A.H.E.R.A.

Management Plan for Asbestos Containing Building Materials

> West Linn High School 5464 West A Street West Linn, OR 97068

TRE Project No. 1020-90

Conducted By:

Prepared by

THREE RIVERS ENVIRONMENTAL, Inc.

ASBESTOS MANAGEMENT PLAN

FOR

West Linn High School 5464 West "A" Street West Linn, OR 97068

ASBESTOS PROGRAM COORDINATOR:

Tim Woodley (503) 673-7041

INSPECTION CONDUCTED BY:

THREE RIVERS ENVIRONMENTAL, Inc.

P.O. BOX 216 Gladstone OR, 97027 Phone: (503) 557-2396 Fax: 557-3025

WEST LINN-WILSONVILLE SCHOOL DISTRICT

TABLE OF CONTENTS

- 1. Introduction/LEA Designate & (Assurances)
 - Overview of Asbestos
 - AHERA Regulations
- 2. Summary of Asbestos Containing Building Materials (ACBM) in this facility
 - AHERA General Data Sheet
 - Locations & Quantities of Asbestos Containing Building Materials
 - Asbestos Location Diagrams
 - Consultants Cost Estimates for Asbestos Removal
- 3. Plan Distribution/Notification
 - Annual (Employee) Notification Records
 - Annual (Parent/Legal Guardian/Occupant) Notification Records
- 4. Notification & Training of Employees/Contractors/Short-Term Workers
 - Contractor Notification Letter
 - Contractor Notification/Acknowledgment
 - Contractor Asbestos Awareness Training Records
- 5. Training Records
 - LEA Designate/Asbestos Awareness Training Records
 - Maintenance/Custodial Staff
 - Personnel Medical Records Respiratory Protection
- 6. Additional Asbestos Material Assessment Reports
 - Asbestos Sample/Material Location Diagram
 - Asbestos Sample Analysis Data
- 7. Additional Asbestos Sample/Assessment Data
- 8. Periodic Surveillance Reports (6-month)
- 9. Three-year Reinspection Reports
- 10. Asbestos Removal Activity/Response Action Recordkeeping
 - Operations & Maintenance (<3 sq. feet or 3 ln. feet)
 - Small Scale (>3 sq. feet or 3 ln. feet) (<40 ln. feet or 80 sq. feet)
 - Full Scale (>40 in. feet or 80 sq. feet)
 - Flow Charts to Determine Adequate Response Actions
- 11. Operations and Maintenance Plan
- 12. Regulatory Agency Correspondence/Overview of Requirements (EPA, DEQ, Oregon OSHA)
- 13. Certificates (Management Planner, Building Inspector, Project Designer, NVLAP) NIOSH 582, 7400 Method Certification

INTRODUCTION

Each LEA must develop an asbestos management plan for school buildings under its authority. This plan is to be submitted to the state Governor (or designee), no later than October 12, 1988. LEA's are required to begin implementation of their management plan by July 9, 1989 and to complete in stages. A copy of the plan must be available in the school administrative offices for viewing by the public.

A management plan should be used as a guidance document for asbestos control. A brief description of the elements of the plan as required by AHERA follows. Other sections of the notebook provide detailed information on the various components of the plan.

Management plans should be considered working documents. They set forth a framework for short and long-term actions to be taken by the LEA to protect building occupants. They must be kept up to date (e.g., response actions, dates and results of surveillance).

This survey was performed using non-destructive sampling methods in order to maintain the integrity of occupied spaces. Any unknown or suspect materials revealed during renovation or demolition of the structure should be tested for asbestos content prior to their disturbance.

The management plan represents the combination of the Inspection Report with a game plan for responding to and maintaining the asbestos containing materials. It is a flexible document that you can easily update. It is designed on an AHERA format and currently exceeds state and federal requirements for managing asbestos materials in commercial properties.

The Management Plan is a document the Owner must continue to use and update. The notebook will be an aid for the following activities:

Identifying and performing initial cleaning
Scheduling response actions
Training your personnel
Maintaining the asbestos containing materials in place
Learning to budget for asbestos activities
Setting building asbestos policies
Notifying affected parties
Keeping records

Remember this plan is not an encyclopedia of all asbestos facts, nor a recitation of the many rules affecting asbestos, nor a substitute for training.

CONCLUSION

The management plan should provide elaboration on all aspects of the plan. For example, in selecting a response action, justification is necessary for the particular choice, rationale for its prioritization and explanation of the resources required to implement the response should appear in the plan.

LOCAL EDUCATION AGENCY (LEA) GENERAL RESPONSIBILITIES UNDER AHERA

Pursuant to Section 763.84 and Section 763.93 of the EPA Asbestos in Schools Regulation (40 CFR Part 763), each management plan must contain a true and correct statement, signed by the LEA designated person, that certifies that the general LEA responsibilities have been met. This form is provided to assist you in complying with this portion of AHERA.

LEA Name: LEA Address: West Linn / Wilsonville School District Stafford Rd. West Linn, OR 97068

Designated Person Name:

Tim Woodley

Designated Person Address: Stafford Rd. West Linn, OR 97068

Phone number:

(503)638-9869

ASSURANCES

- 1. This AHERA management plan was developed and has been submitted pursuant to the Asbestos Hazard Emergency Response Act of 1986, Public law 99-519; and the United States Environmental Protection Agency Rule: Asbestos Containing Materials in Schools, 40 CFR Part 763; and the undersigned does hereby certify that the LEA has and will ensure the following:
- 2. The activities of any persons who perform inspections, reinspections, and periodic surveillance, develop and update management plans, and develop and implement response actions, including operations and maintenance, are carried out in accordance with Part 763.
- 3...All custodial and maintenance employees will be properly trained as required in Part 763 and all other applicable Federal and/or State regulations (e.g., the Occupational Safety and Health Administration Asbestos Standard for Construction, the EPA Worker Protection Rule, or applicable State regulations).
- 4. All workers and building occupants, or their legal guardians, are informed at least once each school year about inspections, response actions, post-response action activities, including periodic reinspection and surveillance activities, that are planned or in progress.
- 5. All short-term workers (e.g., telephone repair workers, utility workers, or exterminators) who may come in contact with asbestos in a school are provided information regarding the locations of ACBM and suspected ACBM assumed to be ACM.
- 6. All warning labels are posted in accordance with Section 763.95.
- 7. All management plans are available for inspection and notification of such availability has been provided as specified in the management plan under Section 763.93(g).
- 8. The undersigned person designated by the LEA pursuant to Section 763.84(g) (1) has received adequate training as stipulated in Section 763.84(g) (2).
- 9. The LEA has and will consider whether any conflict of interest may arise from the interrelationship among accredited personnel and whether that should influence the selection of accredited personnel to perform activities under Part 763.

Signature / 1

LEA Designate Person, pursuant to

40 CFR 763.93(i) and 768.84

Date: 11.1.99

INTRODUCTION

Each LEA must develop an Asbestos Management Plan for school buildings under its authority. This plan is to be submitted to the state Governor (or designee), no later than October 12, 1988. LEA's are required to begin implementation of their management plan by July 9, 1989 and to complete in stages. A copy of the plan must be available in the school administrative offices for viewing by the public.

A Management Plan should be used as a guidance document for asbestos control. A brief description of the elements of the plan as required by AHERA follows. Other sections of the notebook provide detailed information on the various components of the plan.

Management plans should be considered working documents. They set forth a framework for short and long-term actions to be taken by the LEA to protect building occupants. They must be kept up to date (e.g., response actions, dates and results of surveillance).

This survey was performed using non-destructive sampling methods in order to maintain the integrity of occupied spaces. Any unknown or suspect materials revealed during renovation or demolition of the structure should be tested for asbestos content prior to their disturbance.

The Management Plan represents the combination of the Inspection Report with a game plan for responding to and maintaining the asbestos containing materials. It is a flexible document that you can easily update. It is designed on an AHERA format and currently exceeds state and federal requirements for managing asbestos materials in commercial properties.

The Management Plan is a document the Owner must continue to use and update. The notebook will be an aid for the following activities:

Identifying and performing initial cleaning
Scheduling response actions
Training your personnel
Maintaining the asbestos containing materials in place
Learning to budget for asbestos activities
Setting building asbestos policies
Notifying affected parties
Keeping records

Remember this plan in not an encyclopedia of all asbestos facts, nor a recitation of the many rules affecting asbestos, nor a substitute for training.

CONCLUSION

The Management Plan should provide elaboration on all aspects of the plan. For example, in selecting a response action, justification is necessary for the particular choice, rationale for its prioritization and explanation of the resources required to implement the response should appear in the plan.

The Management Plan is viewed as a planning or working document. It not only sets out a course of action for the LEA, but it becomes documentary evidence of progress in implementing asbestos control options. Give the cost and financing information contained in the plan, it provides guidance on matters such as annual and long-term school budgeting and community tax and bond issues. In addition, the Management Plan will help school administrators identify potential funding sources to implement their asbestos control program.

LEA DESIGNATE

Tim Woodley
West Linn-Wilsonville School District 3Jt
22201 S.W. Stafford Road
Tualatin, OR 97068

The Local Education Agency Designate is required by the Final Rules to ensure the School's continuing compliance with the AHERA requirements. The LEA Designates specific requirements are described in 40 CFR Section 763.84 of the Final Rules.

S	SCHOOL ASBESTO	S COORDINATOR
	 	

As is option, the School may appoint a school asbestos coordinator to ensure compliance within a specific school. The coordinator's responsibilities parallel those of the LEA Designate.

LEA DESIGNATE DOCUMENTATION

The school district must designate and train a person to ensure compliance with the requirements of Section 763.84 of the Final Rules. The responsibilities of the LEA Designate's signature and statement of acceptance appears in the last TAB of the Management Plan. If the school board or superintendent has formally assigned the LEA Designate with a letter, memorandum, or similar conveyance, a copy should be filed under this Tab.

The West Linn-Wilsonville School District's Superintendent Roger L. Woehl acknowledges the undersigned person to act as the LEA Designate throughout the West Linn-Wilsonville School District.

Signature: Leanure Woeld	-
Date: ////99	

LEA DESIGNATE

Tim Woodley
West Linn-Wilsonville School District 3Jt
22210 S.W. Stafford Road
Tualatin, OR 97062
(503) 638-9869

LEA DESIGNATE TRAINING

Course Name: AHERA DP
TRAINING
Training Date: 10-14-99
Total hours:
Description:
-Y

LEA DESIGNATE RESPONSIBILITIES

Responsibilities are listed in the federal register included in this section.

Summary of Asbestos Containing Building Materials (ACBM) in this facility.

This section reflects requirements outlined in 40 CFR 763.85 (vi) (B) (c) (d) and (e)

The following subsections contain this required information:

- AHERA General Data Sheet
- Locations and quantities of Asbestos Containing Building Materials
- Asbestos location diagrams
- Consultants cost estimates for asbestos removal

SAMPLE/MATERIAL LOCATION DIAGRAMS

As part of the AHERA Asbestos Inspection the locations of samples collected are recorded on building diagrams. In addition to the sample locations, specific damage areas are recorded where found. The following pages provide the sample location diagrams for the School District. These drawings are organized in the same manner as the inspection/management plan data, i.e., campus one building one is first.

The title block contains the specific state, district, campus, and building or code with a 12 digit number. Next is the District Name, the Campus Name, and finally the Building Name. The next block provides the date the drawing was made, the street number and finally the drawing number.

Location of Caution Label: The AHERA regulations require the use of labels indicating the presence of Asbestos Containing Building Materials (ACBM). The label is to be placed on or near ACBM in routine maintenance areas in all school buildings. When this label is applied in the field the inspector identifies its' location on the sample location diagram. On the drawing, the label symbol contains information about its placement within the routine maintenance area so that it may be readily found by the LEA. The label states the following:

CAUTION ASBESTOS. HAZARDOUS. DO NOT DISTURB WITHOUT PROPER TRAINING AND EQUIPMENT

The presence of sample numbers, crosshatching and damage areas does not mean that all of the areas indicated contain asbestos. These location diagrams are a record of the field inspection only and are meant to show where samples were taken and what areas may be affected if asbestos is present. The determine which areas are affected, a review of the Inspection/Management Plan Data and the Petrographic Results contained in Sections 4 and 5 should be made. If desired, the location diagrams can be highlighted by the school district's asbestos coordinator to indicate the presence of asbestos containing material.

AHERA GENERAL DATA SHEET

SECTION 01314 CERTIFICATION OF NO HAZARDOUS MATERIAL

No final payment shall be made until the Contractor shall file with the Owner, prior to acceptance of the Work, a notarized Certification of Compliance in the following form:

"TO THE BEST OF MY KNOWLEDGE NO HAZARDOUS MATERIAL IS USED IN THE CONSTRUCTION OF THIS PROJECT. MATERIAL SAFETY DATA SHEETS WILL BE PROVIDED AS REQUESTED BY THE OWNER FOR ALL MATERIALS WHICH MAY BE QUESTIONED IN THE FUTURE."

In WITNESS WHEREOF, the undersigned has signed and sealed this instrument this day of ANNAN, #2001.

Firm Name EMERICK CONSTRUCTION

Signature DEVIS LIBARSTAD

Title PROJECT MANAGER

(Attest) Sinda Sauce (SEAL IF CONTRACTOR IS A CORPORATION) OFFICIAL SEAL
LINDA SAUER
NOTARY PUBLIC - OREGON
COMMISSION NO. 336534
MY COMMISSION EXPIRES JULY 17, 2004

As determined necessary, evidence of compliance may be required to be submitted with and made a part of this Certificate.

END OF CERTIFICATION OF NO HAZARDOUS MATERIAL SECTION

ORIGINAL PROVIDE

A.H.E.R.A Designated Person

01-11-01



Date: November 16, 1999

West Linn S.D. P.O. Box 35 West Linn, OR 97068

Attn: Cindy Hepting

Re: Modular Classroom Buildings SER# 9924-1A/B/C & SER# 9924-2A/B/C

MODERN BUILDING SYSTEMS, INC. certifies and warrants that no asbestos or asbestos based products are used in the manufacture of our buildings. Also, MODERN BUILDING SYSTEMS, INC. uses standard construction materials that are approved for their specific use and that to the best of our knowledge meet current law on the limits of formaldehyde for that material.

Sincerely,

Shelly Beyel

Sales/Leasing Coordinator

Darm Lee, 3-Rivers

AHERA MAINT Plan Binder: WLHS Site.

District Admin

Form 581-3111 (7/88)

Name of School Building LEA (District) County	V. Lian H.S Ma	West Linn School Distric	t Clackamas
No. of Occupants: Staff 105 Students State Management Staff Other Management M	ame of School Building		
Address City Zip Code (503)656-2618 Samuel Nutt (503)638-9869 Building Telephone Number District's Asbestos Program Manager Public X Private State COMSTRUCTION DATA Before Year Built: 1930 X 1930-44 1945-60 1961-75 1975 Actual 1924 Additions Dates:24:27:55:61:62:63:66 Size (Sq. Ft. all floors) 192,654 Construction Type: Steel Hood X Concrete Masonry Other Oof Framing: Steel Hood X Concrete Pump Other Heating Hot Forced Electric Heat System: Steam X Mater Air Baseboard Pump Other Renovation: Yes X No Year: 86,87 USE AND OCCUPANCY Primary Use: School X Athletic Facility Office Marehouse Maintenance Building Other (describe) No. of Occupants: Staff 105 Students 113 Maint./Custodial Personnel 11 INSPECTOR* MANAGEMENT PLANNER* Name Gary Adler Name Susiness Hall-kimbrell Business Hall-kimbrell Business Hall-kimbrell		West Linn	97068-0100
District's Asbestos Program Manager Public X Private State CONSTRUCTION DATA Before Year Built: 1930 X 1930-44 1945-60 1961-75 1975 Actual 1924 Additions Dates:24:27:55:61:62:63:66 Size (Sq. Ft. all floors) 192,654 Construction Type: Steel Hood X Concrete Masonry Other District's Asbestos Program Manager After After 1975 Actual 1924 Additions Dates:24:27:55:61:62:63:66 Size (Sq. Ft. all floors) 192,654 Construction Type: Steel Hood X Concrete Masonry Other Poof Framing: Steel Hot Forced Electric Heat System: Steam X Mater Air Baseboard Pump Other Renovation: Yes X No Year: 86,87 USE AND OCCUPANCY Primary Use: School X Athletic Facility Office Marehouse Maintenance Building Other (describe) No. of Occupants: Staff 105 Students 113 Maint./Custodial Personnel 11 INSPECTOR* Name John Newlin Business Hall-kimbrell Business Hall-kimbrell Business Hall-kimbrell		C1 ty	Zip Code
District's Asbestos Telephone Number Program Manager Public X Private State	(503)656-2618	Samuel Nutt	(503)638-9869
CONSTRUCTION DATA Before Year Built: 1930 X 1930-44 1945-60 1961-75 1975 Actual 1924 Additions Dates:24;27:55:61;62:63;66 Size (Sq. Ft. all floors) 192,654 Construction Type: Steel Hood X Concrete Hasonry Other Doof Framing: Steel Hood X Concrete Heating Hot Forced Electric Heat System: Steam X Hater Air Baseboard Pump Other Renovation: Yes X No Year: 86,87 USE AND OCCUPANCY Primary Use: School X Athletic Facility Office Harehouse Maintenance Building Other (describe) No. of Occupants: Staff 105 Students 1131 Maint./Custodial Personnel 11 INSPECTOR* Name Gary Adler Name Gary Adler Name John Newlin Business Hall-Kimbrell Business Hall-Kimbrell	uilding Telephone Number		Telephone Numbe
Refore 1930 X 1930-44 1945-60 1961-75 1975 Actual 1924	ublic <u>x</u> Private	State	
Refore 1930 X 1930-44 1945-60 1961-75 1975 Actual 1924			
Year Built: 1930 X 1930-44 1945-60 1961-75 1975 Actual 1924 Additions Dates:24;27;55;61;62;63;66 Size (Sq. Ft. all floors) 192,654 Construction Type: Steel	Refore	After	<u> </u>
Construction Type: Steel Wood X Concrete Masonry Other poof Framing: Steel Wood X Concrete Heating	ear Built: 1930 X 1930-44	1945-60 1961-75 1975	Actual 1924
Heating Hot Forced Electric Heat System: Steam X Water Air Baseboard Pump Other Renovation: Yes X No Year: 86,87 USE AND OCCUPANCY Primary Use: School X Athletic Facility Office Warehouse Maintenance Building Other (describe) No. of Occupants: Staff 105 Students 1131 Maint./Custodial Personnel 11 INSPECTOR* MANAGEMENT PLANNER* Name Gary Adler Name John Newlin Business Hall-Kimbrell Business Hall-kimbrell	dditions Dates:24 <u>:27:55:61:6</u> 2	2:63;66 Size (Sq. Ft. all floors	192,654
Heating	onstruction Type: Steel	Hood X Concrete Masonry	Other
System: Steam X Mater Air Baseboard Pump Other Renovation: Yes X No Year: 86,87 USE AND OCCUPANCY Primary Use: School X Athletic Facility Office Warehouse Maintenance Building Other (describe) No. of Occupants: Staff 105 Students 1131 Maint./Custodial Personnel 11 INSPECTOR* Name Gary Adler Name John Newlin Business Hall-Kimbrell Business Hall-kimbrell	poof Framing: Steel Wood .	X Concrete	
Renovation: Yes X No Year: 86,87 USE AND OCCUPANCY Primary Use: School X Athletic Facility Office Warehouse Maintenance Building Other (describe) No. of Occupants: Staff 105 Students 1131 Maint./Custodial Personnel 11 INSPECTOR* Name Gary Adler Name John Newlin Business Hall-kimbrell Business Hall-kimbrell	leating Hot System: Steam X Water	Forced Electric Heat Air Baseboard Pump	Other
Primary Use: School X Athletic Facility Office Warehouse Maintenance Building Other (describe) No. of Occupants: Staff 105 Students 1131 Maint./Custodial Personnel 11 INSPECTOR*	·	_	
Primary Use: School X Athletic Facility Office Warehouse Maintenance Building Other (describe) No. of Occupants: Staff 105 Students 1131 Maint./Custodial Personnel 11 INSPECTOR*			
Maintenance Building Other (describe)	ISE AND OCCUPANCY	·	
Maintenance Building Other (describe) No. of Occupants: Staff 105 Students 1131 Maint./Custodial Personnel 11 INSPECTOR* Name Gary Adler Name John Newlin Business Hall-Kimbrell Business Hall-kimbrell	rimary tien: School 'X Athl	atic Facility Office	Warehouse
No. of Occupants: Staff 105 Students 1131 Maint./Custodial Personnel 11 INSPECTOR* Name Gary Adler Business Hall-Kimbrell Business Hall-kimbrell			
INSPECTOR* MANAGEMENT PLANNER* Name Gary Adler Name John Newlin Business Hall-Kimbrell Business Hall-kimbrell	Maintenance Build	ing Other (describe)	
Name Gary Adler Name Name John Newlin Business Hall-Kimbrell Business Hall-kimbrell	lo. of Occupants: Staff 105	Students 1131 Maint./Custodial	Personnel <u>ll</u>
Name Gary Adler Name John Newlin Business Hall-Kimbrell Business Hall-kimbrell			
Business Hall-Kimbrell Business Hall-kimbrell	INSPECTOR*	MANAGEMENT PLANNER	
Business Hall-Kimbrell Business Hall-kimbrell	dame Gary Adler .	Name John New	lin .
^			
80026 Exp. Date 80046 Exp. Date	Business <u>Ha</u> ll-Kimbrell	Business Hall-kir	nbrell

WI.HS Shop West	RAL DATA SHEET	_
, T <u>Y </u>	Linn School District	Clackamas
Name of School Building LEA (District)	County
PO Box 100 West	Linn	97068-0100
Address City		Zip Code
		(503)638-9869
Building Telephone Number Distr	ict's Asbestos ogram Manager	Telephone Numbe
Public <u>x</u> Private St	tate	
CONSTRUCTION DATA Before	After	
Year Built: 1930 1930-44 1945-60 _		Actual 1 <u>961</u>
Additions Dates: 1962 S	Size (Sq. Ft. all floors)	12,764
Construction Type: Steel Hood	Concrete XX Masonry _	Other
noof Framing: Steel Hood XX Conc	rete	
Heating Hot Forced System: Steam Hater XX Air XX	Electric Heat Baseboard Pump	Other
Renovation: Yes XX No	Year: <u>1987</u>	
•		
USE AND OCCUPANCY		
Primary Use: School XX Athletic Facil	lity Office F	iarehouse
	•	
Maintenance Building		
No. of Occupants: Staff 4 Students	120 Maint./Custodial F	Personnel <u>-0-</u>
TNCPFCTOD*	MANAGEMENT PLANNER*	
4 15 2 1, <u>4 3 4 5 7 5 7 5 7 5 7 5 7 5 7 5 7 5 7 5 7 5</u>		
INSPECTOR* Gary Adler .	John Newl.	in
	Name John Newl:	in
Name Gary Adler Business Hall-Kimbrell		

Form 581-3111 (7/88)

<u></u>	AHERA GENERAL DATA SHEET	
WIHS - Music BIDS lame of School Building	West Linn School Distric LEA (District)	t <u>Clackamas</u> County
) Box 100	West Linn	97068-0100
dress	City	Zip Code
(503) 656-2618	Samuel Nutt	(503)638-9869
ilding Telephone Number	District's Asbestos Program Manager	Telephone Number
ublic <u>x</u> Private <u> </u>	State	
DNSTRUCTION DATA Before	After	
ear Built: 1930 1930-44 _	_ 1945-60 1961-75 1975	Actual 1980
dditions Dates:N/A	Size (Sq. Ft. all floor:	12,715
onstruction Type: Steel	Hood Concrete XX Masonry	Other
oof Framing: Steel Wood	XX Concrete	
eating Hot ystem: Steam Water	Forced Electric Heat Air Baseboard Pump	
enovation: Yes No	XX Year: N/A	
SE AND OCCUPANCY		
rimary Use: School <u>XX</u> Ath Maintenance Built	letic Facility Office ding Other (describe)	Harehouse
	Students 120 Maint./Custodial	
_		
NSPECTOR*		
NSPECTOR*		
	Name John New)	in

Form 581-3111 (7/88)

Oregon Department of Education 700 Pringle Parkway SE Salem. OR 97310-0290

	AHERA GENERAL DATA SHEET	
WLHS-PressBox.	West Linn School Distric	t Clackamas
Name of School Building	LEA (District)	County
20 Box 100	West Linn	97068-0100
Address	City	Zip Code
(503) 656-2618	Samuel Nutt	(503)638-9869
Building Telephone Number	District's Asbestos Program Manager	Telephone Number
Public <u>x</u> Private	State	
CONSTRUCTION DATA Before	After	<u> </u>
	1945-60 1961-75 1975	Actual 1986
Additions Dates:N/A	Size (Sq. Ft. all floors	578
- · · · · · · · · · · · · · · · · · · ·	Hood XX Concrete Masonry 2	Other
oof Framing: Steel Wood	Concrete	
Heating Hot System: Steam Hater	Forced Electric Heat Air Baseboard Pump	Other NONE
Renovation: Yes No _X	X Year: N/A	
USE AND OCCUPANCY		
Primary Use: School Athl	etic Facility XX Office	Harehouse
		
	fing Other (describe)	
No. of Occupants: Staff <u>-0-</u>	Students -0- Maint./Custodial	Personnel
	MANAGEMENT PLANNER	•
INSPECTOR*		
	Name John Newl	in
INSPECTOR* Name Gary Adler Business Hall-Kimbrell	<u>Name</u>	

Form 581-3111 (7/88)

Oregon Department of Education 700 Pringle Parkway SE Salem. OR 97310-0290

	AHERA GENERAL DATA SHEET	
WEHG-1901797	West Linn School District	Clackamas
ame of School Building	West Linn School District LEA (District)	County
0 Box 100	West Linn	97068-0100
ddress	City	Zip Code
(503) 656-2618	Samuel Nutt	(503)638-9869
Building Telephone Number	District's Asbestos Program Manager	Telephone Number
Public <u>x</u> Private <u> </u>	State	
CONSTRUCTION DATA Before	After	***
	_ 1945-60 1961-75 1975 XX	Actual 1987
Additions Dates: N/A	Size (Sq. Ft. all floors)	960
	Hood XX Concrete Masonry	_ Other
pof Framing: Steel Hood	XX Concrete	
Heating Hot System: Steam Hater	Forced Electric Heat Air Baseboard Pump	Other NONE
Renovation: Yes No _	XX Year: N/A	
Renovation: Yes No _	XX Year: N/A	
	<u>XX</u> Year: <u>N/A</u>	
USE AND OCCUPANCY Primary Use: School Athl	letic Facility Office H	arehouse XX
USE AND OCCUPANCY Primary Use: School Athl Haintenance Build	letic Facility Office W	
USE AND OCCUPANCY Primary Use: School Athl Maintenance Build	letic Facility Office H	
USE AND OCCUPANCY Primary Use: School Athl Maintenance Build No. of Occupants: Staff0-	letic Facility Office H ding _XX Other (describe) Students0- Maint./Custodial P	ersonnel <u>-0-</u>
Primary Use: School Athle Maintenance Build No. of Occupants: Staff0-	letic Facility Office H ding _XX Other (describe) Students0- Maint./Custodial P	ersonnel <u>-0-</u>
USE AND OCCUPANCY Primary Use: School Athl Maintenance Build	letic Facility Office Wing _XX Other (describe) StudentsO Maint./Custodial P MANAGEMENT PLANNER* Name John Newli	ersonnel <u>-0-</u>

Form 581-3111 (7/88)

Oregon Department of Education 700 Pringle Parkway SE Salem, OR 97310-0290

	AHERA GENE	RAL DATA SHEET	· · · · · · · · · · · · · · · · · · ·	<u></u>
WLHS-Concession		Linn School District)		Clackamas
Name of School Building				County
0 Box 100	West	Linn	<u>. </u>	97068-0100
Address	Ci ty			Zip Code
(503)656-2618		uel Nutt		(503)638-9869
Building Telephone Numb	=	ict's Asbestos gram Manager		Telephone Number
Public <u>x</u> Priv	ate St	ate		
CONSTRUCTION DATA Before			After	·
Year Built: 1930 19	30-44 1945-60 _	_ 1961-75	1975	Actual 1987
Additions Dates:	N/A S	ize (Sq. Ft. a	ll floors)	178
Construction Type: Ste	el Hood	Concrete <u>XX</u>	Masonry	Other
oof Framing: Steel _	_ Hood XX Concr	ete		
Heating Hot System: Steam Wai	: Forced :er Air	Electric Baseboard _	Heat Pump	Other NONE
Renovation: Yes	No XX	Year: _	N/A	
USE AND OCCUPANCY Primary Use: School _ Maintenar No. of Occupants: Staf	nce Building	Other (describ	e)	
INSPECTOR*		MANAGEMENT	PLANNER*	
Name Gary Adler		Name J	ohn Newli	n
Business Hall-Kimbre	11	Business	Hall-kimb	rell
80026 Exp.	Date	# 80046	Exp.	Date
ourse Provider Hall *Primary person if more	-Kimbrell e than one person.			<u> </u>

Form 581-3111 (7/88)

OREGON DEPARTMENT OF EDUCATION 700 Pringle Parkway SE Salem, Oregon 97310-0290

Office of School District Services 378-6964

SUMMARY DATA SHEET

Facility Name and Address	est Linn	High School	
Preparer Name and Phone NoK	athy Cameron	n (913) 865-9455	Date 4/27/89

AHERA		Type of Asbestos-Containing Bullding Materials (ACBM)				
Damage Category		Surfacing	Thermal System	n insulation (TSI)	Miscellaneous	
<u>.</u>		- Surfacing	Lineal Feet	Square Feet	Wiscenarieous	
Damaged or signific damaged TSI ACM	antiy	21531			in.	
2. Damaged friable surfacing ACM	· · · -					
3. Significantly damage friable surfacing AC						
Damaged or signific damaged friable mis laneous ACM						
5. ACBM with potential damage	i for		6092	2927	157055	
R. ACBM with potential significant damage	l for					
7. Other friable ACBM, friable suspected ACBM	, or					
8. Nontriable ACBM, o nontriable suspecte ACBM						
Total ACBM (Total 1 through 8)	Fţ²	21531		2927	157055	
(10tar i tilloogii 8)	LF.	Marie Marie Marie Marie de la company	6092			
Total Friable ACBM	Ft2			왕 생		
(Total 1 through 7)	L.F.					

LOCATIONS & QUANTITIES OF ASBESTOS CONTAINING BUILDING MATERIALS

Campus: 001 West Linn High School

DAMAGE CATEGORY:

ACBM with Potential for Damage

AHERA COMPLIANCE PROGRAM

West Linn S.D. 3JT 37-0050

CAMPUS : 001 - West Linn High School BUILDING : 001 - West Linn High Main Bldg. Inspection Dates: 07/18/88 to 07/14/89 Inspected By: Gary Adler

Certification #: HK80026 St: KS State Cert #: St:

State Cert #: Gross Square Ft:

POTENTIAL FOR DISTURBANCE:

Slight

Sample# %asb

40

50

60

67

68

69

217,700

* * 	* INSPECTION RESULTS	UNIFIED SAMPLI	NG AREA NUMBER - 03	* * *		
SYSTEM: Low Pr. Steem	LOCATION: All Floors in Build	TYPE OF MATERIAL: Pipe Co			Covering	
DAMAGE CATEGORY: ACBM with Potential for Damage			POTENTIAL FOR DI	STURBANCE :	SAMPLE# 64 65 66	%AS 55 60 60
MATERIAL QUANTITIES	REMOVAL CO	OST	REPLACEMENT COSTS	TOTA	L COSTS	
150 Ft. 4 In. O.D 965 Ft. 6 In. O.D 1133 Ft. 8 In. O.D	\$12,52	5	\$837 \$7,826 \$11,455	\$2	2,175 0,352 7,487	
			AREA TOTAL	\$5	0,014	
RECOMMENDED RESPONSE ACTION: DAM Maintain/Monitor	management Priority 3		. PREVENTIVE M	EASURES: nd OWM Code:	OMA	
LEA RESPONSE:			RESPONSE ACTION S	CHEDULE		
ACTION ELECTION: Same as recommended		STA	RT DATE	COMBITE	TION DATE	
Comments:	ļ	Summer 1989		Ongoing		
****************		******	********	********	******	****
* *	* INSPECTION RESULTS	Unified Sampli	NG AREA NUMBER - 04	* * *		
SYSTEM: Low Pr. Steam	LOCATION: All Floors in Build	ing	TYPE OF MATERIAL	: MJP on Pipe	Covering	

REASON for DAMAGE CATEGORY:

good condition.

The material is observed to be in

West Linn S.D. 3JT 37-0050

CAMPUS : 001 - West Linn High School BUILDING : 001 - West Linn High Main Bldg. Inspection Dates: 07/18/88 to 07/14/89

Inspected By: Gary Adler

Certification #: HK80026 St: KS

State Cert #: Gross Square Ft:

St: 217,700

ATERIAL QUANTITIES	REMOVAL COST	REPLACEMENT COSTS	TOTAL COSTS
212 4 In. O. D.	\$5,955	\$3,309	\$9,264
180 6 In. O. D.	\$6,962	\$4,090	\$11,052
159 % In. O. D.	\$7,653	\$4,500	\$12,153
		AREA TOTAL	\$32,469

RECOMMENDED RESPONSE ACTION: PRIORITY: PREVENTIVE MEASURES: OaM Maintain/Monitor See Part I and OSM Code: OMA LEA RESPONSE: RESPONSE ACTION SCHEDULE ACTION ELECTION: Same as recommended START DATE COMPLETION DATE Summer 1989 COMMENTS: Ongoing * * * Inspection results unified sampling area number - 05 * * * SYSTEM: Dom. Hot Water LOCATION: TYPE OF MATERIAL: Pipe Covering All Floors in Building DAMAGE CATEGORY: REASON for DAMAGE CATEGORY: POTENTIAL FOR DISTURBANCE: SAMPLE# ACBM with Potential for Damage The material is observed to be in Slight 70 45 good condition. 71 50 72 50 MATERIAL QUANTITIES REMOVAL COST REPLACEMENT COSTS TOTAL COSTS 1766 Ft. 4 In. O.D. S15.753 \$9,854 \$25,607 AREA TOTAL \$25,607 PREVENTIVE MEASURES: RECOMMENDED RESPONSE ACTION: PRIORITY: OWM Maintain/Monitor See Part I and OaM Code: OMA LEA RESPONSE: RESPONSE ACTION SCHEDULE ACTION ELECTION: Same as recommended START DATE COMPLETION DATE COMMENTS: Summer 1989 Ongoing *********************************

West Linn S.D. 3JT 37-0050

CAMPUS : 001 - West Linn High School BUILDING : 001 - West Linn High Main Bldg.

Inspected By: Gary Adler Certification #: HK80026 State Cert #:

St: KS St:

Inspection Dates: 07/18/88 to 0			uare ft: 217,700
**	* Inspection results un	ified sampling area number - 06	* * *
SYSTEM: Dom. Hot Water	LOCATION: All Floors in Building		L: MJP on Pipe Covering
DAMAGE CATEGORY: ACBM with Potential for Damage	REASON for DAMAGE CATE The material is observ good condition.		ISTURBANCE: SAMPLE# %ASB 73 50 74 50 75 60
MATERIAL QUANTITIES	REMOVAL COST	REPLACEMENT COSTS	TOTAL COSTS
360 4 In. O. D.	\$10,112	\$5,620	\$15,732
		AREA TOTA	\$15,732
RECOMMENDED RESPONSE ACTION: Oam Maintain/Monitor	Management pla Priority: . 3	N RECOMMENDATION	MEASURES: and Oam Code: OMA
LEA RESPONSE:		RESPONSE ACTION	SCHEDULE
ACTION ELECTION: Same as recommended		START DATE	COMPLETION DATE
COMMENTS:	Su	nmer 1989	Ongoing
*********	*******	***********	***************
1	* INSPECTION RESULTS UN	vified sampling area number - 07	* * *
SYSTEM: Dom. Cold Water	LOCATION: All Floors in Building		L: Corrugated Pipe Covering
DAMAGE CATEGORY: ACBM with Potential for Damage	REASON for DAMAGE CATE The material is observed		FISTURBANCE: SAMPLE# %ASE 76 30 77 30
	The material is observ		76

West Linn S.D. 3JT 37-0050

CAMPUS : 001 - West Linn High School BUILDING : 001 - West Linn High Main Bldg. Inspection Dates: 07/18/88 to 07/14/89

Inspected By: Gary Adler
Certification #: HK80026 St: KS
St: St:

State Cert #: Gross Square Ft:

217,700 St

MATERIAL QUANTITIES	REMOVAL C	DST RE	PLACEMENT COSTS	TOTAL COSTS
933 Pt. 4 In. O.D.	\$8,32	21	\$5,206	\$13,528
			AREA TOTAL	\$13,528
 	MANAGEMENT	PLAN RECOMMENDATI	ON	
COMMENDED RESPONSE ACTION: M Maintain/Monitor	Priority 3	':	PREVENTIVE MEA	SURES: LOEM Code: OMA
•				
A RESPONSE: TION ELECTION:	1		RESPONSE ACTION SCH	EDULE
Same as recommended	,	START	DATE	COMPLETION DATE
mments:		Summer 1989		Ongoing
*********	, ,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	********	*******	<u> </u>
		_		
* * *	INSPECTION RESULTS	UNIFIED SAMPLING	AREA NUMBER - 08 *	* *
	LOCATION: All Floors in Build	ing	TYPE OF MATERIAL:	MJP on Corr, Pipe Cover
•	All Floors in Build	•		
Mage Category:	All Floors in Build	Ategory:	POTENTIAL FOR DIST	Turbance: Sample# 1
MAGE CATEGORY: BM with Potential for Damage	All Floors in Build REASON for DAMAGE C The material is obs	Ategory:	POTENTIAL FOR DIST	
MAGE CATEGORY: BM with Potential for Damage	All Floors in Build	Ategory:	POTENTIAL FOR DIST	TURBANCE: SAMPLE# 179
WAGE CATEGORY: BM with Potential for Damage	All Floors in Build REASON for DAMAGE C The material is obs	ATEGORY: erved to be in	POTENTIAL FOR DIST	TURBANCE: SAMPLE# 1 79 80
MATERIAL QUANTITIES	REASON for DAMAGE Control of the material is observed condition.	ATEGORY: erved to be in	POTENTIAL FOR DIST Slight PLACEMENT COSTS	TURBANCE: SAMPLE# 1 79 80 81 TOTAL COSTS
MAGE CATEGORY: BM with Potential for Damage	All Floors in Build REASON for DAMAGE C The material is obs good condition.	ATEGORY: erved to be in	POTENTIAL FOR DIST Slight	TURBANCE: SAMPLE# 1 79 80 81
MATERIAL QUANTITIES	REASON for DAMAGE Control of the material is observed condition.	ATEGORY: erved to be in	POTENTIAL FOR DIST Slight PLACEMENT COSTS	TURBANCE: SAMPLE# 1 79 80 81 TOTAL COSTS
MATERIAL QUANTITIES 202 4 In. O. D.	REASON for DAMAGE Control of the material is observed condition.	ATEGORY: erved to be in OST RE	POTENTIAL FOR DIST Slight SPLACEMENT COSTS \$3,153 AREA TOTAL	TURBANCE: SAMPLE# 179 80 81 TOTAL COSTS \$8,827
MATERIAL QUANTITIES 202 4 In. O. D.	REASON for DAMAGE Commentation.	ATEGORY: erved to be in OST RE	POTENTIAL POR DIST SLight PLACEMENT COSTS \$3,153 AREA TOTAL CON PREVENTIVE MEA	TURBANCE: SAMPLE# 179 80 81 TOTAL COSTS \$8,827
MATERIAL QUANTITIES 202 4 In. O. D. COMMENDED RESPONSE ACTION:	REASON for DAMAGE Content of the material is observed condition. REMOVAL CONTENT OF THE PRIORITY PRIORITY PRIORITY	ATEGORY: erved to be in OST RE	POTENTIAL FOR DIST Slight PLACEMENT COSTS \$3,153 AREA TOTAL CON PREVENTIVE MEP See Part I and	TURBANCE: SAMPLE# 1 79 80 81 TOTAL COSTS \$8,827 \$8,827 \$8,827
MATERIAL QUANTITIES 202 4 In. O. D. COMMENDED RESPONSE ACTION: Maintain/Monitor A RESPONSE:	REASON for DAMAGE Content of the material is observed condition. REMOVAL CONTENT OF THE PRIORITY PRIORITY PRIORITY	ATEGORY: erved to be in OST RE	POTENTIAL POR DIST SLight PLACEMENT COSTS \$3,153 AREA TOTAL CON PREVENTIVE MEA	TURBANCE: SAMPLE# 1 79 80 81 TOTAL COSTS \$8,827 \$8,827 \$8,827
MATERIAL QUANTITIES 202 4 In. O. D.	REASON for DAMAGE Content of the material is observed condition. REMOVAL CONTENT OF THE PRIORITY PRIORITY PRIORITY	CATEGORY: erved to be in COST RE- PLAN RECOMMENDATI	POTENTIAL FOR DIST Slight PLACEMENT COSTS \$3,153 AREA TOTAL CON PREVENTIVE MEP See Part I and	TURBANCE: SAMPLE# 1 79 80 81 TOTAL COSTS \$8,827 \$8,827 \$8,827

West Linn S.D. 3JT 37-0050

CAMPUS: 001 - West Linn Nigh School BUILDING: 001 - West Linn High Main Bldg. Inspection Dates: 07/18/88 to 07/14/89

Inspected By: Gary Adler
Certification #: HK80026 St: KS
State Cert #: St:
Gross Square Ft: 217 700

Inspection Dates: 07/18/88 t	o U//14/89	Gross Square	FE: 217,700
	* * * INSPECTION RESULTS UNIFIED S	AMPLING AREA NUMBER - 09 *	
SYSTEM: Ceiling Matl.	LOCATION: All Ploors in Building	TYPE OF MATERIAL:	Orop or Lay-in Panel
DAMAGE CATEGORY: N/A	REASON for DAMAGE CATEGORY:	POTENTIAL FOR DIST	urbance: Sample# %asb 82 0
MATERIAL QUANTITIES	REMOVAL COST	REPLACEMENT COSTS	TOTAL COSTS
64000 Square Fee	·t	area total	\$0
RECOMMENDED RESPONSE ACTION:		MENDATION	
LEA RESPONSE: ACTION ELECTION:	1	RESPONSE ACTION SCH	EDULE COMPLETION DATE
COMMENTS:	ļ	n/a	
****************	* * INSPECTION RESULTS UNIFIED	**************************************	
	West and the same of the same	The state of the s	
SYSTEM: Ceiling Matl.	LOCATION: First Floor	TYPE OF MATERIAL:	Açoustical Tile (1xi)
DAMAGE CATEGORY:	REASON for DAMAGE CATEGORY:	Potential for dist N/A	TURBANCE: SAMPLE# %ASE 83 0

5

SYSTEM: Surfacing Mat.

AHERA COMPLIANCE PROGRAM

West Linn S.D. 3JT 37-0050

CAMPUS : 001 - West Linn High School BUILDING: 001 - West Linn High Main Bldg. Inspection Dates: 07/18/88 to 07/14/89 Inspected By: Gary Adler

Certification #: HK80026

State Cert #:

TYPE OF MATERIAL: Acoustical/Thermal Plaster

5t: 217,700

St: KS

Gross Square Ft: MATERIAL QUANTITIES REMOVAL COST REPLACEMENT COSTS TOTAL COSTS 10000 Square Feet AREA TOTAL \$0 RECOMMENDED RESPONSE ACTION: PRIORITY: PREVENTIVE MEASURES: N/A See Part I and OWM Code: LEA RESPONSE: RESPONSE ACTION SCHEDULE ACTION ELECTION: START DATE COMPLETION DATE COMMENTS: N/A N/A ****************** * * * INSPECTION RESULTS UNIFIED SAMPLING AREA NUMBER - 11 * * *

DAMAGE CATEGORY: REASON for DAMAGE CATEGORY: POTENTIAL FOR DISTURBANCE: Sample# ₹ASB Damaged or significantly 10 The material has undergone a High 84 damaged thermal system noticeable degree of contact 85 15 insulating ACM. 86 10 damage. 87 10 88 10 89 25 90 91 15 92 20 93

LOCATION:

First Floor

West Linn S.D. 3JT 37-0050

CAMPUS : 001 - West Linn High School BUILDING : 001 - West Linn High Main Bldg. Inspection Dates: 07/18/88 to 07/14/89

Inspected By: Gary Adler
Certification #: HK80026 St: KS
State Cert #: St:
Gross Square Ft: 217,700

MATERIAL QUANTITIES	REMOVAL C	ost ! R	EPLACEMENT COSTS	TOTAL COSTS
21531 Square Feet	\$371,62	1111	\$57,488	\$429,113
			AREA TOTAL	\$429,113
'				
COMMENDED RESPONSE ACTION: pair and OWM	PRICRITY 1	:	PREVENTIVE MEA See Part I and	SURES: GLM Code: OMD
A RESPONSE:			RESPONSE ACTION SCH	EDULE
FION ELECTION: Same as recommended		STAR	T DATE	COMPLETION DATE
ments:		Summer 1989		Ongoing
*********	******		G AREA NUMBER - 97 *	****
STEM: Floor Matl.	LOCATION: All Floors in Build	ding	TYPE OF MATERIAL:	Vinyl Floor Tile
Mage Category:	All Floors in Build	Category :	TYPE OF MATERIAL: POTENTIAL FOR DIST Slight	•
Mage Category:	All Floors in Build REASON for DAMAGE (The material is obs	PATEGORY: served to be in	POTENTIAL FOR DIST	furbance: Sample# :
MAGE CATEGORY: MM with Potential for Damage	REASON for DAMAGE (The material is observed condition.	CATEGORY: served to be in	POTENTIAL FOR DIST Slight	TURBANCE: SAMPLE# 3 47
MAGE CATEGORY: M with Potential for Damage MATERIAL QUANTITIES	REASON for DAMAGE (The material is obs- good condition.	CATEGORY: served to be in	POTENTIAL FOR DIST Slight REPLACEMENT COSTS	TURBANCE: SAMPLE# 47
MAGE CATEGORY: EM with Potential for Damage MATERIAL QUANTITIES 50000 Square Feet	REASON for DAMAGE Control of the material is observed condition. REMOVAL CONTROL OF STAR STAR STAR STAR STAR STAR STAR STAR	CATEGORY: Served to be in COST F	POTENTIAL FOR DIST Slight REPLACEMENT COSTS \$128,000 AREA TOTAL	TURBANCE: SAMPLE# 47 TOTAL COSTS \$296,500 \$296,500
MAGE CATEGORY: MATERIAL QUANTITIES 50000 Square Feet	REASON for DAMAGE Of The material is observed condition.	CATEGORY: Served to be in COST F	POTENTIAL FOR DIST Slight REPLACEMENT COSTS \$128,000 AREA TOTAL TION	TOTAL COSTS \$296,500 \$296,500
MAGE CATEGORY: BM with Potential for Damage MATERIAL QUANTITIES 50000 Square Feet COMMENDED RESPONSE ACTION: M Maintain/Monitor A RESPONSE:	REASON for DAMAGE (The material is observed to the material observed t	CATEGORY: Served to be in COST F	POTENTIAL FOR DIST Slight REPLACEMENT COSTS \$128,000 AREA TOTAL TION	TOTAL COSTS \$296,500 \$296,500 ASURES: d Oam Code: CMI, CMZ
MAGE CATEGORY: BM with Potential for Damage MATERIAL QUANTITIES 50000 Square Feet COMMENDED RESPONSE ACTION: M Maintain/Monitor	REASON for DAMAGE (The material is observed to the material observed t	CATEGORY: Served to be in COST F	POTENTIAL FOR DIST Slight REPLACEMENT COSTS \$128,000 AREA TOTAL FION	TOTAL COSTS \$296,500 \$296,500 ASURES: d Oam Code: CMI, CMZ

West Linn S.D. 3JT 37-0050

CAMPUS : 001 - West Linn High School BUILDING : 001 - West Linn High Main Bldg. Inspection Dates: 07/18/88 to 07/14/89

Inspected By: Gary Adler

Certification #: HK80026 St: KS

State Cert #: Gross Square Ft:

st: 217,700

* * * INSPECTION RESULTS UNIFIED SAMPLING AREA NUMBER - 98 * * *

sysTEM: Non-Friable LOCATION: TYPE OF MATERIAL: Transite Siding All Floors in Building REASON for DAMAGE CATEGORY: POTENTIAL FOR DISTURBANCE: SAMPLE# RASB DAMAGE CATEGORY: ACRM with Potential for Damage The material is observed to be in Slight Assumed good condition. MATERIAL QUANTITIES REMOVAL COST REPLACEMENT COSTS TOTAL COSTS \$2,044 400 Square Feet \$2,860 \$4,904 AREA TOTAL \$4,904

RECOMMENDED RESPONSE ACTION: OEM Maintain/Monitor

PRIORITY:

PREVENTIVE MEASURES:

See Part I and OaM Code: OMZ

LEA RESPONSE: ACTION ELECTION:

Same as recommended

COMMENTS:

START DATE

Summer 1989

RESPONSE ACTION SCHEDULE

Ongoing

COMPLETION DATE

* * * INSPECTION RESULTS UNIFIED SAMPLING AREA NUMBER - 99 * * *

SYSTEM: Floor Matl.

LOCATION:

All Floors in Building

TYPE OF MATERIAL: Vinyl Floor Tile

DAMAGE CATEGORY: ACBM with Potential for Damage REASON for DAMAGE CATEGORY: The material is observed to be in good condition.

POTENTIAL FOR DISTURBANCE:

Slight

SAMPLE# %ASB 46 10

West Linn S.D. 3JT 37-0050

CAMPUS : 001 - West Linn High School BUILDING : 001 - West Linn High Main Bldg. Inspection Dates: 07/18/88 to 07/14/89

Inspected By: Gary Adler
Certification #: HK80026 St: KS
St: St:

State Cert #: Si Gross Square Ft: 217,700

MATERIAL QUANTITIES	REMOVAL COST	REPLACEMENT COSTS	TOTAL COSTS
86055 Square Feet	\$290,005	\$220,301	\$510,306
		AREA TOTAL	\$510,306
MMENDED RESPONSE ACTION:	MANAGEMENT PLAN REC	OMMENDATION	URES:
Maintain/Monitor	3 .	See Part I and	OEM Code: OMI, OMZ
RESPONSE:	, 	RESPONSE ACTION SCHE	DOTE .
test or newfort.	!	START DATE	COMPLETION DATE
ON ELECTION: Same as recommended	!	SIRKI DAZE	

AHERA COMPLIANCE PROGRAM *** BOILER ROOM SUMMARY *** West Linn S.D. 3JT

37-0050

CAMPUS : 001 - West Linn High School BUILDING : 001 - West Linn High Main Bldg.

BOILER RM: 1

Inspected By: Gary Adler

Certification #: HK80026

St: KS

State Cert #:

st:

BOILER

DAMAGE CATEGORY:

ACBM with Potential for Damage

REASON for DAMAGE CATEGORY: The material is observed to be in good condition.

POTENTIAL FOR DISTURBANCE:

Slight

\$ASB* SY	STEM ID	LOCATION	MATERIAL DESCRIPTION	MATERIAL QUANTITY
50% Mech. I	Insul. N BO	ILER E SIDE	Boiler/Tank Insulation	600 Square Feet
50% Mech. 1	[nsul. N BO	iler e side	Boiler/Tank Insulation	-
0% Mech. 1	Insul. N BO	ILER E SIDE	Boiler/Tank Insulation	
40% Mech. 1	Insul. S BO	ILER E SIDE	Boiler/Tank Insulation	600 Square Feet
45% Mech. 1	Insul. S BO	ILER E SIDE	Boiler/Tank Insulation	
45% Mech. 3	Insul. S BO	ILER E SIDE	Boiler/Tank Insulation	
40% Mech. 1	Insul. DHW'	TANK 2 SIDE	Boiler/Tank Insulation	300 Square Feet
50% Mech. 1	Insul. DHW	TANK E SIDE	Boiler/Tank Insulation	-
45% Mech. 3	Insul. DHW	TANK E SIDE	Boiler/Tank Insulation	
30% Miscell	laneous GASK	et on bl e sid	E Gasket	4 Square Feet
^				-

RECOMMENDED RESPONSE ACTION:

OSM Maintain/Monitor

PRIORITY: 3

PREVENTIVE MEASURES: See Part I and OEM Code: OMZ

LEA RESPONSE:

ACTION ELECTION:

Same as recommended

LEA COMMENT:

START DATE

RESPONSE ACTION SCHEDULE

Summer 1989

Ongoing

COMPLETION DATE

PEMOUED RM. INSUL.

AHERA COMPLIANCE PROGRAM *** BOILER ROOM SUMMARY *** West Linn S.D. 3JT

37-0050

Inspected By: Gary Adler

Certification #: HK80026 st: Ks State Cert #:

st:

CAMPUS : 001 - West Linn High School BUILDING : 001 - West Linn High Main Bldg.

BOILER RM: 1

JOINTS

DAMAGE CATEGORY:

ACBM with Potential for Damage

REASON for DAMAGE CATEGORY: The material is observed to be in good condition.

POTENTIAL FOR DISTURBANCE:

Slight

MP	%ASB* SYSTEM ID	LOCATION	MATERIAL DESCRIPTION	MATERIAL QUANTITY
50	45% Low Pr. Steam	BETWEEN BOILER 142 E SIDE	MJP on Pipe Covering	39 6 în. O. D.
50	45% Low Pr. Steam	BETWEEN BOILER 142 E SIDE	MJP on Pipe Covering	25 10 In. O. D.
50	45% Low Pr. Steam	BETWEEN BOILER 142 E SIDE	MJP on Pipe Covering	30 12 In. O. D.
50	45% Low Pr. Steam	BETWEEN BOILER 142 E SIDE	MJP on Pipe Covering	25 14 In. O.D.
52	25% Dom. Hot Water	BETWEEN BOILER 142 E SIDE	MJP on Corr. Pipe Cover	35 4 In. O. D.
52	25% Dom. Hot Water	BETWEEN BOILER 142 E SIDE	MJP on Corr. Pipe Cover	22 6 In. O. D.
54	0% Dom. Cold Water	BETWEEN BOILER 142 E SIDE	MJP on Corr. Pipe Cover	50 4 In. O. D.
54	0% Dom. Cold Water	BETWEEN BOILER 142 E SIDE	MJP on Corr. Pipe Cover	22 6 In. O. D.

RECOMMENDED RESPONSE ACTION: OLM Maintain/Monitor

PRIORITY: 3

PREVENTIVE MEASURES:

See Part I and ORM Code: OMA

ACTION ELECTION:

LEA RESPONSE:

Same as recommended

COMMENT:

RESPONSE ACTION SCHEDULE

START DATE

COMPLETION DATE

Summer 1989

Ongoing

AHERA COMPLIANCE PROGRAM *** BOILER ROOM SUMMARY *** West Linn S.D. 3JT

37-0050

Inspected By: Gary Adler

State Cert #:

Certification #: HK80026

St: KS St:

CAMPUS : 001 - West Linn Righ School BUILDING : 001 - West Linn High Main Bldg.

BOILER RM: 1

PIPING

DAMAGE CATEGORY:

ACBM with Potential for Damage

REASON for DAMAGE CATEGORY: The material is observed to be in good condition.

POTENTIAL FOR DISTURBANCE:

Slight

SMP	tase* system id	LOCATION	MATERIAL DESCRIPTION	MATERIAL QUANTITY
49	45% Low Pr. Steam	BETWEEN BOILER 142 E SIDE	Pipe Covering	150 Ft. 6 In. O.D.
49	45% Low Pr. Steam	BETWEEN BOILER 142 E SIDE	Pipe Covering	100 Ft. 10 In. O.D.
49	45% Low Pr. Steam	BETWEEN BOILER 1&2 E SIDE	Pipe Covering	130 Ft. 12 In. o.b.
49	45% Low Pr. Steam	BETWEEN BOILER 142 E SIDE	Pipe Covering	50 Ft. 14 In. O.D.
j 51	6% Dom. Hot Water	BETWEEN BOILER 142 E SIDE	Corrugated Pipe Covering	110 Ft. 4 In. O.D.
i 51	6% Dom. Hot Water	BETWEEN BOILER 142 E SIDE	Corrugated Pipe Covering	75 Ft. 6 In. O.D.
i 53	6% Dom. Cold Water	BETWEEN BOILER 122 E SIDE	Corrugated Pipe Covering	150 Ft. 4 In. O.D.
53	6% Dom. Cold Water	BETWEEN BOILER 142 E SIDE	Corrugated Pipe Covering	75 Ft. 6 In. O.D.
İ			-	

RECOMMENDED RESPONSE ACTION: PRIORITY: PREVENTIVE MEASURES: OEM Maintain/Monitor 3 See Part I and OaM Code: OMA LEA RESPONSE: RESPONSE ACTION SCHEDULE ACTION ELECTION: START DATE COMPLETION DATE Same as recommended COMMENT: Summer 1989 Ongoing REMOVAL COST REPLACEMENT COSTS TOTAL COSTS BOILER ROOM ESTIMATED COSTS \$63,950 \$48,149 \$112,099

AHERA COMPLIANCE PROGRAM *** BOILER ROOM SUMMARY ***

West Linn S.D. 3JT 37-0050

CAMPUS : 001 — West Linn High School BUILDING : 001 — West Linn High Main Bldg.

BOILER RM: 2

Inspected By: Gary Adler

Certification #: HK80026 State Cert #:

st: KS st:

BOILER

DAMAGE CATEGORY:

ACBM with Potential for Damage

REASON for DAMAGE CATEGORY:

The material is observed to be in

good condition.

POTENTIAL FOR DISTURBANCE:

Slight

SMP	%ASB*	SYSTEM ID	LOCATION	MATERIAL DESCRIPTION	MATERIAL QUANTITY
56	0% Mech.	Insul.	DHW TANK E SIDE	Boiler/Tank Insulation	200 Square Feet
57	O% Mech.	Insul.	DHW TANK E SIDE	Boiler/Tank Insulation	
58	0% Mech.	Insul.	DHW TANK E SIDE	Boiler/Tank Insulation	
59	50% Mech.	Insul.	DHW XCHANGE TANK S	Boiler/Tank Insulation	60 Square Feet
60	60% Mech.	Insul.	DHW XCHANGE TANK S	Boiler/Tank Insulation	-
61	50% Mech.	Insul.	DHW XCHANGE TANK S	Boiler/Tank Insulation	

RECOMMENDED RESPONSE ACTION: OEM Maintain/Monitor

PRIORITY: 3

PREVENTIVE MEASURES:

RESPONSE ACTION SCHEDULE

See Part I and OaM Code: OMB

LEA RESPONSE: ACTION ELECTION:

Same as recommended

COMMENT:

START DATE

COMPLETION DATE

Summer 1989

Ongoing

AHERA COMPLIANCE PROGRAM *** BOILER ROOM SUMMARY *** West Linn S.D. 3JT

37-0050

Inspected By: Gary Adler

Certification #: HR80026 State Cert #:

st: KS st:

CAMPUS : 001 - West Linn High School BUILDING: 001 - West Linn High Main Bldg. BOILER RM: 2

JOINTS

DAMAGE CATEGORY:

ACEM with Potential for Damage

REASON for DAMAGE CATEGORY:

The material is observed to be in

good condition.

POTENTIAL FOR DISTURBANCE:

Slight

SMP	*ASB*	SYSTEM ID	LOCATION	MATERIAL DESCRIPTION	MATERIAL QUANTITY
	303 Ban	. Hot Water	SW CORNER	MJP on Corr. Pipe Cover	30 4 In. O. D.
63 63		. Hot Water	SW CORNER SW CORNER	MJP on Corr. Pipe Cover	25 6 In. O. D.
63		. Hot Water	SW CORNER	MJP on Corr. Pipe Cover	19 8 In. O. D.
i			<u> </u>	<u> </u>	<u> </u>
				PLAN RECOMMENDATION— — — — — — — — —	

RECOMMENDED RESPONSE ACTION:

Oam Maintain/Monitor

PRIORITY:

PREVENTIVE MEASURES:

See Part I and OaM Code: OMA

LEA RESPONSE:

COMMENT:

ACTION ELECTION:

Same as recommended

RESPONSE ACTION SCHEDULE

START DATE

COMPLETION DATE

Summer 1989

Ongoing

PIPING

DAMAGE CATEGORY:

ACBM with Potential for Damage

REASON for DAMAGE CATEGORY:

The material is observed to be in

good condition.

POTENTIAL FOR DISTURBANCE:

Slight

SMP	%ASB*	SYSTEM ID	LOCATION	MATERIAL DESCRIPTION	MATERIAL QUANTITY
62	35% Dom.	Hot Water	SW CORNER	Corrugated Pipe Covering	175 Ft. 4 In. O.D.
62		Hot Water	SW CORNER	Corrugated Pipe Covering	65 Ft. 6 In. O.D.
62	35% Dom.	Hot Water	SW CORNER	Corrugated Pipe Covering	65 Ft. 8 In. O.D.
1					
			MANAGEMENT	PLAN RECOMMENDATION	

RECOMMENDED RESPONSE ACTION: OEM Maintain/Monitor

PRIORITY: 3

PREVENTIVE MEASURES:

See Part I and O&M Code: OMA

LEA RESPONSE:

ACTION ELECTION:

Same as recommended

START DATE

_ RESPONSE ACTION SCHEDULE _

COMMENT:

Summer 1989

Ongoing

COMPLETION DATE

AHERA COMPLIANCE PROGRAM *** BOILER ROOM SUMMARY ***

West Linn S.D. 3JT 37-0050

CAMPUS : 001 - West Linn High School BUILDING : 001 - West Linn High Main Bldg. BOILER RM: 2

Inspected By: Gary Adler Certification #: HK80026 St: KS

State Cert #:

	REMOVAL COST	REPLACEMENT COSTS	TOTAL COSTS
BOILER ROOM ESTIMATED COSTS	\$13,394	\$9,619	\$23,013
1			

West Linn S.D. 3JT 37-0050

Inspected By: Gary Adler

99

0

CAMPUS : 001 - West Linn High School Certification #: HK80026 St: KS BUILDING : 002 - Shop State Cert #: St: Inspection Dates: 07/08/88 to 07/14/89 12,764 Gross Square Pt: * * * INSPECTION RESULTS UNIFIED SAMPLING AREA NUMBER - 01 * * * SYSTEM: Heating Water LOCATION: TYPE OF MATERIAL: MJP on Non-Suspect Pipe Ground Floor DAMAGE CATEGORY: REASON for DAMAGE CATEGORY: POTENTIAL FOR DISTURBANCE: SAMPLE# **%ASB** N/A N/A N/A 94 0 95 0 96 0 MATERIAL QUANTITIES REMOVAL COST REPLACEMENT COSTS TOTAL COSTS 45 4 In. O. D. 40 6 In. O. D. AREA TOTAL ŠÜ RECOMMENDED RESPONSE ACTION: PRIORITY: PREVENTIVE MEASURES: See Part I and OSM Code: N/A 0 LEA RESPONSE: RESPONSE ACTION SCHEDULE ACTION ELECTION: START DATE COMPLETION DATE COMMENTS: N/A N/A * * * INSPECTION RESULTS UNIFIED SAMPLING AREA NUMBER - 02 * * * LOCATION: TYPE OF MATERIAL: MJP on Non-Suspect Pipe SYSTEM: Dom. Hot Water Ground Floor DAMAGE CATEGORY: POTENTIAL FOR DISTURBANCE: REASON for DAMAGE CATEGORY: SAMPLE# **%ASB** 0 N/A N/A N/A 97 98 0

West Linn S.D. 3JT 37--0050

CAMPUS : 001 - West Linn High School BUILDING: 002 - Shop Inspection Dates: 07/08/88 to 04/24/89

Inspected By: Gary Adler
Certification #: HK80026 St: KS
St: St:

Gross Square Ft:

12,764

MATERIAL QUANTITIES	S REMOVAL CO	ST REPLACEMENT COST:	5 TOTAL COSTS
50 4 In. O. 1	o. '—		I
		AREA TY	OTAL \$0
		PLAN RECOMMENDATION	
ecommended response action: /A	PRIORITY:		VE MEASURES: I and OaM Code:
EA RESPONSE:	_	RESPONSE ACTIO	on schedule
CTION ELECTION:		START DATE	COMPLETION DATE
LEA COMMENTS:		N/A	N/A
****	_ 	**********	**********
	t t t Theneseron Beerran	UNIFIED SAMPLING AREA NUMBER -	A
	INSPECTION RESULTS	ONIFIED SAMPLING AREA NUMBER -	. 03
YSTEM: Dom. Cold Water	LOCATION:	TYPE OF MATE	RIAL: MJP on Non-Suspect Pipe
YSTEM: Dom. Cold Water	LOCATION: Ground Floor	TYPE OF MATE	RIAL: MJF on Non-Suspect Pipe
	Ground Floor		
namage category:			R DISTURBANCE: SAMPLE# &A 00 (
YSTEM: Dom. Cold Water MAMAGE CATEGORY:	Ground Floor REASON for DAMAGE C	ategory: potential fo	R DISTURBANCE: SAMPLE# &A
amage category:	Ground Floor REASON for DAMAGE CHIN/A	ategory: potential fo n/a	R DISTURBANCE: SAMPLE# tax 00 0 01 0 02 0
amage category: /a	Ground Floor REASON for DAMAGE CI	ategory: potential fo n/a	R DISTURBANCE: SAMPLE# \$AS 00 (0 01 (0 02 (0
amage category: /a 	Ground Floor REASON for DAMAGE CI	ategory: potential fo n/a	R DISTURBANCE: SAMPLE# &A. 00 01 02 CS TOTAL COSTS
AMAGE CATEGORY: /A MATERIAL QUANTITIE 50 4 In. O.	REASON for DAMAGE CANANA S REMOVAL CO	ATEGORY: POTENTIAL FO N/A DST REPLACEMENT COST AREA T PLAN RECOMMENDATION	R DISTURBANCE: SAMPLE# &AMO 00 01 02 02 00 00 00 00 00 00 00 00 00 00 00
AMAGE CATEGORY: /A MATERIAL QUANTITIE 50 4 In. O. ECOMMENDED RESPONSE ACTION	REASON for DAMAGE CANANA S REMOVAL CO	ATEGORY: POTENTIAL FO N/A DST REPLACEMENT COST AREA T PLAN RECOMMENDATION : PREVENTI	R DISTURBANCE: SAMPLE# &AMO 00 01 02 02 00 00 00 00 00 00 00 00 00 00 00
MATERIAL QUANTITIE 50 4 In. O. RECOMMENDED RESPONSE ACTION	REASON for DAMAGE CIN/A S REMOVAL CO D. HANAGEMENT I	ATEGORY: POTENTIAL FO N/A DST REPLACEMENT COST AREA T PLAN RECOMMENDATION PREVENTI See Part	OR DISTURBANCE: SAMPLE# tag 00 01 02 CS TOTAL COSTS OTAL \$0 VE MEASURES:
MATERIAL QUANTITIE	REASON for DAMAGE CIN/A S REMOVAL CO D. HANAGEMENT I	ATEGORY: POTENTIAL FO N/A DST REPLACEMENT COST AREA T PLAN RECOMMENDATION PREVENTI See Part	R DISTURBANCE: SAMPLE# tax 00 01 01 02 CS TOTAL COSTS OTAL \$0 EVE MEASURES: I and Oam Code:

N/A

AHERA COMPLIANCE PROGRAM

West Linn S.D. 3JT 37-0050

Inspected By: Gary Adler

CAMPUS : 001 - West Linn High School Certification #: HK80026 st: Ks BUILDING : 002 - Shop State Cert #: St: Inspection Dates: 07/08/88 to 07/14/89 Gross Square Ft: 12,764 * * * INSPECTION RESULTS UNIFIED SAMPLING AREA NUMBER - 04 * * * TYPE OF MATERIAL: Acoustical Tile (1x1) SYSTEM: Ceiling Matl. LOCATION: Ground Floor DAMAGE CATEGORY: REASON for DAMAGE CATEGORY: POTENTIAL FOR DISTURBANCE: SAMPLE# %ASB N/A N/A N/A 03 MATERIAL QUANTITIES REPLACEMENT COSTS REMOVAL COST TOTAL COSTS 200 Square Feet AREA TOTAL 50 PREVENTIVE MEASURES: RECOMMENDED RESPONSE ACTION: PRIORITY: N/A See Part I and OaM Code: LEA RESPONSE: RESPONSE ACTION SCHEDULE ACTION ELECTION: START DATE COMPLETION DATE COMMENTS: N/A N/A .\-----* * * INSPECTION RESULTS UNIFIED SAMPLING AREA NUMBER - 05 * * * SYSTEM: Ceiling Matl. LOCATION: TYPE OF MATERIAL: Drop or Lay-in Panel Ground Floor DAMAGE CATEGORY: REASON for DAMAGE CATEGORY: POTENTIAL FOR DISTURBANCE: SAMPLE# %ASB

N/A

N/A

04

0

West Linn S.D. 3JT 37-0050

CAMPUS : 001 - West Linn High School BUILDING : 002 - Shop Inspection Dates: 07/08/88 to 07/14/89 Inspected By: Gary Adler

Certification #: HK80026 St: KS State Cert #: St:

Gross Square Ft: 12,764

MATERIAL QUANTITIES	REMOVAL	COST	REPLACEMENT COSTS	TOTAL COSTS
11200 Square Feet				J
			AREA TOTAL	\$0
RECOMMENDED RESPONSE ACTION:	Management Priorit 0		DATION PREVENTIVE ME. See Part I and	
LEA RESPONSE:			RESPONSE ACTION SCI	fedule
action election:	!	j s	TART DATE	COMPLETION DATE
Complexes:] }	1/A	N/A
**********	******	 	************	
1 *	* * INSPECTION RESULTS	S UNIFIED SAME	PLING AREA NUMBER - 98 *	* *
SYSTEM: Non-Friable	LOCATION:		TYPE OF MATERIAL:	Transite Siding
Damage Category:	All Floors in Build REASON for DAMAGE of	Category:	POTENTIAL FOR DIS	ŕ
DAMAGE CATEGORY: ACEM with Potential for Demage	All Floors in Build REASON for DAMAGE The material is ob- good condition.	CATEGORY: served to be i	POTENTIAL FOR DIS	Turbance: Sample# %a Assumed
Danage Category:	REASON for DAMAGE of The material is obgood condition.	CATEGORY: served to be i	POTENTIAL FOR DIS	TURBANCE: SAMPLE# %A: Assumed TOTAL COSTS
DAMAGE CATEGORY: ACRM with Potential for Demage	REASON for DAMAGE of The material is obgood condition.	CATEGORY: served to be i	POTENTIAL FOR DIS	Turbance: Sample# %a Assumed
DAMAGE CATEGORY: ACEM with Potential for Demage MATERIAL QUANTITIES	REASON for DAMAGE of The material is obgood condition.	CATEGORY: served to be i	POTENTIAL FOR DIS	TURBANCE: SAMPLE# %A: Assumed TOTAL COSTS
DAMAGE CATEGORY: ACEM with Potential for Demage MATERIAL QUANTITIES	REASON for DAMAGE The material is obgood condition.	CATEGORY: Served to be i	POTENTIAL FOR DISIN Slight REPLACEMENT COSTS \$51 AREA TOTAL NDATION	TURBANCE: SAMPLE# %A. Assumed TOTAL COSTS \$123
DAMAGE CATEGORY: ACEM with Potential for Damage MATERIAL QUANTITIES 10 Square Feet RECOMMENDED RESPONSE ACTION:	REASON for DAMAGE The material is ob- good condition. REMOVAL	CATEGORY: Served to be i	POTENTIAL FOR DISIN Slight REPLACEMENT COSTS \$51 AREA TOTAL NDATION	TURBANCE: SAMPLE# %A. ASSUMED TOTAL COSTS \$123 \$123 ASURES: d OSM Code: OMZ
DAMAGE CATEGORY: ACEM with Potential for Demage MATERIAL QUANTITIES 10 Square Feet RECOMMENDED RESPONSE ACTION: OAM Maintain/Monitor	REASON for DAMAGE The material is ob- good condition. REMOVAL	CATEGORY: served to be i	POTENTIAL FOR DIST REPLACEMENT COSTS \$51 AREA TOTAL PREVENTIVE ME SOO Part I an	TURBANCE: SAMPLE# %A. ASSUMED TOTAL COSTS \$123 \$123 ASURES: d OSM Code: OMZ

West Linn S.D. 3JT 37-0050

CAMPUS : 001 - West Linn High School

BUILDING : 002 - Shop

ACTION ELECTION:

Same as recommended

Inspection Dates: 07/08/88 to 07/14/89

Inspected By: Gary Adler

Certification #: HK80026 St: KS

State Cert #:

St: 12.764

COMPLETION DATE

Gross Square Ft: * * * INSPECTION RESULTS UNIFIED SAMPLING AREA NUMBER - 99 * * * TYPE OF MATERIAL: Vinyl Floor Tile SYSTEM: Floor Matl. LOCATION: All Floors in Building DAMAGE CATEGORY: REASON for DAMAGE CATEGORY: POTENTIAL FOR DISTURBANCE: SAMPLE# %ASB ACRM with Potential for Damage The material is observed to be in Slight 48 10 good condition. MATERIAL QUANTITIES REMOVAL COST REPLACEMENT COSTS TOTAL COSTS 11000 Square Feet \$37,070 \$28,160 \$65,230 AREA TOTAL \$65,230 PRIORITY: PREVENTIVE MEASURES: RECOMMENDED RESPONSE ACTION: See Part I and OEM Code: OMI, OMZ OWM Maintain/Monitor 3 RESPONSE ACTION SCHEDULE LEA RESPONSE:

COMMENTS: Summer 1989 Ongoing ************************

START DATE

West Linn S.D. 3JT 37-0050

CAMPUS : 001 - West Linn High School

BUILDING : 003 - Music Bldg.

Inspection Dates: 07/18/88 to 07/14/89

Inspected By: Gary Adler

Certification #: HK80026 St: KS

State Cert #: Gross Square Ft:

St: 12,715

* * * INSPECTION RESULTS UNIFIED SAMPLING AREA NUMBER - 99 * * * LOCATION: TYPE OF MATERIAL: Vinyl Floor Tile SYSTEM: Floor Matl. All Floors in Building

DAMAGE CATEGORY: ACBM with Potential for Damage

REASON for DAMAGE CATEGORY: The material is observed to be in POTENTIAL FOR DISTURBANCE:

SAMPLE# %ASB

good condition.

Slight

49

MATERIAL QUANTITIES	REMOVAL COST	REPLACEMENT COSTS	TOTAL COSTS
10000 Square Feet	\$33,700	\$25,600	\$59,300
! !		AREA TOTAL	\$59,300
	MANAGEMENT PLAN RECOM	MENDATION	

RECOMMENDED RESPONSE ACTION: OsM Maintain/Monitor

PRIORITY:

3

PREVENTIVE MEASURES:

See Part I and OaM Code: OMI, OMZ

LEA RESPONSE: ACTION ELECTION:

Same as recommended

COMMENTS:

RESPONSE ACTION SCHEDULE

START DATE

COMPLETION DATE

Summer 1989

Ongoing

ASBESTOS LOCATION DIAGRAMS

SAMPLE / MATERIAL LOCATION DIAGRAMS

As part of the AHERA Asbestos Inspection the locations of samples collected are recorded on building diagrams. In addition to the sample locations, specific damage areas are recorded where found. The following pages provide the sample location diagrams for the School District. These drawings are organized in the same manner as the inspection/management plan data, i.e. campus one building one is first.

The title block contains the specific state, district, campus, and building or code with a 12 digit number. Next is the District Name, the Campus Name, and finally the Building Name. The next block provides the date the drawing was made, the street number, and finally the H-K drawing number.

The drawing uses several symbols and cross-batching patterns to illustrate the key elements of the survey information.

SAMPLE LOCATION: The specific locations of samples are found on a point on the drawing leading to a symbol indicating the sample number and the Bulk Sample (BS) Code, which represents the type of material sampled. The Bulk Sample Code descriptions used are as follows:

as cone	DESCRIPTION	85 CODE	DESCRIPTION
a	Unknown	26	Transite Pipe
1	Acoustical Plaster	27	Transite Hood
2	Acoustical/Thermal Insul	25	Asbestos Peds
3	Hardweil/Cailing Plaster	29	Asbestos Glove
4	Vinyt Floor Tite	30	Asbestos Rope
5	Pipe Covering	31	Raw Asbestos
6	Corrugated Pipe Covering	32	Electrical Wiring
7	Wrapped Paper Pipe Cover	33	Fire Hose
8	Boiler/Tank Insulation	34	Fire Ocor
9	Breaching/Exhaust Packing	35	Fire Suit
10	Woven Paper/Tape	36	fire Brick
11	Drop or Lay-in Penel	37	Lab Counter Top
12	Acoustical Tile (1x1)	38	Fiber Frack Kilm
13	Fire or Stage Curtain	39	Fongs
14	MJP on Mon-Suspect Pipe	40	Poured in Insulation
15	MJP on Pipe Covering	41	Contaminated Soil
16	MUP on Corr. Pipe Caver	42	Tectum
17	NUP on Wrapped Pipe Cover	43	Floor Underlayment
18	Fireproofing	44	Hard Grout
19	Vibration Joint Cloth	45	Mortan
20	Interior Ouet Insulation	46	Blown or Scratch Coat
21	Exterior Duct Insulation	47	'Oven/Autoclave Lining
22	Slown-in Insulation	48	Brake Lining
23	Stored Insulation	49	Theatre Curtain
24	Debris	50	Transite Siding
25	Gasket	99	Other

DAMAGE AREAS: When the inspector encounters a section of material in a Unified Sampling Area (USA) which contains localized damage in worse condition than the remainder of the same material contained in this USA, a Damage Area indicator is placed on the drawing. This symbol contains specific information about the damaged area.

Type of Material - The BS Code of the material is indicated so that the type of material can be determined. See the previous section for the listing of the BS codes used.

Quantity - The quantity of material which was found to be damaged is also indicated.

Location - The location of the localized damage is indicated in the symbol. This provides assistance in identifying where the damage can be found.

Response Action - This is the code for the recommended AHERA response action. The following codes are used:

- I. Isolate Area immediately
- 2. Gross Removal
- 3. Glove Bag Removal
- 4. Encapsulation
- 5. Enciosure
- 6. Repair and O&M
- 7. O&M and Monitor

CROSSHATCHING: Crosshatching patterns are used to detail the location of ceiling and floor material suspected of containing asbestos. There are three patterns used:

Floor Tile - This pattern is used to indicate floor tile and sheet flooring material suspected of containing asbestos.

Drop / Lay-in, Accoustical - This pattern is used to indicate the locations of a variety of ceiling tiles including, but not limited, to $1' \times 1'$ and $2' \times 4'$ lay-in panels.

Spray / Trowel Applied Materials - This pattern is used to indicate the presence of spray and trowel applied materials such as fireproofing and acoustical plaster.

LOCATION of CAUTION LABEL: The AHERA regulations require the use of labels indicating the presence of Asbestos Containing Building Material (ACBM). The label is to be place on or near ACBM in routine maintenance areas in all school buildings. When this label is applied in the field the inspector identifies its location on the sample location diagram. On the drawing, the label symbol contains information about its placement within the routine maintenance area so that it may be readily found by the LEA. The label states the following.

CAUTION
ASBESTOS. HAZARDOUS.
DO NOT DISTURB
WITHOUT PROPER TRAINING
AND EQUIPMENT

The presence of sample numbers, crosshatching, and damage areas does not mean that all of the areas indicated contain asbestos. These location diagrams are a record of the field inspection only and are meant to show where samples were taken and what areas may be affected if asbestos is present. To determine which areas are affected, a review of the Inspection / Management Plan Data and the Petrographic Results contained in Sections 4 and 5 should be made. If desired, the location diagrams can be highlighted by the school district's asbestos coordinator to indicate the presence of asbestos containing material.

CLIENT: WEST LINN SCHOOL DISTRICT

CAMPUS NAME & NUMBER: WEST LINN HIGH SCHOOL (001)

PROJECT #: 572-29-291

BUILDING NAME & NUMBER: SHOP (002)

		SAMPLE			- 1	TOT					ACT/	r						
LOCATION	MATERIAL	NUMBER	CONS	HOMOG	COLOR	ASB	CHRY	AMO	CRG	ANT	TRE	MOOL	CEL	MICA	PER	BIND	OTHER 1	OTHER 2
Shop Bldg/701	DROP OR LAY-IN PANEL	119044	Y	Y	Ğ	0	ō	0	0	0	0	20	40	0	30	10	0	0
Shop Bldg/702	DROP OR LAY-IN PANEL	119045	Ý	Ý	G	0	0	0	0	0	0	20	40	0	30	10	0	0
Shop Bldg/705	DROP OR LAY-IN PANEL	119046	Ÿ	Ÿ	G	Ŏ	ŏ	Ò	Ō	Ó	Ò	20	40	0	30	10	0	0
Shop Bldg/Rest Room	DROP OR LAY-IN PANEL	119047	Ÿ	Ÿ	G	o	ŏ	Ŏ	Ŏ	Ŏ	0	30	40	Ò	20	10	G	0
Shop Bldg/Rest Room	DROP OR LAY-IN PANEL	119048	Ÿ	Ÿ	Ğ	ŏ	Ŏ	ŏ	0	Ŏ	Ŏ	30	40	Ō	20	10	0	0
Shop Bldg/Hail	DROP OR LAY-IN PANEL	119049	Ÿ	Y	6	ō	ŏ	ŏ	ē	Ŏ	Õ	30	40	Ō	20	10	O	0
Shop Bldg/704	ACOUSTICAL TILE	119050	Ÿ	Ÿ	Ğ	ŏ	ŏ	ŏ	ē	Ō	Ō	30	40	0	20	10	0	0
Shop 81dg/704	ACOUSTICAL TILE	119051	¥	Ÿ	G	0	0	0	0	0	0	30	40	0	20	10	0	0
Shop Bldg/704	ACOUSTICAL TILE	119052	Ÿ	Ý	G	0	0	١ ٥	G	0	0	30	40	0	20	10	0	0
Shop Bidg/Rest Room	LINOLEUM	119053	Ÿ	Ÿ	T	ò	0	0	0	0	0	0	60	0	0	30	GH 10	0
Shop Bldg/Rest Room	LINOLEUM	119054	Y	Y	т	0	0	0	0	0	0	0	60	0	0	30	GM 10	G
Shop Bldg/Rest Room	LINOLEUM	119055	Y	¥	т	0	Ð	0	0	0	0	0	60	0	0	30	GM 10	0
Shop Bldg	VINYL FLOOR TILE	119056	N	Y	W	0	0	0	0	0	0	0	Ð	0	G	30	CA 70	0
Shop Bldg	VINYL FLOOR TILE	119057	Y	Y	G	0	0	0	0	0	0	0	6	0	0	30	CA 70	0
Shop Bldg	VINYL FLOOR TILE	119058	Y	Y	G	0	0	0	0	0	0	0	0	0	0	30	CA 70	Ð
Shop Bldg	MASTEC	119059	Nŧ	Y	к	0	0	0	0	0	0	0	40	0	0	0	GM 10	TA 50
Shop Bldg	MASTIC	119060	H	Y	ĸ	0	0	0	0	0	0	0	30	0	0	Ð	GM 20	TA 50
Shop Bldg	MASTIC	119061	N	Y	ĸ	0	0	0	0	0	0	0	10	Đ	Đ	0	GM 20	TA 70
Shop Bldg	VINYL FLOOR TILE	119062	Y	Y	É	0	0	0	0	0	0	0	0	0	0	30	CA 70	0
Shop Bldg	VINYL FLOOR TILE	119063	Y	Y	E	0	0	0	0	Ð	0	0	0	0	0	30	CA 70	0
Shop Bldg	VINYL FLOOR TILE	119064	Y	Y	E	0	0	0	0	0	0	0	0	0	0	30	CA 70	0
Shop Bldg/704	VINYL FLOOR TILE	119065	Y	Y	8	0	0	0	0	0	0	0	0	0	0	30	CA 70	0
Shop Bldg/704	VINYL FLOOR TILE	119066	Y	Y	8	0	0	0	Ð	0	0	0	Ð	0	0	30	CA 70	0
Shop Bldg/704	VINYL FLOOR TILE	119067	Y	¥	В	0	0	0	0	0	0	0	0	0	0	30	CA 70	0
Shop Bidg/704	MASTIC	119068	Y	Y	K	10	10	0	0	0	0	0	40	0	0	9	TA 50	0
Shop Bldg/Hall	VINYL FLOOR TILE	119071	Y	Y	Ġ	10	10	0	0	0	0	0	0	0	0	25 0	CA 65 GM 10	TA 50
Shop Bldg/Hall	MASTIC	119074	Y	Y	K	30	30	0	0	0	0	0	10	0	U	U	GM IO	1A 30
							Į l											
								ł										
								ł										;
]										
1								1										
!]	1										1
·					į													
1					į													
1																		
1							1											
j						,]											
1								I										

PSI/Hall-Kimbrell Environmental Service Inc. Asbestos Petrographic Analysis

CLIENT: WEST LINN SCHOOL DISTRICT


CAMPUS NAME & NUMBER: WEST LINN HIGH SCHOOL (001)


PROJECT #: 572-29-291

BUILDING NAME & NUMBER: MUSIC BUILDING (903)



Location of Caution Label








Vinyl Floor Tile





Drop, Lay In, Accoustical





Spray Applied Material

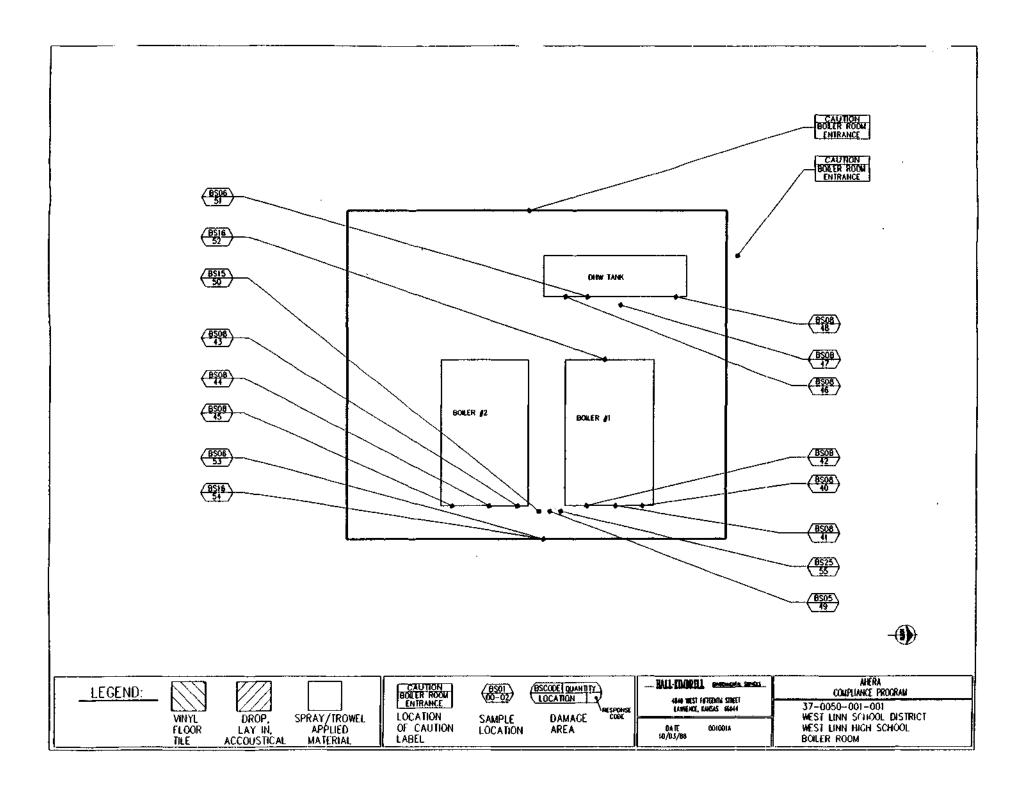


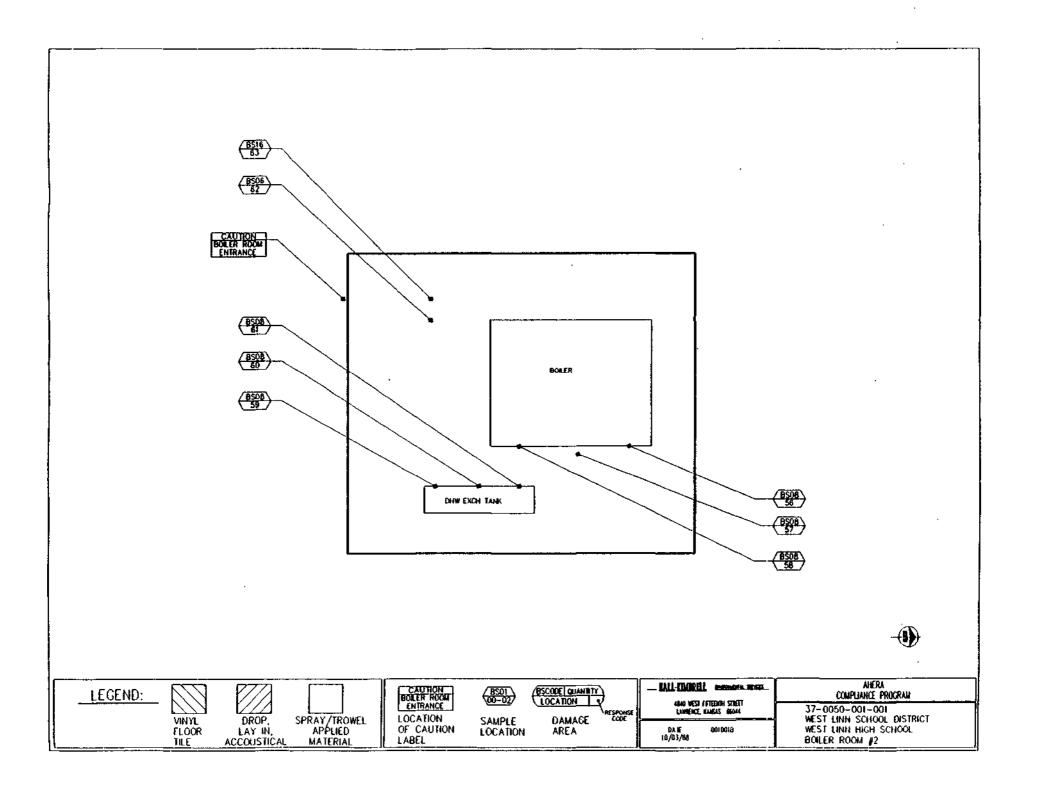

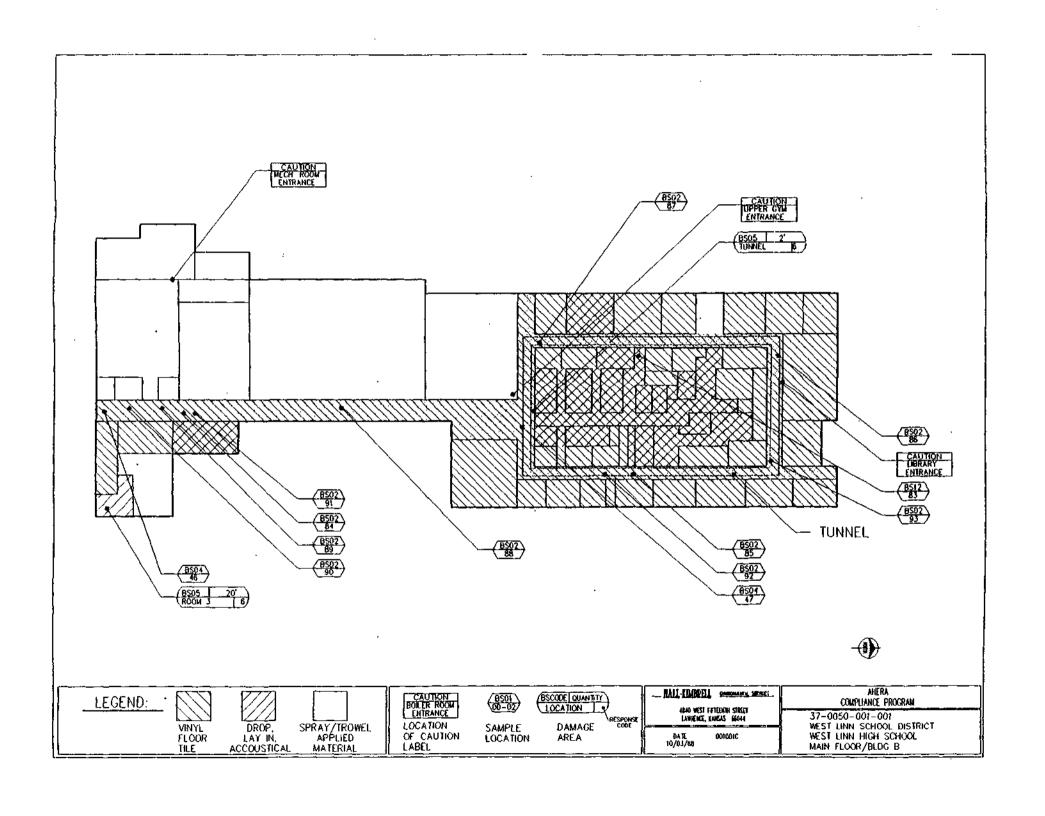

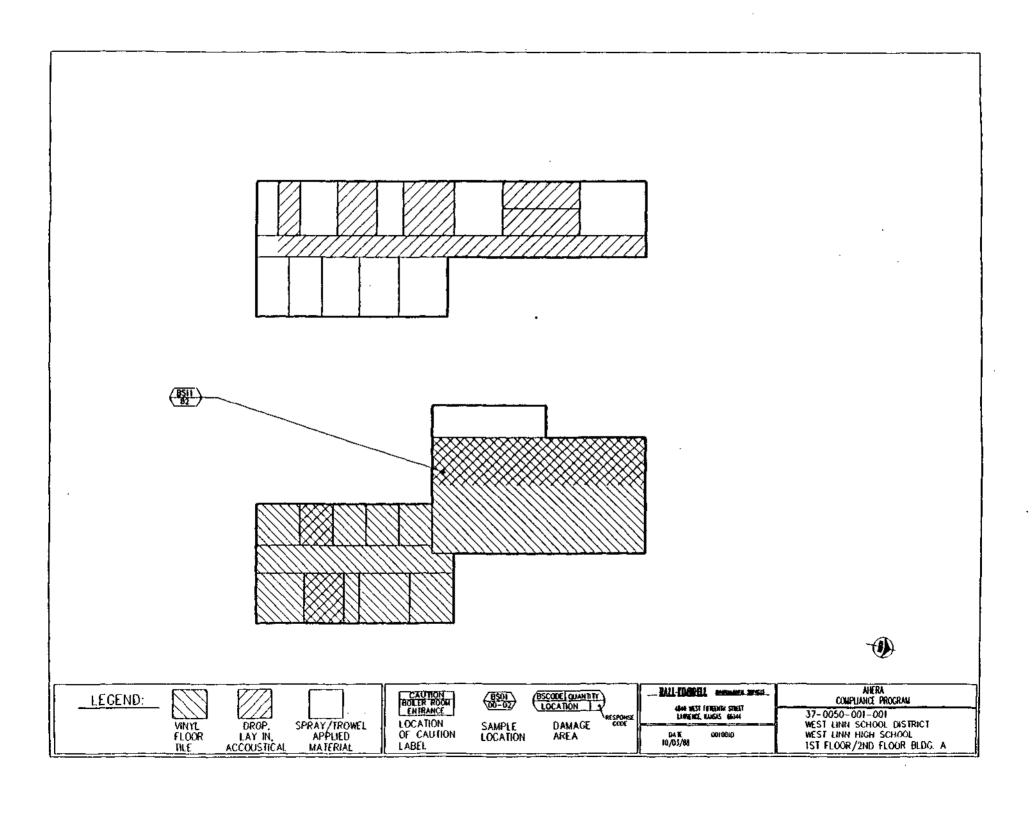


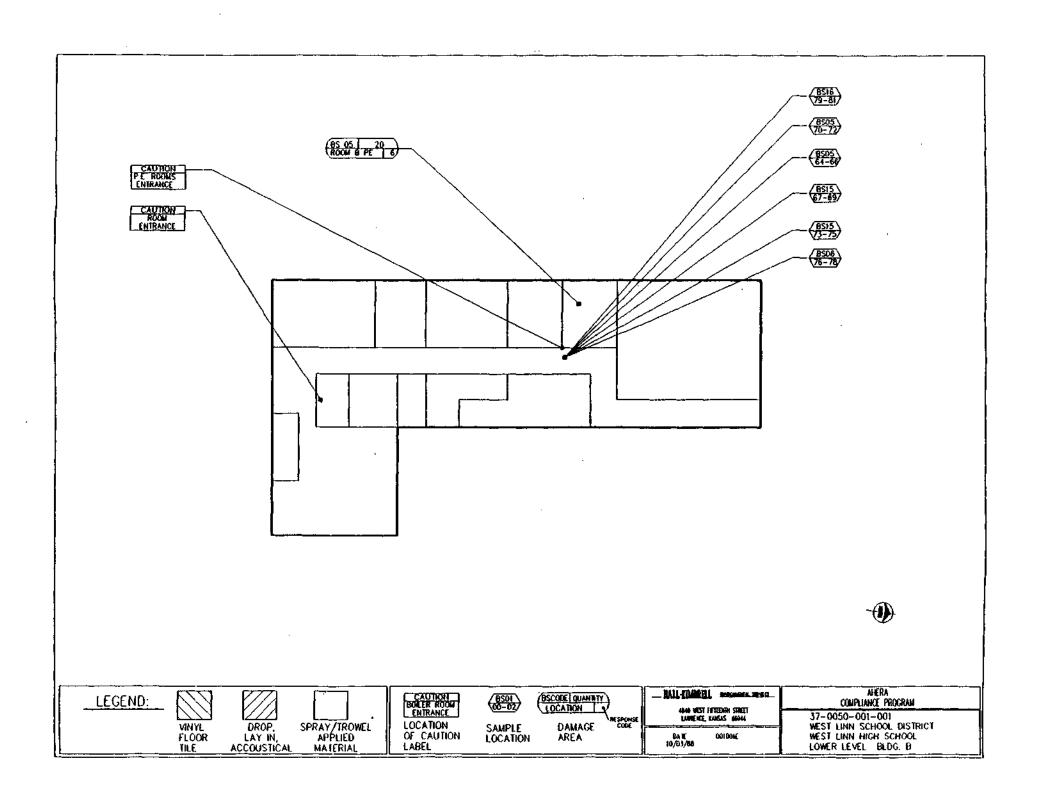

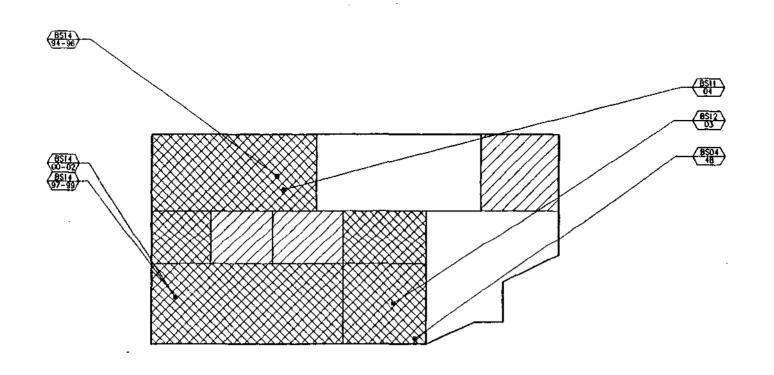




AHERA Compunice Program NAIL-(ROBELL DANSMA SPEE CAUTION BOILER ROOM ENTRANCE BSCODE QUANTITY LOCATION 1 (00-02) LEGEND: 4840 WEST FERROITH STREET LAWRENCE, KANGAS 66044 37-0050-001-002 WEST LINN SCHOOL DISTRICT WEST LINN HIGH SCHOOL WOOD SHOP LOCATION OF CAUTION LABEL VINYL FLOOR TILE SPRAY/TROWEL APPLIED MATERIAL DAMAGE AREA SAMPLE LOCATION DROP, LAY IN, ACCOUSTICAL 0A TE 10/03/88

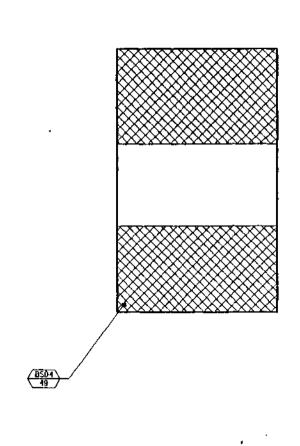



LEGEND: VINYL	DROP, SPRAY/TROWEL	CAUTION BOLER ROOM CO-02 ENTRANCE LOCATION SAMPLE OF CAUTION LOCATION	BSCODE QUANTY LOCATION RESPONSE DAMAGE CODE	HALL-ENDRELL DESCRIPTION STREET LAWFORET, AMELS 6604 DATE 001003	AMERA COMPLIANCE PROGRAM 37-0050-001-003 WEST LINN SCHOOL DISTRICT WOODSHOP
FLOOR TILE	LAY IN, APPLIED ACCOUSTICAL MATERIAL	OF CAUTION LOCATION	AREA	04 H 001003 16/03/88	MUSIC BLDG.

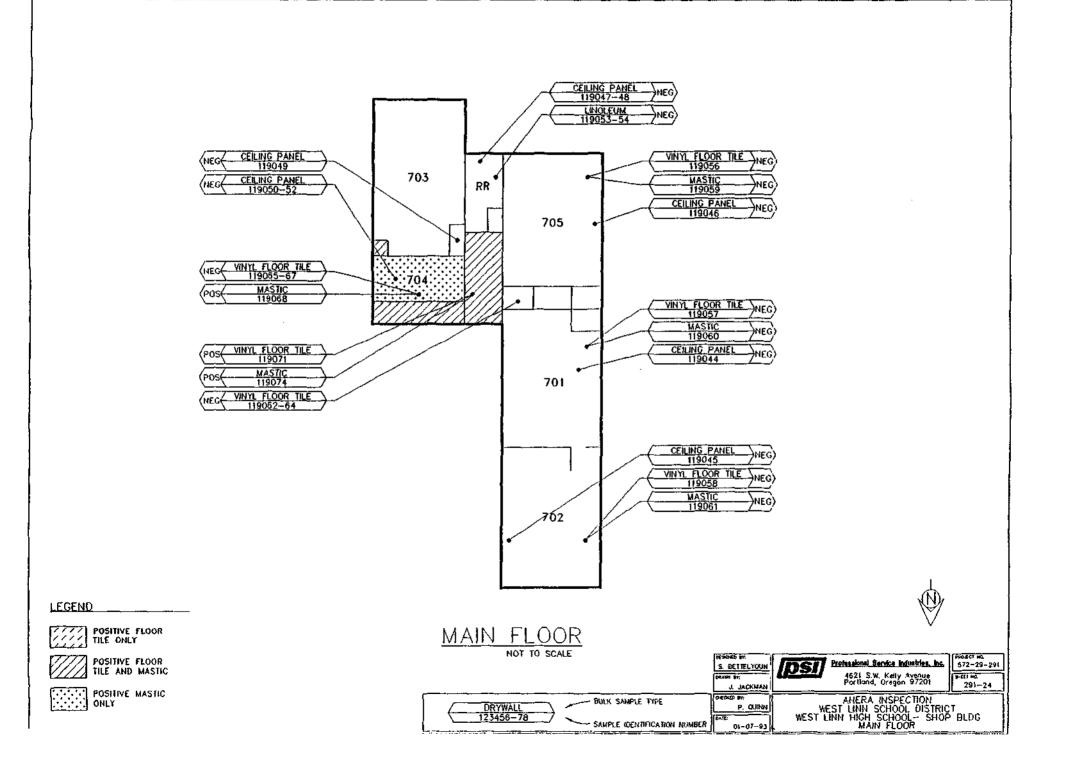

C	Homogeneous Area					Quanity	S/L	F	espons	se Acti	on	Sam	ple Dat	a	Cost	Estimates
		SD	D	PΩ		***************************************		ОМ		REM	CL	Amo	Chry	Other	Repair	Removal
T	STEAM-PIPING		X	Х	<5	2248	LF	X	Х							
T	STEAM-MJP			Х		551	SF	Х								
T	DHW-PIPING			Х		1766	LF	Х								
Τ	DHW-MJP			Х		360	SF	Х					-			
T	DCW-PIPING		Х	Х	<5	933	LF	Χ	Х							
T	DCW-MJP			Х		202	SF	Χ								
s	ACOUST.PLASTER	Х	X		35	21531	SF	Х	Х	Х						
М	FLOOR TILE			Х		50000	SF	Χ								
CA	TRANSITE SIDING			Х		400	SF	Χ								
М	FLOOR TILE			Χ		86055	SF	Х								
	·															-
T	BR#1-BOILER		Х	Х	<5	1504	SF	Х	Х							
Т	BR-MJP		X	Х	<5	248	SF	Х	Χ							
T	BR-PIPING		Х	Х	<5	840	LF	Χ	Х							
									~							
T	BR-#2-DH20 TANK			Х		60	SF	X								
T	BR-MJP			Х		74	SF	Χ								
T	BR-PIPING			Х		305	LF	Χ								
I																
J																
T																
T															······································	***************************************
Cod	es:	<u>-</u>											***************************************			
Ţ -	Thermal					***************************************				<u> </u>	***************************************			***************************************	······································	······································
	Surfacing	{			···-	****				~~~					***************************************	
*****	Misc		_	-							***************************************					······································
	- Transite	₩			<u>-</u>											

C	Homogeneous Area	Со	nditi	ion	%ACN	Quanity	S/L	F	espon	se Acti	on	San	nple Dat	a	Cost	Estimates
		SD	D	PD				OM	REP	REM	CL	Amo	Chry	Other	Repair	Removal
CA	TRANSITE SIDING			Х		10	SF	Х								
М	FLOOR TILE			Х		1100	SF	Х								
								·*			***************************************					
П								***************************************			*******					
													}			


											***************************************				***************************************	
											•				······································	
						-								-		
											**********				***************************************	
Cod	es:														,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	
1	Thermal															
S - 3	Surfacing	~~~		_											***************************************	**************************************
	Misc				•••••••••••••••••••••••••••••••••••••••			·		<u> </u>					*************************************	<u> </u>
	- Transite		-													
<u> </u>	- Hariono		1						1					<u></u> 1		

С	Homogeneous Area FLOOR TILE	Со	nditi	ion	%Dam	Quanity	S/L	F	espon	se Acti	on	San	ple Dat	a	Cost I	stimates
j		SD	D	PD				ОМ	REP	REM	CŁ	Amo	Chry	Other	Repair	Removal
М	FLOOR TILE			Х		10000	SF	Х								
																<u></u>

								***********							***************************************	
											***************************************		***************************************			-
	·															

				****						***************************************						
\bot																

Cod																
T - 1	Thermal															
	Surfacing										***************************************				***************************************	
	Misc														***************************************	***************************************
CA ·	· Transite												*********			····

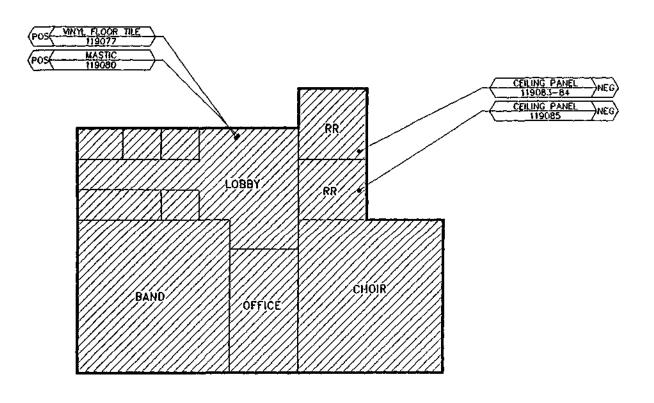


MAIN FLOOR NOT TO SCALE

LEGEND


POSITIVE FLOOR

POSITIVE FLOOR TILE AND MASTIC

POSITIVE MASTIC



Professional Service Industries, Inc. 572-29-291 S. BETTELYOUN 4821 S.W. Kelly Avenue Portland, Oregon 97201 SULL HOL 291-23 7. TYCKHAN AHERA INSPECTION
WEST LINN SCHOOL DISTRICT
WEST LINN HIGH SCHOOL - MUSIC BLDG
MAIN FLOOR P. OUNNY



DI-07-93

CONSULTANTS COST ESTIMATES FOR ASBESTOS REMOVAL

DISTRICT COST SUMMARY

PROJECT NUMBER: 37-0050

DISTRICT	NAME:	West	Linn	S.D.	3 JT	
----------	-------	------	------	------	-------------	--

.a1	With Chirt	REINSULATION COST	- COUDINED COS
High Main Bldg	\$1.000.662	\$571 450	\$1,522,112
		· · · · · · · · · · · · · · · · · · ·	
, _		•	\$65,353
•		· -	\$59,300
		•	\$0
	,	•	\$ 0
.5		\$0 	\$0
MPUS TOTALS	\$1,071,504	\$575,261	\$1,646,765
ol.			
ldle School Main	\$210,024	\$155,749	\$365,773
	\$0	\$0	\$0
MPUS TOTALS	\$210,024	\$155,749	\$365,773
•			
ark Main Bldg	\$136,022	\$94,263	\$230,285
		· · · · · · · · · · · · · · · · · · ·	\$327,698
			\$218,465
			\$53,157
Wash 1/766	747,074	344,854	\$52,564
MPUS TOTALS	\$631,808	\$250,361	\$882,169
chool			
Timary Main Bldg	\$141,357	\$103,448	\$244,805
	\$0	\$0	\$0
	\$0	\$0	\$0
	\$D	50	\$0
ldin g	\$0	\$0	\$0
MPUS TOTALS	\$141,357	\$103,448	\$244,805
ne1			
	e765 187	\$1 98 836	\$564,023
mary mattr ordy	3303,157		
AMPUS TOTALS	\$365,187	\$198,836	\$564,023
te Main Bldg	\$376,182	\$176,628	\$352,810
AMPUS TOTALS	\$376,182	\$176,628	\$552,810
	A16 707	244 747	Ann 951
			\$28,254
	-		\$0
2	\$337	\$25 6	\$593
lding	\$0	\$0	\$0
	\$10,713	\$2,138	\$12,851
ampus totals	\$27,557	\$14,141	\$41,698
e School			
	\$71,393	\$54.220	\$125,613
lding	\$0	\$0	\$0
ampus totals	\$71,393	\$\$4,220	3125,613
lding		•	
	el High Main Bldg. High Main Bldg. MPUS TOTALS AMPUS TOTALS Park Main Bldg Park 1-3 Park 12-16 Park 17-22 MPUS TOTALS Chool Primary Main Bldg MMPUS TOTALS Col Main Bldg MMPUS TOTALS	### ### #### #### ####################	### ### ### ### ### ### ### ### ### ##

NOTE: Please see the 'Cost Estimates' section of Part I for a full explanation of the cost estimates presented here

PAGE 4A - 1

DISTRICT COST SUMMARY

PROJECT NUMBER: 37-0050
DISTRICT NAME: West Linn S.D. 3JT

DISTRICT NAME: West Link 5.0. 331	REMOV	AL COSTREINSULATIO	ON COST	ost —
CAMPUS	TOTALS \$	2,962 \$2,2	\$5,236	5
DISTRICT	TOTALS \$2,89	17,974 \$1,530,9	918 \$4,428,892	2

PLAN DISTRIBUTION/NOTIFICATION

This section reflects requirements outlined in 40 CFR 763.84 & 763.93 (10)

The following subsections contain this required information:

- · Annual (employee) notification records.
- Annual (parent/legal guardian/occupant/employee) notification records

ACTION:

You must send an annual notification to parent, teacher, and employee organization.

Short-term workers must be informed as to the location of ASBM in the school building.

FORMS:

N/A

PLAN DISTRIBUTION/NOTIFICATION

AHERA requires that the LEA notify all building occupants, workers, contractors, and parents or legal guardians of school children. There are three key elements to the Notification program and they are Initial Notification, Annual Notification must include a discussion of:

- Inspections
- Re-inspections
- Surveillance
- Response actions
- · Post-response action activity
- · Availability of management plant

The LEA designate can realize benefits from the notification program because informed occupants are less likely to disturb the material and will report problem situations.

Contract workers (short-term) who will come in contact with ACBM during their work must be informed of the presence of ACBM. In addition, under various right-to-know laws, all workers must be informed of the potential for contact with hazardous materials such as asbestos.

There are three key areas of notification:

INITIAL NOTIFICATION OF THE MANAGEMENT PLAN AVAILABILITY

At the implementation of the Management Plan, notification to parent, teacher and employee organization of the availability of the plan is to be enacted. Enclosed is a list of steps that are to be taken to provide adequate notifications.

ANNUAL NOTIFICATION

On an annual basis, the parent, teacher and employee organization shall receive notification reiterating the availability of the plan and other asbestos activities that will occur or have occurred. The annual notification is included in the steps to be taken.

NOTIFICATION OF THE AVAILABILITY OF THE MANAGEMENT PLAN

The Initial and Annual Notification should follow these procedural steps:

- Step 1: Notify in writing the president of the parent, teacher and employee organization about the availability of the management plan. This is to be done when the plan is submitted to Governor's designate (October 1988).
- Step 2: If in the event there are no organizations for either parent, teachers or employees, other logical information devices will be used. A newspaper notice is an acceptable media to comply to the AHERA rules.
- Step 3: The notification will explain the location and availability of the management plan, at no cost to review and how to receive a copy (i.e., \$.10 per page black & white or \$50 per copy). A summary of each school inspection report may be included in the letter initially and annually if desired.
- Step 4: The notification will include all response actions scheduled, all response actions previously undertaken in the past calendar year, notice of inspections, periodic surveillance and other pertinent asbestos management activities that are planned or in progress.
- Step 5: Recordkeeping: A dated copy of each notification is to be kept. In addition, a signed receipt from a certified letter should be kept (optional). Keep all records under TAB 13.

ANNUAL (EMPLOYEE) NOTIFICATION RECORDS

EMPLOYEE NOTIFICATION LETTER

Dear Employee:

Printed Name_____

An environmental health & safety consulting firm completed a study to determine the presence. location, and quantity of asbestos-containing materials at the <u>West Linn-Wilsonville School District</u>. The facilities were inspected in accordance with the Environmental Protection Agency guidelines for asbestos-containing materials (i.e., 40 CFR 763). This study is available for your review in the main office of each facility.

Asbestos poses a widespread concern for everyone since it was used extensively in buildings and homes constructed up to the late 1970's for insulation, acoustical purposes, and/or fire retardation. During that time, asbestos was a government-approved building material and considered almost a miracle substance because of its fire retardant and insulating properties. Airborne asbestos fibers are a health hazard and have been linked with different types of abdominal and lung cancers. We are, therefore, committed to taking corrective measures, when and where appropriate, and our asbestos control efforts will be based on the advise of experts knowledgeable in asbestos abatement techniques.


It is very important that all maintenance, custodial, and production employees read carefully the list of known and suspect asbestos-containing materials located in the main office. Please note the location of asbestos-containing material and avoid any unnecessary disturbance of the material. West Linn-Wilsoville School District has also designed an Operations & Maintenance Plan to ensure that the remaining asbestos-containing materials at our facility remain in good condition. The Asbestos Operations and Maintenance Plan includes specific requirements for the safe handling and removal of asbestos-containing material and should be consulted prior to beginning any work on or near asbestos-containing materials.

By signing this document, you are acknowledging only that you have been informed of the known asbestos-containing materials in the <u>West Linn-Wilsonville School District</u>, the Asbestos Operations & Maintenance Plan for safe handling of asbestos-containing materials, and that you are aware that asbestos may produce adverse health effects if proper control techniques are not used. Our goal is to provide everyone with training and knowledge so that exposure to our employees and contractors does not occur. Our policy of hiring licensed asbestos abatement contractor to perform all work involving asbestos-containing materials will continue.

Please sign and return a copy of this letter. contact me.	If you	have	any	questions	or (conce rns ,	please
Sincerely,							
Asbestos Program Manager							
Signature				Date			

Social Security No.

ANNUAL (PARENT/LEGAL GUARDIAN/OCCUPANT) NOTIFICATION RECORDS



West Linn-Wilsonville School District 3JT

ADMINISTRATION BUILDING

P.O. Box 35 · West Linn, Oregon 97068 · (503) 638-9869 or Fax (503) 638-9878

January 4, 2000

Dear Parents and Students:

In our efforts to comply with Federal and State requirements regarding asbestos management; and to ensure a safe learning environment for the patrons of West Linn-Wilsonville Schools, please be advised that all district facilities except Boeckman Creek Primary, Athey Creek Middle, Wilsonville High and Rosemont Ridge Middle contain varying amounts of known asbestos-containing materials.

The District employs the services of a professional asbestos management firm who has completed a study to determine the presence, location and quantity of asbestos-containing materials in all district facilities. The facilities have been recently re-inspected in accordance with the Environmental Protection Agency guidelines for asbestos-containing materials and this study, as well as all historic data regarding asbestos, is available for your review in the main office of each facility.

West Linn-Wilsonville Schools is committed to providing safe schools for all students and employees in our district and we thank you for your attention to this important issue.

Sincerely,

DEPARTMENT OF OPERATIONS

Asbestos Program Manager

NOTIFICATION & TRAINING OF EMPLOYEES, CONTRACTORS/SHORT-TERM WORKERS

This section reflects requirements outlined in 40 CFR 763.92 (a)(l), (2)(iv) & 763.84 (b)

The following subsections contain this required information:

Contractor/Employee Notification Letter Contractor Notification/Acknowledgement Contractor Asbestos Awareness Training Records

Notification and Labeling

Once the presence of ACM has been established in a facility a notification and warning program should be initiated. The notification and warning program serves two purposes

It alerts affected parties to a potential hazard in the building It provides basic information on avoiding the hazard

Building occupants, employees and others who are aware of the presence of ACM are less likely to disturb the material and cause fiber release. Note, however, that the AHERA Rule requirements for notification are limited to sending written notices to employees, parent and teachers (or organizations representing these groups if such organization exist.) The notices must announce the existence and location of the management plan.

Notification

Notification of building occupants and other affected individuals can be accomplished several ways. Two common techniques are

Distributing notices
Holding awareness or informational seminars

The distribution of notices is an effective means of altering building occupants about the presence of asbestos. Memos or letters can be tailored to specific parties, and verification that notification was received is easily accomplished. For example, in a large multitenant facility, the building owner can send detailed reports to the management of individual companies, while distributing similar informational memos to building occupants.

Awareness or informational seminars can be designed to follow written notification. They serve to expand on relevant information while allowing those attending to raise questions. These seminars can be developed at the same time as other training programs, and typically last no more than several hours.

Regardless of notification format chose, building occupants could be provided with the following information:

What asbestos is and how it is typically used Health effects of associated exposure What type(s) of ACM are present in the facility The exact location(s) of these materials How individuals can avoid disturbing ACM How to recognize and report damage

SHORT-TERM WORKER NOTIFICATION

Information regarding the location of ACBM must be provided for all short term workers who come into the building according to the AHERA Final Rules. To comply with this requirement, LEA should inform all short-term workers that the management plan must be reviewed prior to working in the building.

This can be accomplished by the following:

All workers are to report to the school administrative office prior to starting any activities, review the plan, and sign a statement that they have done so.

CONTRACTOR NOTIFICATION LETTER

CONTRACTOR NOTIFICATION LETTER

West Linn-Wilsonville School District hired an environmental health & safety consulting firm to complete a study to determine the presence, location, and quantity of asbestos-containing materials at the West Linn-Wilsonville School District. Our schools were inspected in accordance with Environmental Protection Agency guidelines for asbestos-containing materials (i.e., 40 CFR Part 763). This study is available for your review in the Central Records Library.

The purpose of this letter is to advise you as to where the known asbestos-containing materials are located at the <u>West Linn-Wilsonville School District</u>, and to refer you to the Asbestos Survey for identification of the presence, location, and quantity of asbestos-containing materials throughout our facility. The survey is located in the Main Office and it is essential that you familiarize yourself in the contents of the survey and the asbestos described in the Operations & Maintenance Plan prior to beginning any work in this facility.

The <u>West Linn-Wilsonville School District</u> has an Operations and Maintenance Plan which provides our employees and contractors with the proper knowledge to institute safe practices for the elimination of potential airborne fibers. One key element of this program includes periodic air testing to ensure that asbestos fiber concentrations are maintained well below the EPA indoor air quality level. Whenever known or suspected asbestos-containing materials are impacted, air quality testing will be conducted.

By way of background, the term "asbestos" describes a group of minerals, including actinolite, amosite, anthophyllite, chrysotile, crocidolite, and tremolite that are related to each other as fibrous inorganic hydrated mineral silicates. These minerals have been valued as a natural resource with hundreds of applications in manufacturing, construction and consumer products. Their fibrous forms allow them to be made of cloth, felt, gaskets, rope or to be used for reinforcement in cements, asphalt, and plastic. They are nonflammable, withstand high temperature and have a high-tensile strength. Three forms of asbestos products are typically found in buildings 1) surfacing materials; 2) thermal materials; and 3) miscellaneous materials such as ceiling tiles, floor tiles and shingles.

Asbestos poses a widespread concern for everyone since it was used extensively in buildings and homes constructed with insulation, acoustical treatments and/or fire protection. Asbestos was installed as a government-approved building material and was considered almost a miracle substance because of its many physical properties. However, airborne asbestos fibers are a health hazard and have been linked with different types of abdominal and lung cancers. We are therefore committed to taking corrective measures wherever appropriate, and our asbestos control efforts will be based on the advice of experts knowledgeable in asbestos abatement techniques.

Asbestos fibers tend to be retained by the lungs and can cause a variety of diseases, some of which are not evident for 20 years or more after initial exposure.

If you have any questions or concerns, please contact the APM, <u>Tim Woodley</u>, at (503) 673-7041.

Thank you in advance for your cooperation.

Sincerely,

Asbestos Program Manager

CONTRACTOR / NOTIFICATION / ACKNOWLEDGMENT

Contractor Notification / Acknowledgement

The <u>West Linn-Wilsonville School District</u> facilities have been determined to contain asbestos. Your work may bring you into close proximity to known or suspected asbestos-containing materials. Please refer to the Asbestos Building Survey and List of Routine Maintenance Areas for descriptions of asbestos-containing material in the specific areas you will be working in.

WORKING WITH ASBESTOS CAN BE DANGEROUS. INHALING ASBESTOS FIBERS HAS BEEN LINKED WITH VARIOUS TYPES OF CANCER. IF YOU SMOKE AND INHALE ASBESTOS FIBERS, THE CHANCE THAT YOU WILL DEVELOP LUNG CANCER IS GREATER THAN THAT OF THE NON-SMOKING PUBLIC.

Disturbance of the asbestos-containing materials may cause release of asbestos fibers into the air. The work you are about to perform should not disturb and/or damage these materials. Any such activity is prohibited without the use of engineered control procedures and employees trained in their use (DEQ certified asbestos abatement workers and/or supervisors). An asbestos work order must be granted by the <u>LEA</u> before performing any task that might result in the disturbance of asbestos-containing materials. The only contractors that are permitted to intentionally disturb asbestos containing material are those that have received an Oregon Asbestos Abatement Contractor license.

By signing this document you are acknowledging that you have been informed of the known locations and health hazards associated with asbestos-containing materials in the <u>West Linn-Wilsonville School District.</u> You are also acknowledging that you understand that only licensed asbestos abatement contractors and certified asbestos abatement employees may intentionally disturb asbestos-containing material. If you encounter damaged materials that you believe might contain asbestos, you are responsible for notifying the APM prior to any activities that might results in the release of asbestos fibers.

SIGNATURE:	DATE:	
PRINTED NAME:	SS#:	
COMPANY:		

CONTRACTOR ASBESTOS AWARENESS TRAINING RECORDS

TRAINING

This section reflects requirements outlined in 40 CFR 763.84 (2), 763.92 (a) (v), (2)

The following subsections contain this required information:

- LEA Designate/Asbestos Awareness Training Records
- Maintenance/Custodial Staff
- Personnel Medical Records (if applicable)

ACTION: You must train your custodian and maintenance employees. Prior to the start of the O & M Plan, there is a 2 hour awareness training and 14 additional hours of training for workers who may come in contact with asbestos.

FORM: N/A

EMPLOYEE AND WORKER TRAINING

Training workers to use special procedures and work practices is a key to a successful asbestos management program. The training requirements differ between OSHA and AHERA, primarily in that OSHA has no specific number of training hours. There is also a difference in various state training programs.

All LEA maintenance and custodial staff, as well as contract workers, who work in a building containing ACBM are required to receive at a minimum a two-hour awareness training seminar. Any of these workers who will disturb ACBM must receive an additional 14 hours of training. Workers engaged in large-scale, long-duration ACBM activities in K-12 schools must receive 24 hours of training and become "Accredited Asbestos Workers". They must also receive an annual 8-hour refresher course. In Washington State the training program is 36 hours for "Accredited Workers".

The time intervals for the awareness education and 14 hours additional training of the employees are not specified by EPA regulations. However, it is highly recommended that both the two-hour awareness seminar and the additional 14 hours of training be given annually. All employees must receive the two-hour awareness training within 60 days of beginning work or, if they will come into contact with ACBM, before they begin their activities. Intervals should be checked for compliance with state and local rules and regulations. Many private companies and LEAs have all workers who contact ACBM attend the 24-hour training to provide the highest level of worker training. A sample employee training records form is included in this section.

LEA DESIGNATE

The local Education Agency designated person (asbestos program manager) is the responsible person on behalf of the school district to ensure that the management plan and the AHERA rules are followed and, even more importantly, to protect the health of the building occupants and the environment.

Every LEA must designate a person and train them with the basic knowledge of the following:

- --Health effects of asbestos
- --Detection, identification and assessment of asbestos containing materials
- -Options for controlling asbestos containing building materials
- --Asbestos management programs
- -- State and Federal regulations

There is no approved course or length of training set by the EPA. Some people are of the opinion that the LEA designate should take a 5 day Accredited Inspector/Management Planner course. This

TRAINING

is the highest level of accredited training for non-workers. Because the LEA designate is the most responsible party in the asbestos management process, taking this course when available makes sense. There are 3 day courses to train LEA designates and even 1 day courses.

TWO-HOUR AWARENESS TRAINING

The required LEA two-hour awareness training program should include the information given to the occupants for the general information sessions and mailings and should include:

- -- Uses and forms of ACBM
- --Health effects of asbestos
- -- Location of ACBM in building
- --Recognition of problems such as damage, deterioration, or delamination of ACM
- -- Name and telephone number of the APM
- --General understanding of the asbestos management program
- --Overview of work practices and procedures to be followed by personnel who will
- -- Contact ACBM

WORKERS WHO CONTACT ACBM

All employees and contract personnel who contact ACBM through cleaning maintenance or emergencies must have at least an additional 14 hours of training (16 hours total). Three types of training for workers who contact ACBM can be identified:

- -- Training for custodians involved in cleaning and simple maintenance tasks
- --Training for maintenance workers involved in general maintenance and more complex repair tasks
- --Training for workers who may conduct limited asbestos abatement (removal, enclosure, and encapsulation) or whose work involves direct (intentional) contact with ACBM

All three types of training should include general discussions of the uses and health effects of asbestos, the location of ACBM in the building, the overall asbestos control program, and the asbestos management program.

The additional 14-hour training program should also include:

- --Physical characteristics of asbestos
- --Methods and procedures for handling and disposing ACBM
- -- Medical monitoring and surveillance requirements
- -- Personal protection, including respiratory protection and protective clothing
- Working knowledge of the asbestos management program, including safety, access, and reinspection
- -- Equipment availability and uses including wet cleaning, HEPA vacuuming, steam cleaning, etc.
- --Hands-on training in use of respirators, personal protection, work practices, and fiber control

TRAINING

- --Importance of record-keeping and employee record generation requirements
- --Requirements for clearing work-order through the APM for of all renovation and ACBM disturbance activities
- -- Nonasbestos safety considerations
- -- Training and licensing requirements by state and local agencies

ACCREDITED ASBESTOS WORKER TRAINING

The training requirement for an accredited asbestos worker includes a 24-hour, or three-day course. The course should include lectures, demonstrations, at least six hours of hands-on training, individual respirator fit-testing, course review, and an examination. EPA recommends the use of audio-visual materials to complement lectures where appropriate.

The training course should adequately address the following:

- --Physical characteristics of asbestos
- --Potential health effects related to asbestos exposure
- -- Employee personal protective equipment
- --State-of-the-art work practices
- --Personal hygiene
- --Addition safety hazards
- -- Medical monitoring
- -Air monitoring
- --Relevant federal, state, and local regulatory requirement, procedures, and standards.
- -- Establishment of respiratory protection programs
- --Course review

The worker must receive a passing grade of 70% on an examination with 50 multiple-choice questions.

TEACHING QUALIFICATIONS

The 2 and 14-hour training programs can be conducted by any qualified person trained in asbestos control and management. The EPA stresses the use of the most qualified people available. The 24-hour training program for workers must be an EPA-accredited training course. A sample form for recording individual worker training is included in this section.

CONTRACT SERVICES

Where custodial and maintenance services are performed under contract with a service company, the building owner must ensure that the service company's staff has been properly trained for working with ACBM. Training will include successful completion of courses on asbestos control and special programs that meet the requirements for the LEA staff discussed above. The company's respirator and medical surveillance programs should be reviewed. In addition, the company performance should be verified with other customers, particularly owners of buildings containing ACBM.

If the service company meets the training and performance requirements, an initial session should be held with the company's supervisors and workers to inform them of the location of ACBM in the building and of all building-specific operating procedures. The APM assumes responsibility for ensuring that the service company adheres to all aspects of the asbestos management program.

LEA DESIGNATE/ASBESTOS AWARENESS TRAINING RECORDS

Course Title: AHERA DP TRAINING


Date(s): 10-14-99

Location: WEST LINN-WILSONVILLE

SCHOOL DISTRICT

ADMINISTRATION BLDE,

PAC PRO Safety & Health Services
660 N.W. Bella Vista Drive • Gresham, Oregon 97030
Phone: 503-666-6693 • Fax: 503-665-3143

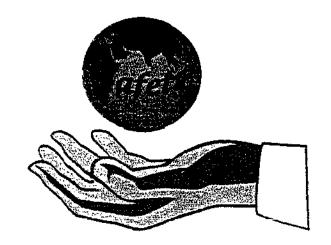

Attendance Roster

Name	Сотрану	Phone Number
1 Jeri Nelson	WL-WV School Dist.	673-7013
1. Jeri Nelson 2 Tim Woodley	School District	673-7041
` <u></u>		
4.		
5.		
6		
7.		
8.		
9.		
10.		
11.		
12		
13.		
14.		
15.		
16.		
17.		
18.		
19.		
20.		



Presented by Three Rivers Environmental, Inc.

Jeri Nelson

has successfully completed a Designated Person training course in accordance with EPA AHERA 40 CFR, Part 763, Subpart E.

October 14, 1999 West Linn - Wilsonville School District 22210 SW Stafford Road West Linn, Oregon 97068

Instructor

Three Rivers Environmental, Inc. 545 W. Arlington

Gladstone, Oregon 97027

Certificate of Completion

Presented by Three Rivers Environmental, Inc.

Tim Woodley

has silebes sfully completed to Designated Person
training course madeordance with
EPAAIIERA 40, CFR, Part 763, Subpart E.

October 14, 1990

West Lina - Wilsonville School District

22210 SW Stafford Road

West Linn Oregon 27068

mey Mezill


nstructor

Three Rivers Environmental: Inc. 545 W Arlington Gladstone, Oregon 97027. (503)-557-2396


MAINTENANCE / CUSTODIAL STAFF

Date(s): 03-26-01

Location: WESTLINN-WILSONVILLE 5.D



660 N.W. Bella Vista Drive • Gresham, Oregon 97030 Phone: 503-666-6693 • Fax: 503-665-3143

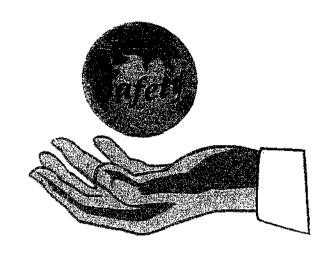


Attendance Roster

SIGNATURE	PRINTED NAME	PHONE NUMBER
1 Wall Of all the	David Jolliffe	539 5824
2/leny turn	Terry L. Sturman	630-3675
3 Kolin Nol	Robin Nolan	(031-4832
4. Plesmoldo R agrico	REYNALDOR ESPINO	675-8260
5. Value Hollocap	Vicki Holtcamp	638-4460
6. Claud Kodi	Claude Koch	653-9482
7. Centilar	(SIINWAI)	723-1453
8.	Tun Lucay	772-7105
9 Jacoh	Lunda Sacobs	636-2698
10. Januar	Leo Moser	435-2979
The flow	Jun Hour	635 9272
ommen former	Chevyl Sommer	673-7265
3) airneda Molin	ChyNEGA NOLIN	
14. ('aul zuerhar	CAROL Zuencher	673-7013
15 Nor	Jeri Nelson	673-7013
16 Ma Fredon	John Erickson	632-4421
17. USER 6-10 BARROSO		723-0614
18. ELOUN WARROQUIN EL		1//>
19 Aly Costra	Aldagunda Pastro O	
20 Lase Angel Dosa	Store H. Rosas	691 - 89-39

Date(s): 03-26-01

Location: WESTLINN-WILSONVILLE S.D.

PAC PRO Safety & Health Services
660 N.W. Bella Vista Drive • Gresham, Oregon 97030
Phone: 503-666-6693 • Fax: 503-665-3143

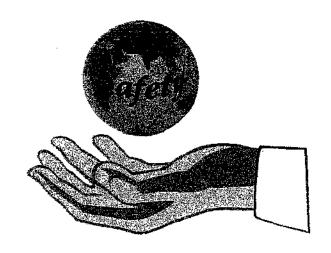

Attendance Roster

SIGNATURE	PRINTED NAME	PHONE NUMBER
Than Olello	David Jolliffe	539 5826
2 /Jerry Turn	TRAY L. STURMAN	630-3675
3. Kor Noc	Robin Nolan	631-4832
4. Raznol do R. agmis	REYNALDO & ESPINO	678-8260
5. Chalm Holtomp	Vicki Holtcamp	638-4460
6. Cloud Kade	Claude Koch	653-9482
7. Ou Juliu	COLINWALL	723-1453
8.	Jun Lucey	772-7105
9. Thoras (facol)	Lunda Secoles	636-2698
10. January	Leo Moser	435-2979
I ffrom	Jun Horar	635 9272
of threigh frommer	Cheryl Somner	673-7265
3 (augueda Molin	OWYNEA A NOLIN	673-7013
 14 Carol zure la	CAROL Zuencher	673-7013
15 Day Nor	Jeri Nelson	673-7013
16. John Friedson	John Erickson	632-4421
17. USERGIO BARROSO		723-0614
18. ETOLOR WARROQUIN STA		
19. Aly Castro	Aldegunda Castro O.	430-17-81
20. Jase Angel Dosas	Love H. Rosas	691 - 89-39


Date(s): 02-16-01

Location: WEST LINN-WILSONVILLE S.D.

WEST LINN, OR

PAC PRO Safety & Health Services

660 N.W. Bella Vista Drive • Gresham, Oregon 97030 Phone: 503-666-6693 • Fax: 503-665-3143

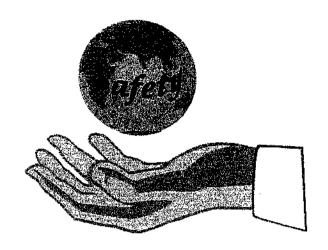


Attendance Roster

SIGNATURE	PRINTED NAME	PHONE NUMBER
1. July Neomass	VICKI LEOMANS	673-7013
2 Shim Jamble	Steve Lewallon	/ (/ / /
3. John W. Hustley &	John W. HARHLEY Jr	673-7100
4 Ket gio Lyna	RENGEO LUNA	774-6428
5x my donne	LARRY JOHNSON	625-4541
6. Say Ife.	LARRY TOUSE	678-1494
7. Kenin Wahunda	Keoin Washington	794-9452
8 KO-D mos	Kon O mosa	653~1832
2 La Figa	Battle Rigg	570-0466
10. min Morwel	Doug NIMROD	998-7252
11. Kary W B I	ROCKY Bounds	931-1027
12 mispay mounts	mickey mouse	824-3105
13. Ollas Parin	Allan Perrine	656-6685
14 Dany Sug	GARY H. N.S.	2227-8206
15. Jan I wan	TOM NIXON	682-8434
16.	105/ er 1300	6/25 1901
17.		
18.		
19.	<u> </u>	****
20.		

Course Ti	ILE: ASBESTOS AWARENESS
Date(s):_	02-16-01
Location:	WEST LINN-WILSONVILLE S.D.
	WEST LINN, OR

PACERO Safety & Health Services
660 N.W. Bella Vista Drive * Gresham, Oregon 97030
Phoene: 503-666-6693 * Fax: 503-665-3143

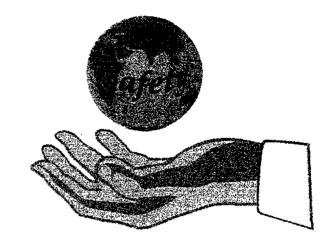

Attendance Roster


SIGNATURE	PRINTED NAME	PHONE NUMBER
1 ROBERT STEWARD	Robert Steeren	n/A
2 Robin K Meintoch	Robin K Metatoch	303-722-9775
3 1 & Ronson	Frank F Ransom	7607086
4. oftening & Paula	HAROLA PAULRY	5037257166
5. BLAINE CHRISTOPHER	Blame ChaisTOPHER	503 771-8127
6 DE PROJERESS	PEPRO HORRES SAT	503 6 9 1KG 39
7. Derry Casey	Terry Casey	673-7436
8. Kim Vachter J	Kim Vachtet	673.7013
9. Sonda Vaccondar	Linda Varsandar	666-1925
10. JESUS LUNA	JESUS LUNA	803-7060
11. JOSE LUNA	JOSCZINA	498-7252
12		
13.		
14.		
15.	<u> </u>	
16.		
17.		
18.		
19.		
20.	<u> </u>	

Date(s): 02-16-01

Location: WESTLINN · WILSONVILLE S. D.

WEST LINN, OR

PAC PRO Safety & Health Services
660 N.W. Bella Vista Drive • Gresham, Oregon 97030
Phone: 503-666-6693 • Fax: 503-665-3143

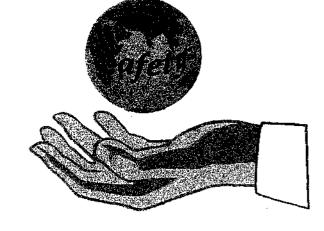

Attendance Roster

SIGNATURE	PRINTED NAME	PHONE NUMBER
1. Trul Connell	5-36Hry Cromwell	650-2636
2 Darrie Comment	Darryl Gromwell	503-65-2636
3. Transmy Batting	Nancy BeHineski	655-7152
4 Witte	BILL RAY	650-3842
5/11/all Olims	MIAIR L. RAINER	673-7013
6.	<u> </u>	
7.		
8.		
9.		
10.		
11.		
12.		
13.		2
14.		
15.		
16.	<u> </u>	
17.		
18.		
19.		
20.		

ASBESTOS AWARENESS TRAINING FEBRUARY 21, 2000

Smith, Jason

Moser, Leo

Simmons, Phil

Riggar, Butch

Pauley, Harold

Deatherage, Ryan

Wart, James

Herring, William

Hartley, John

Johnson, Larry

Wall, Colin

Griffin, James

Luna, Jose

Bounds, Rocky

Luna, Jesus

Luna, Refugio

Washington, Kevin

Somner, Cheryl

Koch, Claude

Baer, David

Rainey, Mark

Olson, Terry

Garza, Pam

Yeomans, Vicki

Nolan, Robin

Hines, Gary

Lewallen, Steve

Ray, Bill

Peter, Jim

Cromwell, Darryl

Nixon, Tom

Daley, John

Jacobs, Linda

Vachter, Kim

Sturman, Terry

Simmons, Joe

Thomas, David

Christopher, Blaine

Howard, Jerry

Whitney, Clair

Course Title: ABBESTOS AWARENESS

Date(s): CRITCH AWARENESS

Location: WESTLINH / WILLIAM VILLE

WESTLINH OR

WESTLINN OR

PAC PRO Safety & Health Services

660 N.W. Bella Vista Drive • Gresham, Oregon 97030 Phone: 503-666-6693 • Fax: 503-665-3143



Attendance Roster

SIGNATURE	PRINTED NAME	PHONE NUMBER
1. Jam D & mith	Jam D Smith	5031682-1521
2-45 MEY	Leo Moser	435-2979
3. Jell dimond	Phil Simmons	570 - 9753
4 Bill 20_	Butch RIDGER	570-0466
5. Housed & Pauley	HAROLD R PAUley	7757146
a Rym clather wit	Ryan De atherage	557-7347
Tromo to than	James H- Want	632-6492
& William \ Herry	WILLIAM HERRING	632-4582
9. John W Huckey	John W HARtley JV	698-4771
10 avois Aonison	LARRY JOHNSON	625-4541
11.	COLIN WALL	232-215,7
12 Jaires & Oloffic	VAMES A GRIFFA	656-4688
13. VOC 2000	JOSE F-LUNA	259-9483
14. Forif But	ROCKY BOUNES	582-8506
15. Jac. S. Jung	Jesis Lung	2567-9983
16. 10. 1916	PERINE LUNG	948 9287
17 we of Washington	Keyin Washington	794-9452
18 Grend Sommer	Charge Service	250009
19. Carry Ca	Charle Koch	653-9482
20. This fine	David 5 Rose	632-3408

Course Title: ASBESTOS AWARENESS

Date(s): 02/21/CC

Location: WEST LIND/WILSONVILLE

SCHOOL DIST. ADMIN. BLDG.

WEST LIND, CR

PAC PRO Safety & Health Services

660 N.W. Bella Vista Drive
Gresham, Oregon 97030
Phone: 503-666-6693
Fax: 503-665-3143



Attendance Roster

SIGNATURE	PRINTED NAME	PHONE NUMBER
Min Hellen	MAIK L. RAINEY	673-7013
2 / Jen Jan	Terry Olion	
3 Par Garza	Pam Garza	
4 Ville M (LEONARS	VICKI GEOMANS	
5. Poly Nol	Bobin Dolan	<u></u>
6. Hary Thuis	GARY HINES	
7. The second	Steve Levaller	673-7909
8. Ultar	· BILL RAY	673-7845
9. my Kett	Jim Peter	656-6665
10. Darry	Desill esemble	660-263e
11. Thomas Lyon	THOMAS NIXON	1682-8434
12 July 2 Caly	John C. DAls-	631-8603
13. Frade Ladred	binda 5 cheeks	636-2698
14. Kin Varity	K.m. Vachter	65-6.5.429
15. Terry C. Sturman	June 1 Str	630-3675
16. Joe Symmons	Joe Simmons	673.7016
17. Carl Thyones	DAVID THOMAS	673-7013
18. Jan (Hitzely)	BLAINE CHRISTOPHER	771-8127
19 Jone	Jerry Haund	63 673-750s
26. Join Whitnus	CLAIR WHITNEX	722 12 49

ASBESTOS AWARENESS MARCH 20, 2000

Gaffney, Les Sherman, Walt Chavarin, Freddy Steward, Robert Cromwell, Gary Zuercher, Carol Dvorak, Mark Rose, Thelma Lasit, Sharon Espino, Reynaldo Nolin, Gwynn Nimrod, Doug Varsandar, Linda Holtcamp, Vicki Bettineski, Nancy Moser, Ronald Boyle, Lester Casey, Terry Perrine, Allan Torres, Pedro Nelson, Jeri

Joliffe, Dave

Course Title: ASBESTOS AWARENESS Date(s): 3/20/00 WEST LINN SCHOOL DIST. Location: ADMINISTRATION BLDG. WESTLINN OR

PACINO Safety & Health Services (60) N.Vv. Sella Vista Drive . Gresham, Oregon 979) Phone: 503-666-6693 + Fax: 503-665-3143



Attendance Roster

SIGNATURE	PRINTED NAME	PHONE NUMBER
1. Les C. Baffmers	LES OF GATTNEW	503-762-4086
2 West 5/1000	VIKAG SHERMAN	507-30-2-2092
3. 14 12 Care	Tread throating	<u></u>
4436000	ROBER STERIARD	11/4
5. May I Comsol	GALY COMMENTS	690 2056
6. Could fine to	CARCL courches	1634 1374
7. Mach Doorah	MARK DUOKAK	<u>us7-7430</u>
8. 4	THECOLF ROSE	454-3494
9. Shary Farit	Sharen Lasy	673 7/55
10. Heyrol to the Lynno	Royus GO IL SPIM	ľ
11 Karmer	Constant Wald	435-1009
12 Josephan Zamung	Nuc HIMROD	924-3/05
13. The Carson fur	Landa Versonder	666-1975
14 Mills Hollow	Vide Holdicanop	1.38 - 4440
15. The Carl Miss	None BeHANSE	
	Kunery U Muser	100 8 3 K 3 H
17		532 6400
18. Terry Cary	Terry accy	654-6685
	Allan Ferrine	COC. 00000
20. PEPRO 4012865 S		1

Course Titl	e: ASBESTOS AWARENESS
Date(s):	3/20/00
Location: _	WEST LINN SCHOOL DIST
	ADMINISTRATION BLDG.
	WEST LINN, OR

PACTRO Safety & Health Services
660 N.W. Rella Vista Drive * Gresham, Oregon 970-9
Phone: 503-066-6603 * Fax: 503-665-3143



Attendance Roster

PLEASE PRINT your name clearly, as you want it to appear on your certificate.

SIGNATURE	PRINTED NAME	PHONE NUMBER
1. ;()	Sauce Volite	
2 Car Dillon	Waster Walson	(0)3-7013
3.		
4.		
5.		
6.		
7.		
8.		
9.		
10.		
11.		
12.	_	
13.		
14.		
15.		
16.		
17.		
18.		
19.		
20.		

Tel

PERSONNEL MEDICAL RECORDS (if applicable)

MEDICAL MONITORING

OR-OSHA Division 3 - 1926.1101 (m); (n)(3)

A medical surveillance program must be made available to workers employed in the construction industry who are:

 exposed to asbestos at or above the PEL (0.1 f/cc - 8TWA) or Excursion Limit (1.0 f/cc - 30 min.) for 30 or more days per year;

or

- engaged in Class I, II, and/or III asbestos work for 30 or more days per year;
- required by the rules to war a negative-pressure respirator.

All other employees who are or will be exposed to asbestos at or above the action level must be covered by a medical surveillance program.

Medical examinations must be given on the following schedule:

- prior to assignment to an area where negative-pressure respirators are worn; or
- within 10 working days following the thirtieth day of exposure annually thereafter.
- if an examining physician determines that any test(s) should be more often than the annual schedule.

Examinations must include:

- · medical and work history;
- standardized questionnaire; abbreviated questionnaire;
- physical examination;
- chest X-ray (this is based on the doctor's discretion and analyzed by a specialist);
- · pulmonary function test; and,
- any other examination deemed necessary.

The employer must maintain an accurate record for each employee, including:

- name and social security number;
- · copy of medical examination;
- · physician's written opinions;
- any medical complaints related to asbestos;
- maintain the record for 30 years beyond termination

Employee access to information: the employer shall provide a coy of the physician's written opinion to the employee within 30 days from its receipt.

Physicians written opinion: Employers must instruct the physician not to reveal in the written opinion given to the employer specific findings or diagnoses unrelated to occupational asbestos exposure.

RESPIRATORY PROTECTION OR-OSHA Division 3 – 1926.1101 (h)

Respirators must be worn under the following conditions:

- during the time necessary to install or implement engineering controls and work practices to bring exposures to below the PEL and/or excursion limit
- in operations where controls are not feasible i.e. maintenance and repair activities
- where controls have not reduced exposure levels below the PEL and/or excursion limit
- in emergencies
- · in all regulated areas, and
- whenever employee exposure exceeds PEL and/or excursion limit.
- Whenever employer cannot do an appropriate negative exposure assessment of an asbestos abatement project.

PERIODIC SURVEILLANCE

This section reflects requirements outlined in 40 CFR 763.92 (3) (b) (2) (i-iii)

ACTION: Check the condition of the asbestos-containing materials (ACM) at least every 6

months.

TRAINING: None required; O & M or Inspector suggested.

FORM: Use the form included in this Section.

A well-run asbestos management program must include periodic surveillance of the ACBM. Periodic surveillance is the scheduled observation of asbestos materials to determine if any damage or deterioration occurred since the previous observation. Because much of the ACBM is observed daily by the school staff during normal work and also because many areas are not accessible, slight changes in the condition of the ACBM occurring over time may not be readily apparent.

Some building owners conduct monthly surveillance. AHERA requires surveillance in K-12 schools at no greater than six month intervals, and this is a prudent minimal frequency for any Owner. This periodic surveillance can save the building owner considerable time money, and embarrassment in the event of ACBM deterioration or damage. Moreover, properly conducted surveillance provides a great deal of comfort to building workers and occupants.

SURVEILLANCE PERSONNEL:

AHERA establishes no training requirements for the persons conducting the periodic surveillance. Any employee or contractor selected by the Asbestos Program Coordinator is allowed to conduct the surveillance. Three Rivers Environmental Inc. recommends that the observer either take a 16-hour Operations and Maintenance course or a 3-day inspector course. The individual should be knowledgeable of the building's construction, previous inspections and surveillances, generation of records, conditions to be observed, and personal protections. It is the Owner's responsibility to ensure that the surveillance does not cause an exposure of safety problem for the person conducting this activity.

DATA REQUIREMENTS:

All areas with ACBM or suspected ACBM must be visually examined in each periodic surveillance. A record of the surveillance date and the person conducting the surveillance, as well as any changes in ACBM conditions, must be recorded. This requires the person to be knowledgeable of earlier ACBM conditions. The records generated by this periodic inspection must be filed in the Management Plan at the Owner's administrative office. It is recommended that the reports to be filed in the administrative office be submitted to the Asbestos Program Coordinator for review.

SURVEILLANCE CONCERNS:

The person conducting the periodic surveillance must observe the same major factors that were observed in the original inspection and that were used to assess the material's conditions. The six items to be evaluated are:

- -- Deterioration or delamination of the materials.
- -- Physical damage to the material or adjacent areas.
- -- Water damage of any material in the area.
- -- Air-stream effects
- -- Exposure, accessibility and activity changes.
- -- Changes in building use.

PERIODIC SURVEILLANCE

RECORDKEEPING:

File Periodic Surveillance Reports under TAB 8 and utilize the appropriate form.

COMMUNICATIONS:

Any changes in conditions or notable circumstance should be communicated to the Asbestos Program Coordinator. The updated information is to be included in the Management Plan and in the annual notification letters.

AHERA

Six Month Periodic Surveillance

WEST LINN SCHOOL DISTRICT #3Jt

OF

West Linn High School 5464 West "A" Street West Linn, OR 97068

Project No. 1020-109

KOBERT C. MODTGOMSAY
AHERA Inspector

Management Planner

Signature & Date

Signature & Date

Prepared by:

P.O. Box 216 Gladstone, OR 97027 Phone (503) 557-2396 Fax (503) 557-3025

Page #: 1 of 5

Client: West Linn School District TRE Job#: 1020-109

Campus: West Linn High School Building: Main

Address: 5464 West "A" Street Date of Surveillance: May 2000

Person Conducting Surveillance: Robert Montgomery

Material Description: Boiler/Tank Insulation/Mechanical Insulation

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Gasket

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/MJP on Corrugated Pipe Cover

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Page #: 2 of 5

Client: West Linn School District TRE Job#: 1020-109

Campus: West Linn High School Building: Main

Address: 5464 West "A" Street Date of Surveillance: May 2000

Person Conducting Surveillance: Robert Montgomery

Material Description: Boiler/Tank Insulation

Homogeneous area(s): HK USA #02

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/MJP on Corrugated Pipe Covering

Homogeneous area(s): HK USA #02

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #02

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #03

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #04

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Pipe Covering

Homogeneous area(s): HK USA #05

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/MJP on Pipe Covering

Homogeneous area(s): HK USA #06

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #07

Last Material Condition: Good New Material Description: Same

Page #: 3 of 5

Client: West Linn School District TRE Job#: 1020-109

Campus: West Linn High School Building: Main

Address: 5464 West "A" Street Date of Surveillance: May 2000

Person Conducting Surveillance: Robert Montgomery

Material Description: Domestic Cold Water/MJP on Corrugated Pipe Covering

Homogeneous area(s): HK USA #08

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Acoustical Thermal Plaster

Homogeneous area(s): HK USA #11

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #50

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #50

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #52

Last Material Condition: Good New Material Description: Same

Change in material condition: No.

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #53

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #54

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #55

Last Material Condition: Good New Material Description: Same

Page #: 4 of 5

Client: West Linn School District TRE Job#: 1020-109

Campus: West Linn High School Building: Main

Address: 5464 West "A" Street Date of Surveillance: May 2000

Person Conducting Surveillance: Robert Montgomery

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #56

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #57

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #58

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/MJP on Corrugated Pipe Covering

Homogeneous area(s): HK USA #59

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Pipe Covering

Homogeneous area(s): HK USA #60

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/MJP on Pipe Covering

Homogeneous area(s): HK USA #61

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #97

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Transite Siding Homogeneous area(s): HK USA #98

Last Material Condition: Good New Material Description: Same

Page #: 5 of 5

Client: West Linn School District TRE Job#: 1020-109

Campus: West Linn High School Building: Main

Address: 5464 West "A" Street Date of Surveillance: May 2000

Person Conducting Surveillance: Robert Montgomery

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #99

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #99

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Transite Siding Homogeneous area(s): HK USA #98

Last Material Condition: Good New Material Description: Same

Shange in material condition: No

Material Description: TSI Hard Fittings, Mag Line Over Corrugated Pipe Covering Homogeneous area(s): 50 hard fittings, 40 ln. ft. under S. wing of high school Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: MJP on Pipe Covering (12" O.D.)

Homogeneous area(s): 1 sq. ft. TSI damaged exposed in gym (E. side above landing)

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Material Description: Sheet vinyl

Homogeneous area(s): 290 sq. ft. torn sheet vinyl between cafeteria & stairs to commons area

Last Material Condition: Good New Material Description: Same

p.2

THREE RIVERS ENVIRONMENTAL, Inc.

June 2, 2000

West Linn-Wilsonville School District Attention: Tim Woodley P.O. Box 35 West Linn, OR 97068

Three Rivers Env

Dear Mr. Woodley,

Three Rivers Environmental, Inc. appreciates the opportunity that we had to conduct your AHERA Re-inspection of asbestos containing building materials. This reinspection consisted of the review and updating of all AHERA records under current regulatory guidelines and the inspection and assessment of all asbestos containing materials in eight schools with addition of the Administration Building within West Linn-Wilsonville School District. The review of all AHERA records and the assessments of all asbestos containing building materials were performed by an accredited AHERA Building Inspector and Management Planner.

The following are the "Areas of Concern" for each individual school and the materials that were located that are in need of immediate attention.

West Linn High School-

Material:

TSI hard fittings, mag lines over corrugated pipe covering

Assessment noted: 50 hard fittings, 40 ln. ft. under S. wing of high school

Recommended Response Action: Immediately isolate, restrict access, clean-up

debris and maintain in an intact and

undamaged condition.

Material:

MJP on pipe covering (12" O.D.)

Assessment noted:

1 sq. ft. TSI damaged exposed in gym (E. side above

landing)

Recommended Response Action: Repair and maintain in an intact and

undamaged condition.

West Linn High School cont.

Material:

Sheet vinyl

Assessment noted:

290 sq . ft. torn sheet vinyl between cafeteria & stairs to

Recommended Response Action: Abate, repair flooring and replace

Willamette Primary-

Material:

TSI hard fittings

Assessment noted:

1 sq. ft., 1 damaged hard fitting, wall intrusion, cracks at

hanger location.

Recommended Response Action: Repair and maintain in an intact and

undamaged condition.

Wilsonville Primary-

Material:

Floor tile, 12x12

Assessment noted: 7 ln. or sq. ft. of tile cracked severely at stress line.

Recommended Response Action: Remove and repair damaged tiles and

maintain in an intact and undamaged

condition.

Inza R. Wood Primary-

Material:

Hard fitting, mag

Assessment noted:

1 hard fitting slightly damaged in mechanical room

Recommended Response Action: Repair and maintain in an intact and

undamaged condition.

West Linn High School (Bolton Campus)-

Material:

Corrugated pipe covering

Assessment noted:

I sq. ft. exposed TSI pipe covering in basement storage

room

Recommended Response Action: Repair and maintain in an intact and

undamaged condition.

Cedar Oak Park Primary-

Material:

Vibration joint cloth

Assessment noted: 2 sq. ft. damaged corners in fan room (West)

Recommended Response Action: Remove or repair and maintain in an intact

and undamaged condition.

Material:

TSI air cell piping

Assessment noted:

1 sq. ft. damaged TSI in boiler room, S. wall

Recommended Response Action: Remove or repair and maintain in an intact

and undamaged condition.

Administration Building-

Material:

Woven paper tape

Assessment noted:

8 sq. ft. of damaged paper tape on walls in boiler room

Recommended Response Action: Repair or replace and maintain in an intact

or undamaged condition.

AHERA

Periodic Surveillance Report

for

WEST LINN-WILSONVILLE SCHOOL DISTRICT 3JT

WEST LINN HIGH SCHOOL

5464 West "A" St. West Linn, OR 97068

Project No. 1020-40

April 1999

Prepared by

P.O. Box 216 Arlington Gladstone, Oregon 97027 (503) 557-2396

Page #: 1 of 5

Client: West Linn School District TRE Job#: 1020-40

Campus: West Linn High School Building: Main

Address: 5464 West "A" Street Date of Surveillance: April 1999

Person Conducting Surveillance: Matthew Johnson

Material Description: Boiler/Tank Insulation/Mechanical Insulation

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Gasket

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/MJP on Corrugated Pipe Cover

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No.

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Page #: 2 of 5

TRE Job#: 1020-40 Client: West Linn School District

Campus: West Linn High School

Building: Main

Address: 5464 West "A" Street

Date of Surveillance: April 1999

Person Conducting Surveillance: Matthew Johnson

Material Description: Boiler/Tank Insulation

Homogeneous area(s): HK USA #02

Last Material Condition: Good

New Material Description: Same

Change In material condition: No

Material Description: Domestic Hot Water/MJP on Corrugated Pipe Covering

Homogeneous area(s): HK USA #02

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #02

Last Material Condition: Good

New Material Description: Same

Change in material condition:

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #03

Last Material Condition: Good New Material Description: Same

No

Change in material condition: N٥

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #04

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Pipe Covering

Homogeneous area(s): HK USA #05

Last Material Condition: Good

New Material Description: Same

Change in material condition:

Material Description: Domestic Hot Water/MJP on Pipe Covering

Homogeneous area(s): HK USA #06

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #07

Last Material Condition: Good New Material Description: Same

Page #: 3 of 5

Building: Main

Client: West Linn School District TRE Job#: 1020-40

Campus: West Linn High School

Address: 5464 West "A" Street Date of Surveillance: April 1999

Person Conducting Surveillance: Matthew Johnson

Material Description: Domestic Cold Water/MJP on Corrugated Pipe Covering

Homogeneous area(s): HK USA #08

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Acoustical Thermal Plaster

Homogeneous area(s): HK USA #11

Last Material Condition: Good New Material Description: Same

Change in material condition:

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #50

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #50

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #52

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #53

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #54

Last Material Condition: Good

New Material Description: Same

Change In material condition: Nο

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #55

Last Material Condition: Good

New Material Description: Same

Page #: 4 of 5

Client: West Linn School District TRE Job#: 1020-40

Campus: West Linn High School Building: Main

Address: 5464 West "A" Street Date of Surveillance: April 1999

Person Conducting Surveillance: Matthew Johnson

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #56

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #57

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #58

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/MJP on Corrugated Pipe Covering

Homogeneous area(s): HK USA #59

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Pipe Covering

Homogeneous area(s): HK USA #60

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/MJP on Pipe Covering

Homogeneous area(s): HK USA #61

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #97

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Transite Siding Homogeneous area(s): HK USA #98

Last Material Condition: Good New Material Description: Same

Page #: 5 of 5

Client: West Linn School District TRE Job#: 1020-40

Campus: West Linn High School

Building: Main

Address: 5464 West "A" Street

Date of Surveillance: April 1999

Person Conducting Surveillance: Matthew Johnson

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #99

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #99

Last Material Condition: Good

New Material Description: Same

Change in material condition:

No

Material Description: Transite Siding Homogeneous area(s): HK USA #98

Last Material Condition: Good

New Material Description: Same

Change in material condition:

No

Joe Simmons
West Linn-Wilsonville School District
Administration Building
P.O. Box 35
West Linn, OR 97068

Subject: AHERA 6 Month Reinspection Areas of Concern:

Dear Mr. Simmons:

Three Rivers Environmental has completed the AHERA 3 Year Reinspection. The list below are areas that need to be addressed in the Operation and Maintenance Plan and scheduled for repair or removal:

Bolton Middle School:

Boiler Room: 3 sq. ft. previous encapsulation delaminating needs

bridging.

Custodial Office: 1 sq. ft. exposed piping.

1 sq. ft. exposed seam.

Hallway/Storage 2 sq. ft. previous encapsulation delaminating needs

(N. of boiler room) bridging.

Weight Room: 1 sq. ft. damaged Hard Fitting.

1 sq. ft. exposed seam.

West Linn High School:

Boiler Room: 3 sq. ft. exposed boiler insulation with debris.

2 sq. ft. exposed cold water piping.

Willamette Primary:

Elect. Room Below Cafe: 1 sq. ft. exposed Hard Fitting.

Inza R. Wood:

Kitchen Supply Closet: 2 sq. ft. damaged Hard Fittings.

Should you have questions or comments, please contact me at your convenience.

Respectfully submitted,

Jeff Smith

Three Rivers Environmental

AHERA

Periodic Surveillance Report

for

WEST LINN-WILSONVILLE SCHOOL DISTRICT 3JT

WEST LINN HIGH SCHOOL

5464 West "A" Street West Linn, OR

Project No. 1020-12

August 1997

Prepared by

P.O. Box 216 Gladstone, Oregon 97027 (503) 557-2396

Page #: 1 of 1

TRE Job#: 1020-12 Client: West Linn School District

Campus: West Linn High School Address: 5464 West "A" Street

Building: Music

Date of Surveillance: August 1997

Person Conducting Surveillance: Glenn Bryant

Material Description: Vinyi Floor Tile Homogeneous area(s): HK USA #99

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Signature <u>JB.</u>

Page #: 1 of 1

TRE Job#: 1020-12 Client: West Linn School District

Campus: West Linn High School Address: 5464 West "A" Street

Building: Shop

Date of Surveillance: August 1997

Person Conducting Surveillance: Glenn Bryant

Material Description: Transite Siding Homogeneous area(s): HK USA #98

Last Material Condition: Good

New Material Description: Same

Change in material condition:

No

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #99 Last Material Condition: Good N

New Material Description: Same

Change in material condition:

No

jnature <u>GB</u>.

Page #: 1 of 5

Client: West Linn School District TRE Job#: 1020-12

Campus: West Linn High School

Building: Main Address: 5464 West "A" Street

Date of Surveillance: August 1997

Person Conducting Surveillance: Glenn Bryant

Material Description: Boiler/Tank Insulation/Mechanical Insulation

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Gasket

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

***aterial Description: Low Pressure Steam/MJP on Pipe Covering

mogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition:

Material Description: Domestic Hot Water/MJP on Corrugated Pipe Cover

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #01

' ast Material Condition: Good New Material Description: Same

lange in material condition:

Page #: 2 of 5

Client: West Linn School District TRE Job#: 1020-12

Campus: West Linn High School Building: Main

Address: 5464 West "A" Street Date of Surveillance: August 1997

Person Conducting Surveillance: Glenn Bryant

Material Description: Boiler/Tank Insulation

Homogeneous area(s): HK USA #02

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/MJP on Corrugated Pipe Covering

Homogeneous area(s): HK USA #02

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #02

ist Material Condition: Good New Material Description: Same

nange in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #03

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #04

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Pipe Covering

Homogeneous area(s): HK USA #05

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/MJP on Pipe Covering

Homogeneous area(s): HK USA #06

Last Material Condition: Good New Material Description: Same

Change in material condition: No

.aterial Description: Domestic Cold Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #07

Last Material Condition: Good New Material Description: Same

Page #: 3 of 5

Client: West Linn School District TRE Job#: 1020-12

Campus: West Linn High School Building: Main

Address: 5464 West "A" Street Date of Surveillance: August 1997

Person Conducting Surveillance: Glenn Bryant

Material Description: Domestic Cold Water/MJP on Corrugated Pipe Covering

Homogeneous area(s): HK USA #08

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Acoustical Thermal Plaster

Homogeneous area(s): HK USA #11

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #50

ist Material Condition: Good New Material Description: Same

hange in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #50

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #52

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #53

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #54

Last Material Condition: Good New Material Description: Same

Change in material condition: No

.aterial Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #55

Last Material Condition: Good New Material Description: Same

Page #: 4 of 5

Client: West Linn School District TRE Job#: 1020-12

Campus: West Linn High School Building: Main

Address: 5464 West "A" Street Date of Surveillance: August 1997

Person Conducting Surveillance: Glenn Bryant

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #56

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #57

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #58

st Material Condition: Good New Material Description: Same

mange in material condition: No

Material Description: Domestic Cold Water/MJP on Corrugated Pipe Covering

Homogeneous area(s): HK USA #59

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Pipe Covering

Homogeneous area(s): HK USA #60

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/MJP on Pipe Covering

Homogeneous area(s): HK USA #61

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #97

Last Material Condition: Good New Material Description: Same

Change in material condition: No

...aterial Description: Transite Siding Homogeneous area(s): HK USA #98

Last Material Condition: Good New Material Description: Same

Page #: 5 of 5

Client: West Linn School District TRE Job#: 1020-12

Campus: West Linn High School Building: Main

Address: 5464 West "A" Street Date of Surveillance: August 1997

Person Conducting Surveillance: Glenn Bryant

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #99

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #99

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Transite Siding mogeneous area(s): HK USA #98

ist Material Condition: Good New Material Description: Same

Change in material condition: No

Signature 53

AHERA

Periodic Surveillance Report

for

WEST LINN-WILSONVILLE SCHOOL DISTRICT 3JT

WEST LINN HIGH SCHOOL

5464 West "A" Street West Linn, OR

Project No. 1020-10

February 1997

Prepared by

P.O. Box 216 Gladstone, Oregon 97027 (503) 557-2396

Page #: 1 of 1

Client: West Linn School District TRE Job#: 1020-10

Campus: West Linn High School Building: Music

Address: 5464 West "A" Street Date of Surveillance: Feb. 1997

Person Conducting Surveillance: Glenn Sutherby

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #99

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Signature

Page #: 1 of 5

Client: West Linn School District TRE Job#: 1020-10

Campus: West Linn High School Building: Main

Address: 5464 West "A" Street Date of Surveillance: Feb. 1997

Person Conducting Surveillance: Glenn Sutherby

Material Description: Boiler/Tank insulation/Mechanical Insulation

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Gasket

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #01

ast Material Condition: Good New Material Description: Same

Jhange in material condition: No

Material Description: Domestic Hot Water/MJP on Corrugated Pipe Cover

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Page #: 2 of 5

lient: West Linn School District TRE Job#: 1020-10

Campus: West Linn High School Building: Main

Address: 5464 West "A" Street Date of Surveillance: Feb. 1997

Person Conducting Surveillance: Glenn Sutherby

Material Description: Boiler/Tank Insulation

Homogeneous area(s): HK USA #02

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/MJP on Corrugated Pipe Covering

Homogeneous area(s): HK USA #02

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #02

Last Material Condition: Good New Material Description: Same

Thange in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #03

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #04

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Pipe Covering

Homogeneous area(s): HK USA #05

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/MJP on Pipe Covering

Homogeneous area(s): HK USA #06

Last Material Condition: Good New Material Description: Same

Change in material condition: No

aterial Description: Domestic Cold Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #07

Last Material Condition: Good New Material Description: Same

Page #: 3 of 5

lient: West Linn School District TRE Job#: 1020-10

Campus: West Linn High School Building: Main

Address: 5464 West "A" Street Date of Surveillance: Feb. 1997

Person Conducting Surveillance: Glenn Sutherby

Material Description: Domestic Cold Water/MJP on Corrugated Pipe Covering

Homogeneous area(s): HK USA #08

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Acoustical Thermal Plaster

Homogeneous area(s): HK USA #11

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #50

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #50

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #52

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #53

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #54

Last Material Condition: Good New Material Description: Same

Change in material condition: No

'aterial Description: Low Pressure Steam/Pipe Covering

...omogeneous area(s): HK USA #55

Last Material Condition: Good New Material Description: Same

Page #: 4 of 5

Hient: West Linn School District TRE Job#: 1020-10

Campus: West Linn High School Building: Main

Address: 5464 West "A" Street Date of Surveillance: Feb. 1997

Person Conducting Surveillance: Glenn Sutherby

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #56

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #57

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #58

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/MJP on Corrugated Pipe Covering

Homogeneous area(s): HK USA #59

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Pipe Covering

Homogeneous area(s): HK USA #60

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/MJP on Pipe Covering

Homogeneous area(s): HK USA #61

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #97

Last Material Condition: Good New Material Description: Same

Change in material condition: No

1aterial Description: Transite Siding Homogeneous area(s): HK USA #98

Last Material Condition: Good New Material Description: Same

Page #: 5 of 5

lient: West Linn School District TRE Job#: 1020-10

Campus: West Linn High School

Building: Main

Address: 5464 West "A" Street

Date of Surveillance: Feb. 1997

Person Conducting Surveillance: Glenn Sutherby

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #99

Homogeneous area(s): HK USA #99
Last Material Condition: Good N

New Material Description: Same

Change in material condition: No

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #99

Last Material Condition: Good

New Material Description: Same

Change in material condition:

tion: No

Material Description: Transite Siding Homogeneous area(s): HK USA #98

Homogeneous area(s): HK USA #98

Last Material Condition: Good New Material Description: Same

`hange in material condition:

No

Signature

Page #: 1 of 1

Client: West Linn School District TRE Job#: 1020-10

Campus: West Linn High School

Building: Shop

Address: 5464 West "A" Street

Date of Surveillance: Feb. 1997

Person Conducting Surveillance: Glenn Sutherby

Material Description: Transite Siding Homogeneous area(s): HK USA #98

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #99

Homogeneous area(s): HK USA #99
Last Material Condition: Good N

New Material Description: Same

Change in material condition:

No

Signature

AHERA

Periodic Surveillance Report

for

WEST LINN-WILSONVILLE SCHOOL DISTRICT 3JT

WEST LINN HIGH SCHOOL

5464 West "A" St. West Linn, OR

Project No. 1020-08

January 1996

Prepared by

170 E Arlington Gladstone, Oregon 97027 (503) 656-4601

THREE RIVERS ENVIRONMENTAL

PERIODIC SURVEILLANCE REPORT

Page #: 1 of 5

Cilent: West Linn School District TRE Job#: 1020-08

Campus: West Linn High School

Bullding: Main

Address: 5464 West "A" Street Date of Surveillance: Jan. 1996

Person Conducting Surveillance: Jeff Smith

Material Description: Boiler/Tank Insulation/Mechanical Insulation

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Gasket

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #01

hast Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/MJP on Corrugated Pipe Cover

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #01

Last Material Condition: Good New Material Description: Same

THREE RIVERS ENVIRONMENTAL

Client: West Linn School District

PERIODIC SURVEILLANCE REPORT

Page #: 2 of 5

TRE Job#: 1020-08

Campus: West Linn High School

Building: Main

Address: 5464 West "A" Street

Date of Surveillance: Jan. 1996

Person Conducting Surveillance: Jeff Smith

Material Description: Boiler/Tank Insulation

Homogeneous area(s): HK USA #02

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/MJP on Corrugated Pipe Covering

Homogeneous area(s): HK USA #02

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #02

Last Material Condition: Good

New Material Description: Same

Change in material condition:

No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #03

Last Material Condition: Good

New Material Description: Same

Change in material condition:

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #04

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/Pipe Covering

Homogeneous area(s): HK USA #05

Last Material Condition: Good

New Material Description: Same

Change in material condition:

No

Material Description: Domestic Hot Water/MJP on Pipe Covering

Homogeneous area(s): HK USA #06

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/Corrugated Pipe Covering

Aomogeneous area(s): HK USA #07

Last Material Condition: Good New Material Description: Same Change in material condition: No 170 E. Arlington Gladstone, Oregon 97027 (503) 656-4601

THREE RIVERS ENVIRONMENTAL

Client: West Linn School District

PERIODIC SURVEILLANCE REPORT

Page #: 3 of 5

TRE Job#: 1020-08

Campus: West Linn High School

Building: Main

Address: 5464 West "A" Street Date of Surveillance: Jan. 1996

Person Conducting Surveillance: Jeff Smith

Material Description: Domestic Cold Water/MJP on Corrugated Pipe Covering

Homogeneous area(s): HK USA #08

Last Material Condition: Good New Material Description: Same

Change in material condition:

Material Description: Acoustical Thermal Plaster

Homogeneous area(s): HK USA #11

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #50 Last Material Condition: Good N

New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #50

Last Material Condition: Good New Material Description: Same

Change in material condition:

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #52

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #53

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #54

Last Material Condition: Good New Material Description: Same

Change in material condition: No

Viaterial Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #55

Last Material Condition: Good New Material Description: Same

Change in material condition: No 170 E. Arlington Gladstone, Oregon 97027 (503) 656-4601

ENVIRONMENTAL

Client: West Linn School District

PERIODIC SURVEILLANCE REPORT

Page #: 4 of 5

TRE Job#: 1020-08

Campus: West Linn High School

Building: Main

Address: 5464 West "A" Street

Date of Surveillance: Jan. 1996

Person Conducting Surveillance: Jeff Smith

Material Description: Low Pressure Steam/Pipe Covering

Homogeneous area(s): HK USA #56

Last Material Condition: Good

New Material Description: Same

Change in material condition:

Material Description: Low Pressure Steam/MJP on Pipe Covering

Homogeneous area(s): HK USA #57

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/Corrugated Pipe Covering

Homogeneous area(s): HK USA #58

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Material Description: Domestic Cold Water/MJP on Corrugated Pipe Covering

Homogeneous area(s): HK USA #59

Last Material Condition: Good

New Material Description: Same

Change in material condition:

Material Description: Domestic Hot Water/Pipe Covering

Homogeneous area(s): HK USA #60

Last Material Condition: Good

New Material Description: Same

Change in material condition: No

Material Description: Domestic Hot Water/MJP on Pipe Covering

Homogeneous area(s): HK USA #61

Last Material Condition: Good New Material Description: Same

Change In material condition: No

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #97

Last Material Condition: Good New Material Description: Same

Change in material condition:

'faterial Description: Transite Siding -Aomogeneous area(s): HK USA #98

Last Material Condition: Good New Material Description: Same

Change in material condition: No 170 E. Arlington Gladstone, Oregon 97027 (503) 656-4601

THREE RIVERS ENVIRONMENTAL

Client: West Linn School District

PERIODIC SURVEILLANCE REPORT

Page #: 5 of 5

TRE Job#: 1020-08

Campus: West Linn High School

Building: Main

Address: 5464 West "A" Street

Date of Surveillance: Jan. 1996

Person Conducting Surveillance: Jeff Smith

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #99

Homogeneous area(s): HK USA #99 Last Material Condition: Good N

New Material Description: Same

Change in material condition: No

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #99

Last Material Condition: Good

New Material Description: Same

Change in material condition:

No

Material Description: Transite Siding Homogeneous area(s): HK USA #98

Last Material Condition: Good

New Material Description: Same

Change in material condition:

No

Signature



Page #: 1 of 1

TRE Job#: 1020-08

Campus: West Linn High School

Client: West Linn School District

Building: Music

Address: 5464 West "A" Street

Date of Surveillance: Jan. 1996

Person Conducting Surveillance: Jeff Smith

Material Description: Vinyi Floor Tile Homogeneous area(s): HK USA #99

Last Material Condition: Good

New Material Description: Same

ENVIRONMENTAL

PERIODIC SURVEILLANCE REPORT

Page #: 1 of 1

Client: West Linn School District TRE Job#: 1020-08

Campus: West Linn High School

Building: Shop

Address: 5464 West "A" Street

Date of Surveillance: Jan. 1996

Person Conducting Surveillance: Jeff Smith

Material Description: Transite Siding Homogeneous area(s): HK USA #98

Last Material Condition: Good

New Material Description: Same

Change in material condition:

Material Description: Vinyl Floor Tile Homogeneous area(s): HK USA #99

Last Material Condition: Good

New Material Description: Same

RECORDKEEPING (Asbestos Removal Activity/Response Action Recordkeeping)

This section reflects requirements outlined in 40 CFR 763.91 & 763.94 (d) (e) (f) (g) (h)

The following subsections contain this required information

• Flow charts to determine adequate response actions

• Operations & Maintenance (<3 sq. ft. or <3 ln. ft.)

• Small scale/short duration (>3 sq. ft. or 3 ln. ft.) or (>40 ln. ft. or 80 sq. ft.)

ACTION: All asbestos-related activities must be recorded.

TRAINING: LEA Designate must ensure that program is enacted and maintained.

FORMS: Understand how to use all the recordkeeping forms.

The purpose of the record-keeping system is three-fold:

-- To ensure maximum protection of all persons in the building.

-- To provide detailed, retrievable records of all events.

- To provide the needed records in event of a law suit.

In essence, the AHERA regulations required that everything done with regards to asbestos in a facility must be documented by the facility's owner so that the training and exposure of all persons involved in the work can be documented and the fate of all ACBM can be determined.

The recordkeeping requirements described in 40 CFR 763.94 are quite explicit in regards to the LEA's recordkeeping responsibilities. Although some records are required to be kept up to six years, they may be required beyond six years (as long as 20 to 40 years) in the event of a law suit. Thus, all records should be maintained in a retrievable state for up to 40 years (or let's just say don't ever throw them away).

Location: Records must be kept in the administrative offices of both the actual building and the LEA. If these are in the same building, it is advisable that a duplicate set of records should be established in a different location in the event of fire or other damage.

The following activities or occurrences require detailed documentation. A brief description is given here. Refer to the appropriate TAB number in the management Plan for exact AHERA requirements and sample forms for compiling information. Narratives of pertinent record keeping data and tab locations.

Tab 10	Response Actions Selected: records of all preventative measures, major abatement activities.
Tab 8	Periodic Surveillance: conducted at a minimum of six-month intervals to determine any damage or deterioration of ACBM.
Tab 9	Reinspection: conducted every three years by an accredited inspector.
Tab 11	Operations and Maintenance: initial, periodic and emergency cleanings; minor and major fiber release episodes; maintenance procedures for ACBM.

RECORDKEEPING (Asbestos Removal Activity/Response Action Recordkeeping)

Tab 5

Medical Surveillance: annual examination of any person who will contact ACBM in their work. Keep

copies of examination forms.

Tab 5

Training: 2-hour awareness training for all custodial staff, 14 hours additional for those who will disturb ACBM; recommended annually.

MEMO FOR THE RECORD

Under CFR 40 763.94 and 763.85 (b) (l)

Records of abatement, surveys, inspections and reinspection may be archived and maintained in a centralized location in the administrative office.


All inspection activities and/or asbestos abatement records prior to the May/June 19953-year Inspection are stored in a large box in the Asbestos Program Manager's office or some other designated location.

OPERATIONS & MAINTENANCE (<3 Sq. feet or 3 ln. feet)

SMALL SCALE (>3 sq. feet or 3 ln. feet) (<40 ln. feet or 80 sq. feet)

FAX NO. : 503 693 7221

Apr. 12 2000 08:25AM P2



9 PAGES

ASN-3

QUARTERLY REPORT FORM USED WITH THE ANNUAL NON-FRIABLE AND FRIABLE NOTIFICATIONS

For DEQ use only
tate Received
roject Number

Instructions: This form is used in conjunction with Department of Environmental Quality (DEQ) Form ASN-2 and ASN-7 (Annual Notice of Intent to remove smaller friable asbestos projects and annual notice of Intent to remove non-friable asbestos projects). This form is used to summarize the projects done using these plans. This Report shall only apply to projects where the scope of each removal does not exceed 40 linear or 80 square feet of friable asbestos removal or for non-friable projects being performed by a School, College, or Facility or where a contractor is performing this work for a School, College, or a Facility. Large friable asbestos removal projects may not be subdivided to accommodate this size limitation.

	Due Dates: (per OAR 340-032-5630)	2 nd Quarter due April 15 2 2 nd Quarter due July 13		rter due October 15 rter due January 15	
ontractor,	Facility Owner, School	Rep. IRS Environment	al of Oregon,	Inc. Phone. 693-	6388
arter and Cal	lendar Year for this Report	1 st Qtr: X 2 st Qtr:	3 rd Qtr:	4 th Qtr:Ye	ar:
iling Addres	s: 755 SW Dennis Av	enue, Hillsboro, Oreg	on	Washington County	97123 Zo
	Spect or PO Bo	(City	Сошну	Zış
ithet Parson:	Bruce Korum	Title:	President	Phone:69	3-6388
list the non- er side. Uyo 8788	-friable asbestos removal project ou need to report more projects.	stos removal projects (40 linear of its that you performed at a School, make copies of the back side of the PORTLANO	College, or Facility his form	ss) that you performed during the quarter. (More be	ig the quarter. oxes are on the
		ale		DUCT PAPER	
		41466	Certi	fication No: 08787	
					_
ane of Wor	rker Doing Non-Ifinble Removal	100			·
	rker Doung Non-Stinble Removal riable aspestos removed:	Lie-	5F. 9		· · · · · · · · · · · · · · · · · · ·
unousi of Fr	riable asbestos removed:	Liv. Square Footage:	5F	zar to date.	
Amount of Fr Amount of N Qt The	riable ashestos removed: on-friable Ashestos Removed: sestions? Contact the DE DEQ Ashestos Control Section	Lie-	e number of you SEND IT TO:	r local DEQ regional o	ffice.
Amount of Framount of No	riable ashestos removed: on-friable Ashestos Removed: sestions? Contact the DE DEQ Ashestos Control Section	Square Footage: Q at 1-800-452-4011 for the SIGN THIS FORM AND at 2020 SW 4th, Ste. 400, Portlant is Northwest region must send this	e number of you SEND IT TO:	r local DEQ regional of FAX to (\$03) 229-5265, or Western Regional DEQ o	ffice.

Jun 06 00 12:50p Three Rivers Env (503)557-3025 p.5

FROM : IRS ENVIRONMENTAL	FAX NO. : 503 693 7221	Apr.	12 2000 08:26AM	Ρ
FRUM : 185 ENUTRONMENTAL	FMX NU. 1 000 000 (664	, ,,-, .		

5864	
Job site address: 2313 SWI ATNOCA PORGLANCE	:64
Description of Facility: ILESIDENCE	Type of Asbesios: VIN4C
Project start date. 3-26-05	Completion date: 3 220 - 00
Name of Certified Worker ROBERT NOVAL	Certification No. OB'794
Name of Worker Doing Non-friable Removal:	·
Amount of Friable asbestos removed: LF: 75	SF
	Year to date:
8862	
Tob site address: 5464 WEST A 57, WEST	(LINA)
	Type of Asbestos: PIDOR TILE & DERRIS
Project start date: 3-33-00	Completion date: 3-22-00
Name of Certified Worker:	Certification No: 08594
Name of Worker Doing Non-Griable Removal: VINCE C	
Amount of Friable asbestos removed: LF:	
	Year to date:
Annual Assessment Asse	15/1/10 04/10
S877 Job site address: 735 SW STARK, PORTL	A-N-10
	Type of Asbestos: PIPE INSULATION
	Completion date: 3-22-00
	Certification No: OSS94
Name of Worker Doing Non-friable Removal:	
Amount of Frinble asbestos removed: LF: 23	
· · · · · · · · · · · · · · · · · · ·	Year to date:
SBBS Jub site address: 7000 SW WILSON AUE 1	
Description of Facility SCHOOL- 4 lighland Hirk	
	Completion date: 3.37-00
Name of Certified Worker: 20N C+IA-PC	Certification No. CYS (8 1
Name of Worker Doing Non-friable Removal:	
Amount of Friable asbestos removed: LF:	SF:
Amount of Non-friable Asbestes Removed: Square Footage	Year to date:
୪ ଟେ ୮	
Job site address: 6300 SW NICOL RD PORTL	ONA.
Description of Facility 604-1001	Type of Ashestos. FITTINGS
Project start date: 3-37-00	Completion date: 3:27:00
	Certification No: 03787
Name of Worker Doing Non-friable Removal:	
Amount of Friable ashestos removed: LF: 10	SF:
Amount of Non-frieble Asbestos Removed: Square Footage:	Year to date:

Job Location: WEST KINN MIGH SCHOOL Floor: MAIN /	<u>Bosen</u>
Project: REMOUAL of 18 HARD Fiftings	
For pipe provide: Total linear feet 1841 and pipe size 2" f /	
For other materials provide: Total square feet:	
Type of ACM: 75/	
Start Date: 3-8-00 Completion Date: 3-8-00	,
Methods to Control Emissions: Glove Bay, Wet METHOD, HASH VAC.	
Give name of Contractor of Subcontractor:	
Name: TS/	<u> </u>
Address: 13600 N.E. 10th AUBNUE	
City: Vancouvel State: WA. Zip: 98	<u> 185</u>
Phone: 30/574-8400 Contact person: Dane N Lin W	'atts
Name of Monitoring Lab: ————————————————————————————————————	
Anticipated Disposal Site: Hillsboro Kand Fill, Hilloboro O.	<u>Z</u>
Supervisor in charge of job: Tesse James	
Cert. #: Exp. Date: Phone:	····
Asbestos Program Manager: Tim Woodkey	·
Training date: Exp. date: Phone:	
O&M (less than 3 ln. 3 sq. ft.)	
S Small scale	
☐ Large scale	

Attach pre-abatement and post-abatement air sample results

ASBESTOS ABATEMENT SUMMARY Project #: 1020 - 100

Job Location: WEST LIDE HIGH SCHOOL FIGOR: MAIN, WOOD SHOP FOY
Project: PATCH & REPAIR UATREMOUAL REINCAPSULATION
TSI HARD FITINGS
For pipe provide: Total linear feet 8 and pipe size 2"
For other materials provide: Total square feet: 20
Type of ACM: UNYL FLOOR TILE MASTIC, TSI MAG HARD FITHINGS
Start Date: 3-22-00 Completion Date: 3-22-00
Methods to Control Emissions: WET METHODS, HEAR UAC.
Give name of Contractor of Subcontractor.
Name: IRS OF ENVIORNMENTAL OF OREGON
Address: 755 SW DENNIS AUENUE
City: HILLSBORD State: 0P. Zip: 97123
Phone (503) 693-6388 Contact person: BUCE KORUM
Name of Monitoring Lab: THREE RIVERS EWIDRUMENTAL JUC.
Anticipated Disposal Site: HILLS BORD LANDFILL
Supervisor in charge of job: VIUCE CHAUEZ
Cert. #: 08594 Exp. Date: 06-02-00 Phone: 693-6388
Asbestos Program Manager: TIM WOODLEY
Training date: Exp. date: Phone:
O&M (less than 3 ln. 3 sq. ft.)
Small scale

Attach pre-abatement and post-abatement air sample results

Large scale



CLIENT: West Linn-Wilsonville School District TRE JOB NO: 1020-100

ATTN: Tim Woodley

P.O. NO: Verbal

CONTRACTOR: I.R.S. Environmental

REPORT NO: 6

PROJECT: West Linn High School

PAGE NO: 1 OF 1

Cafeterial library, wood shop foyer, patch & repair, removal TSI reincapsulation

SampleIDNx 1	Sample IDNox 2	SampleiDNox B1	SampleiDNo:
Laboratory.No. RM00-0064	LaboratoryNo. RM00-0065	LaboratoryNor RM00-0066	Laboratory Nox RM00-000
Sample Location: Felipe T. Tellez 534-23-9827 EL	Sample Location: Felipe T. Tellez 534-23-9827 P	Sample Location Blank	Sample Location: Blank
WorkPerformed Patch & Repair	WorkPerformed Patch & Repair	WorkPerformed	WorkPerformed:
1/2 Face	1/2 Face	N/A	N/A
Date Sampled 3/22/00	Date-Samplect 3/22/00	DateSampled: 3/22/00	DateSampled: 3/22/
Sampled by: R. Montgomery	Sampledby: R. Montgomery	Sampled by: R. Montgomery	Sampledby: R. Montgome
PampNox LV-09	PumpNix LV-09	Ритр Ма	PumpNix N
Start Time: 07:30	StartTime: 08:10	StartTime: N/A	StartTime: N
Stop Time: 08:00	Stop Time: 08:40	Stop Tiene: N/A	Step Time: N
MinutesSampled: 30	MinutesSampled 30	MinutesSampled N/A	MinutesSampled: N
Start FlowRate: (LPM) 2	Start Flow Rate (LPM) 2	Start Flow Rate: (LPM) N/A	Start Flow Rate: (LPM) N
StopFlowRate (LPM) 2	StopFlowRate (LPM) 2	StopFlowRate (LPM) N/A	StopFlowRate:(LPM) N
Average How Rate (LPM) 2	Average FlowRate (LPM) 2	Average How Rate (LPM) N/A	AverageFlowRate(LFM) N
Voltame 60 L	Volume: 60 L	Volume N/A L	Volume N/A L
Date Analyzect 3/22/00	DateAnalyzed 3/22/00	DateAnalyzed 3/22/00	DateAnalyzed 3/22/
Graticule Field Area: 0.00817	Graticule Field Area 0.00817	Gasticule Field Area 0.00817	GraticuleFieldArea 0.008
Total Fibers 1/100	Total Fibers: 1/100	Total Fibers 0/100	Total Fibers: 0/1
Coefficient of Variation: LOD	Coefficient of Variation: LOD	Coefficient of Variation: N/A	Coefficient of Variation: N
Fibas/cc 0.0079 f/ee	Fibes/cc 0.0079 f/cc	Fibers/or N/A f/ee	Fibers/cc: N/A f/

Abbreviations

AP-Ateasample priortoabatement, AD-Ateasample during abatement, C-Clearance, P-Personal sample from breathing zone, EL-Excussion limit, NAE-Negative aire draust, PA-postabatement areasample, BG-Background, LQQ-Limit of Quantification, LCD-Limit of Detection

Comments:

Analyzedby: Robert Montgomery

THREE RIVERS ENVIRONMENTAL

PROJ. No: 1030-100

DATE: 3-30-00 Pg. 1 of 2

See air monitoring reports of this date V

ASBESTOS PROJECT CHECKLIST

PROJECT NAME: WEST LIND HIGH S	CHOOL,	THEET	PROJ. MGR: BORET C. MOUTGON	१द्दर्भ
VIUYL PATCH REPAIR, REMOVAL, T. PLINCADSULKTION	SI MARD		ON SITE: 0700 OFF SITE:	0920
OWNER PROVIDED ON-SITE CONTAC	CT:		CONTRACTOR: IRS EUUDENM	ENTAL
NAME:			SUPERVISOR: VINCE CNAVE 2	
Intent to remove ACM on site and complete Date Pre-abatement samples taken:	te?	<u> </u>	PERSONNEL & METHODS	CORRECTION REQUIRED NO YES
Disposal site HILL SROED LAWNS	LL, HIL	<u> </u>	WORKER PROTECTION ADEQUATE: PERSONAL AIR MONITORS USED: PROTECTIVE CLOTHING:	() ()
AREA ISOLATION	CORRECT REQUIE NO	=	PERSONNEL USING DECON: EQUIP. MAINTAINED PROPERLY: WEITING, PRIOR & DURING: EXCESSIVE DEBRIS:	0 27 0
BARRICADES & SIGNS: AIRLOCKS: COVERINGS ON FLOORS & WALLS: NON-MOVABLE EQUIP. COVERED: ALL OPENINGS SEALED:	() M/A () M/A () M/A () M/A () M/A	0 0 0 0 0	BAGGING OPERATION: NEGATIVE AIR ADEQUATE: DECON ADEQUATE: CLEAN ROOM ADEQUATE: SHOWER FILTERED AND ADEQUAT Respiratory Protection in use:	7
AIR HANDLING EQUIP. OFF/SEALED	* :	()	1/2 Face (*) Full Face () PAPR () Ty	pe C()

PROJECT MANAGEMENT LOG

0700! ABATEMENT CREW, CONSISTING OF VINCE CHAVEZ FELIPE
TO TELLEZ AID MILUSL TOLLEZ ARE ON SITE AND PREMIEDING
TO PATCH ! KEDAIR THE NUMEROUS AREAS OF FLOOR TILE WHICH ARE
Nomber.
DESS: TREW FINISHED WITH SHEET VINYL REPAIR AND HAS
MOUED DUER TO THE WOOD SHOP. AFTER OPENING
UP THE CEILING WE DISCOUERED (1) HIF WHICH WAD FALLEN
DEF (WHICH WAS FORMATLY INSTITUTED AND PRAGES) A TOTAL OF 9 HF
WERE LIGOUSEEN ALL WERE REINCHPIVLATEN WITH A THICK COAT
OF JORY PAINT-AFRE MISTING WITH WATER
0900: THE CREW HAS ADOUT FINISHED.
NA MILLA
SIGNATURE TO LEEVE MARGOLICA
52-6-12
COBIET C. MONTOMERY

THREE RIVERS ENVIRONMENTAL

PROJ. No: 1030 - 100

DATE: 300 \to Pg. 2 of 2

See air monitoring reports of this date

PROJECT MANAGEMENT LOG

09151	DURING THE REPAIR WORK WE DISCOVERED THAT THE ORIGINA
	FLOOR TILE WAS COUCHED UP IDITH PLYWOOD AND SHEET
<u> </u>	
<u></u>	THE CREW HAS FINISHED AND IS PREPARING TO DEMOROLIZE
	ANN HEAD OVER TO STAFFORD.
0998	SET WALLERATED HO JOCKY
	SET UT AND CALLARATED AUTHORITIES
/	
0930.	() TAREIED
·	
	
-	
·· <u>·</u>	
	·
	6
_	
·	
	
<u> </u>	
	· · · · · · · · · · · · · · · · · · ·
	
	

SIGNATURE POLICE SUPERINES

ASBESTOS ABATEMENT SUMMARY Project #: 1020-25 104

Job Location: W. L. W.	SD. WL. 48	Floor: Bose ment
Project: PRMOND of	U NF.	
For pipe provide: Tot	tal linear feet <u>6 w. 47.</u>	and pipe size 1 52"
For other materials provide	e: Total square feet:	
Type of ACM: 78/		
Start Date: 3-9-00	Com	pletion Date: 3-9-00
Methods to Control Emiss	ions: Chove Bry, Hep	apletion Date: 3-9-00
Give name of Contractor of		
Name: Key 8/16	me Confracting	
Address: 417	NW 209 th	
	State: Wh	
Phone:	Contact pers	on:
Name of Monitoring Lab:	TRA.	
	Hillsboron Com	1 Fize
Supervisor in charge of jo	b: Bob Censt	
	Exp. Date: 4-00	Phone:
Asbestos Program Manage	er: Tim Weadley	
Training date:	Exp. date:	Phone:
O&M (less than 3	In. 3 sq. ft.)	
Small scale		
☐ Large scale		

Attach pre-abatement and post-abatement air sample results



CLIENT: West Linn-Wilsonville School District TRE JOB NO: 1020-104

ATTN: Tim Woodley

P.O. NO: Verbal

CONTRACTOR: Keystone Contracting

Removal of 6 hard fittings

REPORT NO: 1

PROJECT: West Linn High School

PAGE NO: 1 OF 2

Sample IDNo 1	Sample IDNo 2	SampleIDNo: 3	Sample IDNor
LaboratoryNo: IJ00-0049	LaboratoryNix IJ00-0050	LaboratoryNo: IJ00-0051	LaboratoryNo: IJOO-00
Sample Location 10' N. of S. wall of mechanical room AD	Sample Location 6' S. of entrance to mechanical room AD	Sample Location Bob Craft 568-15-4649 P	Sample Location: Blank
WorkPerformed N/A	Work Performed N/A	WorkPerformed Glovebag 1/2 face	WorkPerformed: N/A
Date Sampled: 3/9/00	Date Sampled 3/9/00	Date Sampled: 3/9/00	Date Sampled: 3/9/
Sampledby: I. Jones	Sampled by: I. Jones	Sampledby: I. Jones	Sampled by: I. Jon
PumpNo HV-23	PumpNa HV-22	PampNix LV-03	PumpNox N
Start Time 16:30\	StartTime 16:30	StartTime 16:55	Start Time: N
StopTime: 18:30	StopTime 18:30	Stop Time: 17:25	Stop Time: N
MinutesSampled: 120	Minutes Sampled: 120	Minutes Sampled 30	Minutes Sampled: N
Start Flow Rate: (LPM) 10	Start How Rate: (LPM) 10	Start Flow Rate: (LPM) 2	Start Flow Page (LPM) N
StopFlowRate: (LPM) 10	Stop Flow Rate: (LPM) 10	Stop Flow Rate: (LFM) 2	StopFlowRate (LPM) N
Avenge How Rate (LPM) 10	Average Flow Rate (LPM) 10	Average How Rate (LPM) 2	Average How Rate: (LPM) N
Volume 1200 L	Volume 1200 L	Volume 60 L	Volume N/A L
Date Analyzect 3/9/00	Date Analyzed 3/9/00	Date Analyzect 3/9/00	Date Analyzed 3/9/0
Graticule Field Area 0.00817	Graticule Field Area 0.00817	Gizticule Fieldi Auez 0.00817	Grzticule Field Arex 0.008
Total Fibers 12/100	Total Fibess 7/100	Total Fibers 1.5/100	Total Fibers: 0/1
Coefficient of Variation: 0.59	Coefficient of Variation: LOQ	Coefficient of Variation: LOD	Coefficient of Variation: N
Fibers/cc: 0.0047 f/cc	Fibes/cc <0.0039 f/ee	Fibers/cc: 0.012 f/ce	Fibers/cc: N/A

Abbreviations

AP-Areasample prior to abatement, AD-Areasample during abatement, CClearance, P-Personal sample from breathing zone, EL-Excussion limit, NAE-Negative air exhaust, PA-post abatement areasample, BG-Background, LOQ-Limit of Quantification, LOD-Limit of Detection

Comments < Sample calculated at Limit of Quantification (10 fibers/100 fields)

Analyzed by: Irvin Jones



CLIENT: West Linn-Wilsonville School District TRE JOB NO: 1020-104

ATTN: Tim Woodley P.O. NO: Verbal

CONTRACTOR: Keystone Contracting

REPORT NO:

PROJECT: West Linn High School

Removal of 6 hard fittings

PAGE NO: 2 OF 2

Sample IDN x B2	Sample IDN a	Sample IDNo:	Sample IDNa
Laboratory No. IJ00-0053	Laboratory No:	LaboratoryNo	Laboratory No.
Sample Location Blank	SampleLocation	Sample Location:	Sample Location:
Work Performed N/A	Work Performed	Work Performed:	Work Performed
Date Sampled 3/9/00	Date Sampled	Date Sampled:	Date Sampled:
Sampled by: I. Jones	Sampled by:	Sampled by:	Sampled by:
PumpNix N/A	PumpNix	PumpNix	PampNa
StartTime: N/A	Start Time:	Start Time:	Start Time:
Stop Time: N/A	StopTime	ScopTime	Stop Time:
MinutesSampled: N/A	MinutesSampled	MinutesSamplect	Minutes Sampled
Start Flow Rate: (LPM) N/A	Start How Rate: (LPM)	Start Flow Rate: (LFM)	Start How Rate: (LPM)
Stop Flow Rate: (LPM) N/A	Stop Flow Rate (LPM)	Stop Row Rate: (LPM)	Stop How Rate: (LPM)
Average Flow Rate (LPM) N/A	AveageHowRate (LPM)	Average Flow Rate (I.PM)	Average Flow Rate: (LPM)
Volume N/A L	Volume: L	Volume: L	Volumer L
Date Analyzed: 3/9/00	Date Amilyzed:	Date Arelyzech	Date Analyzect
Genicale Field Asex 0.00817	Gasticule Field Arex	Graticule Field Area	Chaticale Field Area
Total Fibers 0/100	Total Fibers	Total Fibers:	Total Hibers:
Coefficient of Variation N/A	Coefficient of Variation:	Coefficient of Variation:	Coefficient of Variation:
Fibers/cc: N/A f/ee	Fibers/cc: f/ee	Fibers/cc: f/cc	Fibers/cc f/e

NAE Negative aire charact, PA-post abatement are a sample, BG-Background, LCQ Limit of Quantification, LOD-Limit of Detection

Comments

Analyzed by: Irvin Jones THREE RIVERS
ENVIRONMENTAL

PROJ. No: 1020-104	
DATE: 6-9-00 Pg. 1 of	1
See air monitoring reports of this date	

VISUAL INSPECTION REPORT

PROJECT NAME: W.L. H.S.	PROJ. MANAGER:	Irvin James
OWNER PROVIDED ON-SITE CONTACT: NAME: John (Custod) and LEA DESIGNATE:		OF MECH. RM ARRA (6 HF
CONTRACTOR: KEYSTONE CONTRACTING	 ;	
SUPERVISOR: BOB CRAFT DISPOSAL SITE: HULS BORD LANDFILL	REGULATED Negative Pressure End	REQUIRED
Regu	lated Area:	G: () CON: () A/A () QUATE: () EQUATE: () A/A () ATE: () A/A () ATE: () A/A ()
Dispo	osable Coveralls: ()	() -1221 () -13F- O ()
Time of Inspection:	PASS: \\Z FAII	L: 🗆
VISUAL INSPECTION LOG (List any exceptions debris, location of debris found, containment integrity, excessive 1) HAO STUERAL SPOTS TO RECLEAN 2)	airborne encapsulant, damaged	luding; visible l areas, etc.)
THREE RIVERS ENVIRONMENTAL representative converts area (as mentioned above) and verifies that the in his knowledge and belief, has found no asbestos contains the second	nspection has been thourd ining dust or debris. _ () - \ () /	n inspected the specific ugh and to the best of

Reportby:

Project Log

CLIENT: W.L.W. S.D.

ATTN: Tim Woodkey Contracting

PROJECT: W.L. M.S. 6 HF RRMOUNTE

TRE JOB NO: 1020 -

PURCHASE ORDER NO:

REPORT DATE:

PAGE NO: / OF W

1310	Contreter BY FRANCE OF "PIPING THEATTON
	OF THE HALD FITTINGS, I (INW JONES of TRE) / SO
	Him I Women BR There To Look of it.
1325	TRE (TENIN JONE) ARRIVED AT WASTLIND HICK School Met With Frank Jacked HT HE IN
	Machinish IXA AND ISLO HIM WA Would Allange
1336	WITH JERRY HOLDSON (WA.W.S.O.) TO INFORM HER OF OUR INTENTION CONTRACTOR (NEW TONE CONTRACTOR CREW YOUR SONT A
1490	PAPER WEAK COMPLETED FOR Job.
1515	BEB CRAFT Keystere Contracting ARRIVED BY TRE
7540	TRA & Keystone Deponted For W. L. HS.
1605	ARRIVED AT W. L. H.S.
1615	SET UP Chove BRS AND things For Job
1430	Coph: bi sted NU-229 NU-22 5 Grated Songles
1640	Seol. HAD HIS SLAF Them. HThomphe To
1103	34 STARIBO Chave Brigging.
Não	HARD Fifting Removely More 10 From MP
1710	Regione on Brent
1710	Keystone Londing hanipment.
1000	Reystone OFF 3.70.
83>	CARBRATE HURS 5 HU-22 Stepped Somphe 152

ENVIRONMENTAL

Project Log

CLIENT: W.L. W.S.A.

ATTN: Tim Woodkiy

CONTRACTOR: Key store Continuing
PROJECT: WL HS
L HP REMOUNDE

PURCHASE ORDER NO:

REPORT DATE:

PAGE NO: ZOF Z

1840		Damobilizad.
845	BKL	Elsurgenest off Ste
953	Conto	retal John (Custoelina).
1902		OFF SITE,
	····	
		

ASBESTOS ABATEMENT SUMMARY Work Order No.: /0 20-87

Job Location: WEST LION HIGH SCHOOL Floor: BASEMENT.
Project: TSI REMOVAL COACHES OFFICE
For pipe provide: Total linear feet 5' / IMF and pipe size 2" For other materials provide: Total square feet:
Type of ACM:
Start Date:
Methods to Control Emissions: Containment of Caiticals, WET MEDIO
Give name of Contractor of Subcontractor:
Name: 123.12C
Address: 19645 SE SUNNY SIDE Rd. 1860
City: BORING State: OREGON Zip: 97009
Phone: 658-6606 Contact person: JULIANNA
Name of Monitoring Lab: THREE RIVES REVUERMENTAL
Anticipated Disposal Site: NOR THERN WASCO CO. LAND FILL.
Supervisor in charge of job: Rodrieurz, Lizaura
Project Manager: IRUIN Jones
Name: IRUM Forms Date: 11-11-99 Phone: 557-2386
Asbestos Program Manager:
Name: Tim Woolsky Date: 11-11-99 Phone: 673-7041

Attach pre-abatement and post-abatement air sample results

THREE RIVERS ENVIRONMENTAL, Inc.

Air Sample Analysis Report

CLIENT: West Linn-Wilsonville School District TRE JOB NO: 1020-82

ATTN: Tim Woodley P.O. NO: Verbal

CONTRACTOR: Insulation Removal Corp. REPORT NO: 1

PROJECT: West Linn High School PAGE NO: 1 OF 1

Coaches office

SampleIDNa 1	Sample IDNo: 2	Sample IDNox B1	Sample IDNo: B2
LaboratoryNox IJ99-0421	LaboratoryNo: IJ99-0422	LaboratoryNo: IJ99-0423	LaboratoryNio. IJ99-0424
Sample Location E. end of coaches office BG	Sample Location: At door of coaches office outside door BG	Sample Location: Blank	Sample Location Blank
WorkPerforment N/A	WorkPerformed N/A	WorkPerformed: N/A	WorkPerionned: N/A
Date-Sampled 11/11/99	Date-Sampled: 11/11/99	Date Sampleri 11/11/99	Date Sentiplect 11/11/9
Sampledby: I. Jones	Sampled by: I. Jones	Sampled by: I. Jones	Sampledby: I. Jone
PumpNia HV-03	PumpNa HV-09	PumpNo: N/A	PumpiNo: N/A
StartTime: 15:25	StartTime 15:25	StartTime: N/A	Start Time: N/A
Stop Time: 17:33	StopTime: 17:33	Stop Time: N/A	Stop Time: N/A
MinutesSamplect 128	MinutesSampled: 128	MinutesSampled N/A	MinutesSampled: N/A
Start How Rate (LPM) 10	Start Flow Rate (LPM) 10	Start Flow Rate: (LPM) N/A	Start How Rate (LPM) N/A
Stop Flow Rate: (LPM) 10	StopFlowRate (LFM) 10	StopPlowRate (LPM) N/A	Stop Flow Rate (LPM) N/A
Average How Rate: (LPM) 10	Average Flow Rate (LPM) 10	Average Flow Rate: (LPM) N/A	Average How Rate (LPM) N//
Volume 1280 L	Volume: 1280 L	Volume: N/A L	Volume N/A L
Date Analyzeck 11/11/99	DateAnalyzed 11/11/99	DateAnalyzed: 11/11/99	DateAnalyzed 11/11/9
Graticule Field Area: 0.00817	GraticuleFieldArea 0.00817	GraticuleFieldArea 0.00817	GraticuleFieldArea: 0.0081
Total Fibers: 7/100	Total Fibers 5/100	Total Fibers: 0/100	Total Fibers: 0/10
Coefficient of Variation: LOO	Coefficient of Variation: LOO	Coefficient of Variation N/A	Coefficient of Variation: N/A

Abbreviations

AP-Areasample prior to abatement, AD-Areasample during abatement, C-Clearance, P-Personal sample from breathing zone, EL-Excursion limit, NAE-Negative air exhaust, PA-post abatement areasample, BG-Background, LOQ-Limit of Quantification, LOD-Limit of Detection

Comments < Sample calculated at Limit of Quantification (10 fibers/100 fields)

Analyzedby: Irvin Jones

THREE RIVERS
ENVIRONMENTAL

PROJ. No: 1020 -82
DATE: 11-11-99 Pg. 1 of
See air monitoring reports of this date

ASBESTOS PROJECT CHECKLIST

PROJECT NAME: WEST LINN HIGH School	PROJ. MGR: Jones, Irvin
	ON SITE: 1455 OFF SITE: 1755
OWNER PROVIDED ON-SITE CONTACT: NAME: Gary (Janifor)	CONTRACTOR: 1RC SUPERVISOR: Rooleieu; 7, 412 Auro.
Intent to remove ACM on site and complete? Date Pre-abatement samples taken: Disposal site: North, and Masco (O. L. And Fill)	PERSONNEL & CORRECTION REQUIRED NO YES WORKER PROTECTION ADEQUATE: (*) () PERSONAL AIR MONITORS USED: (*) ()
AREA ISOLATION CORRECTION REQUIRED	PROTECTIVE CLOTHING: () () PERSONNEL USING DECON: () () () EQUIP. MAINTAINED PROPERLY: () WETTING, PRIOR & DURING: ()
BARRICADES & SIGNS: AIRLOCKS: COVERINGS ON FLOORS & WALLS: NON-MOVABLE EQUIP. COVERED: ALL OPENINGS SEALED: AIR HANDLING EQUIP. OFF/SEALED: () () ()	EXCESSIVE DEBRIS: () BAGGING OPERATION: () NEGATIVE AIR ADEQUATE: () DECON ADEQUATE: () CLEAN ROOM ADEQUATE: () SHOWER FILTERED AND ADEQUATE: () Respiratory Protection in use: 1/2 Face (X) Full Face () PAPR () Type C ()
PROJECT MANA	GEMENT LOG
1455 TRE. ARRIVED ON SITE. CO HAD BOTH GATES UNLOCKED.	ONTACTED CONSTRUCTION.
1525 CALIBRATRO HU-03 & H	10-09, STARTED SAMALES 1/2
1535 IRC ON SITE. Rodric BANDELIO WORKER-	uiz, Lizauro Supervison. Gonzale.
1544 IRC STARTED SAT U	ρ,
	in Know we would BE working
1607 CHECK ON HEO GRESS. 1	7% Complete WITH CRITICALS.
	SIGNATURE: Charles

THREE RIVERS ENVIRONMENTAL

PROJ. No: 1020- 82 DATE: //~11-99 Pg. 2 of See air monitoring reports of this date []

PROJECT MANAGEMENT LOG

1630 -	PHEIN To S	ED BAL	S. AND O	CATTIONS	EVERYTHINI	15 600	d, READY
140-		, ,	- START	·			
17/8 -	PB 6	TMEN	Tons	LATE.			
17,9 -	/N3	P& 710. \$48.5.7	- Rock	Rete (Broken)	Uncured	Tops of	CelliNL).
1733		DKIBR	BTED	HU- 03	3 5 11 11-09	STOPPI	ED SAMPLE 1: 2
1739	- (2 LBAN	UP	ComPLE.	ን ፩ .		
1750 -					OFFS		
1755		TRB.	OFF	SITE	hocked	Two	Cares)
			······································		· 		
			······································				
	·						
	<u></u>	 					
· · · · · · · · · · · · · · · · · · ·							
		···		·			
	<u></u>		···				2
-			· · · · · · · · · · · · · · · · · · ·				

SIGNATURE: didle



INVOICE

Billed To:

Project Name/Location

Three Rivers Environmental

West Linn High School 5464 West A Street

P.O. Box 216

West Linn, OR 97068

Gladstone, OR 97027

invoice #

10808

Your Job/P.O.#

Invoice Date 10/31/99

Due Date

Description

11/30/99

Our Job#

5384.00

Details

Glovebag Pipe Insulation 16-29-99

Quantity Units

Price **Amount**

Asbestos Abatement Services As Quoted

1.00 Each

740,0000

740.00

Net Invoice Amount

\$740.00

Terms: Net 30. A service charge of 1.5% will be assessed on all past due accounts. APR is 18%. Minimum service charge is

Page #

1

ASBESTOS ABATEMENT SUMMARY Work Order No.: 1020-80

Job Location:_	West Linn High Sch	<u>ool</u>	Flo	or: <u>lst</u>	
Project:	Removal of approxim	mately 2:	5' of TSI & 5 hard fi	ttings	
	······································		· · · · · · · · · · · · · · · · · · ·		
For pipe provi	de: Total linear fo	eet	aı	nd pipe size	4"
For other mate	erials provide: Total	squaref	eet:		
Type of ACM	TSI				
Start Date:	10-29-99		_ Completion	n Date:10)-29-99
Methods to Co	ontrol Emissions:	Enclos	sure (glove bags & F	HEPA vac)	····
Give name of	Contractor of Subcon	tractor:			
Name:	Insulation Re	moval C	orporation		
Addre	ss: <u>19645 S.E. S</u>	Sunnysid	e Rd.		
City: _	Boring		State: Oregon	Zi	p: <u>97009</u>
Phone	(503) 658-6608		Contact person:	JulieAnn	Α
Name of Moni	itoring Lab:	Three	Rivers Environmen	tal, Inc.	
Anticipated D	isposal Site:	North	ern Wasco County L	andfill	
Supervisor in	charge of job:	Lizau	o C. Rodriguez		
Project Manag	er <u>:</u>				
Name:	Irvin Jones	Date:	10-29-99	Phone:(50	03) 557-2396
Asbestos Prog	ram Manager:	W	est Linn-Wilsonville	School Distri	ct3Jt
Name:	Joe Simmons	Date:_	10-29-99	Phone:(<u>5</u>	03) 673-7013

Attach pre-abatement and post-abatement air sample results

West Linn-Wilsonville School District TRE JOB NO: 1020-80

ATTN: Tim Woodley P.O. NO: Verbal

CONTRACTOR: Insulation Removal Corp. REPORT NO:

PROJECT: West Linn High School PAGE NO: 1 OF 2

TSI & H.F. Pipe Insulation Rmvl.

Sample IDNo. 1	Sample IDNo: 2	Sample IDNox 3	SampleIDNix B
LahonatonyNo IJ99-0416	LaboratoryNo: 1J99-0417	Labradory No. 1J99-0418	LaboratoryNix 1J99-041
Sample Location S.W. corner of mezzanine BG	Sample Location: Center of containment AD	Sample Location S.W. corner of mezzanine AD	Sample Location Blank
WorkPerformed N/A	WorkPerformed: N/A	WorkPerformed N/A	WorkParformed N/A
DateSampled 10/29/99	DateSampled: 10/29/99	DateSumplect 10/29/99	Date Sampled 10/29/9
Sampled by: I. Jones	Sampledity. I. Jones	Sampledby: I. Jones	Sampled by: I. Jone
PumpNia HV-23	PumpNa HV-22	PumpNa HV-23	PumpNo N/A
Stant Firme: 19:00	Start Time: 20:20	StartTime: 21:00	Start Time: N/A
Stop Time: 21:00	Stop Time: 22:20	Stop Time: 22:30	Stop Time: N/A
MinutesSampled: 120	MinutesSampled: 120	MinutesSampled 90	MinutesSampled: N/A
StartHowRate (LFM) 10	Stant.FlowRate (LPM) 10	StautFlowRate (LPM) 10	Start Flow Rate (LPM) N/A
StopFlowRater(LPM) 10	StepFlowRater(LPM) 10	StopFlowRate (LPM) 10	Stop Flow Rate: (LFM) N/A
Average Flow Rate: (LPM) 10	Average-How Rate (LPM) 10	Average-FlowRate: (LFM) 10	AverageRowRate (LPM) N//
Volume: 1200 L	Volume 1200 L	Volume: 900 L	Volume N/A L
Date:Analyzest 10/29/99	Date Analyzed 10/29/99	Date:Analyzect 10/29/99	Date Analyzed 10/29/9
GraticuleFieldArea: 0.00817	GaziculeFieldArex 0.00817	GazticuleFieldArea 0.00817	Ginticulei Field Area 0.0081
Total Fibers 8/100	Total Fibers 9.5/100	Total Fibers: 5.5/100	Total Fibers: 0/10
Coefficient of Variation: LOQ	Coefficient of Variation LOQ	Coefficient of Variation: LOQ	Coefficient of Variation: N/A
Fibers/cc: <0.0039 f/ce	Fibers/oc: <0.0039 f/ce	Fibers/cc: <0.0052 f/cc	Fibersic: N/A f/e

NAE-Negative air exhaust, PA-postabatement areas ample, BG-Background, LOQ-Limit of Quantification, LOD-Limit of Detection

Comments < Sample calculated at Limit of Quantification (10 fibers/100 fields)

Analyzedby: Irvin Jones



West Linn-Wilsonville School District TRE JOB NO: 1020-80

Tim Woodley ATTN:

P.O. NO: Verbal

CONTRACTOR: Insulation Removal Corp. REPORT NO:

PROJECT: West Linn High School

PAGE NO: 2 OF 2

TSI & H.F. Pipe Insulation Rmvl.

ampleIDNox B2	SampleIDNox	Sample IDN x	Sample IDNo:
aboratory.No: 1J99-0420	Laboratory.No:	LaboratoryNo	LaboratoryNox
kimple Location Blank	Sample Location	Sample Location:	Sample Location:
Work/Performed N/A	WorkPerformed	WorkPerformed	WorkPerformed
Date Sampled 10/29/99	DateSampled	DateSampled	DateSampled
kingledby: I. Jones	Sampled by:	Sampled by:	Sampled by:
numpNa N/A	Pumpi Vo	PumpNo	Pump No:
entTime: N/A	Start Time:	Start Time:	Start Time:
topTime: N/A	Stop Time:	Stop Time:	Stop Time:
finatesSampled N/A	MinutesSampled	MinutesSampled:	MinutesSampled:
ant Flow Rate: (LPM) N/A	Start Flow Rate (LPM)	Start How Rate: (LP!M)	Stant How Rate: (LPM)
topFlowRate (LPM) N/A	StopFlowRate (LPM)	Stop-Flow Rate (LPM)	StopFlowRate (LPM)
verageFlowRate (LPM) N/A	AvezageHowRate (LPM)	Avenge HowRate (LPM)	Average Flow Rate: (LPM)
otame N/A L	Volume: L	Volume: L	Volume L
nie:Amilyzed 10/29/99	DateAnaliyzed	Date:Anellyzed	Date Analyzect
raticuleFieldArea: 0.00817	Graticule Field Avea	Ciraticule Field Area	GraticuleFieldArea
otal Fibers: 0/100	Total Fibers:	Total Fibers:	Total Fibers:
cefficient of Variation: N/A	Coefficiental Variation:	Coefficient of Variation:	Coefficient of Variation:
ibers/oc: N/A f/cc	Fibers/cc: f/ee	Fibers/cc: f/ec	Fibers/cc f/e

NAE-Negativeairrexhaust, PA-postabatementareasample, BG-Background, LOQ-Limit of Quantification, LOD-Limit of Detection

Comments

Analyzedby: Irvin Jones



PROJ. No: 1020-80	_
DATE: 10-29-99 Pg. 1 of 1	
See air monitoring reports of this date	

VISUAL INSPECTION REPORT

PROJECT NAME: WEST LINN HIGH SCHOOL	PROJ. MANAGER:	FRUIN JONE	5	
N. E. CORNER OF GYM. (MEZERNINE) OWNER PROVIDED ON-SITE CONTACT: NAME: JOHN DAILY LEA DESIGNATE: TIM WOODLEY	AREA OF INSPECTION (Location of Containment N.E. MEZONINE "STEAM A	nt)	Flace	Aces.
CONTRACTOR: INSULATION REMOUAL CORPORATION		<u> </u>		
SUPERVISOR: LEZAURO C. RODRIGUEZ DISPOSAL SITE: NORTHERN WASCO COUNTY	<u>REGULATEI</u>	O AREA	CORREC REQUII	
LAND FILL	Negative Pressure En	closure: 🔲	NO	YES
PRE ABATEMENT SAMPLE RESULTS:	PERSONAL AIR MONIT PROTECTIVE CLOTHIN PERSONNEL USING DE	1G:	8) 8) () N/A	() () ()
(If Applicable) DATE:	EXCESSIVE DEBRIS: ENCAPSULATION ADE CRITICAL BARIERS AS	-	& . & .	()
ANALYTICAL RESULTS: PCM TEM	NEGATIVE AIR ADEQU DECON ADEQUATE:	JATE:	() M/A () N/A	()
SAMPLE NO. RESULTS (FIBERS/CC or STRUCTURES)	CLEAN ROOM ADEQU SHOWER FILTERED AI		() M/A () M/A.	()
Regula Respir	al Protective Euuipmen ted Area: ator: 1/2 Face (x) Full F able Coveralls: (x)			
Time of Inspection:	ASS: 🖾 FAI	L: 🗀		
VISUAL INSPECTION LOG (List any exceptions for debris, location of debris found, containment integrity, excessive air one 'S" Spot of 181 on 4" PIPE, was che	und during this inspection in rborne encapsulant, damage	d areas, etc.)		
THREE RIVERS ENVIRONMENTAL representative cer work area (as mentioned above) and verifies that the ins his knowledge and belief, has found no asbestos contain	pection has been thour			
NAME: IRUN JONES SIGNATUR	E Shingfore			

THREE RIVERS
ENVIRONMENTAL

PROJ. No: 1020-80
DATE: /0-29-99 Pg. / of
See air monitoring reports of this date

IRUIN JONES

ASBESTOS PROJECT CHECKLIST

PROJECT NAME: WEST LINN HIGH SCHOOL	PROJ. MGR: _ ININ JONES
	ON SITE: 1752 OFF SITE:
OWNER PROVIDED ON-SITE CONTACT: NAME: JOHN ONLY	CONTRACTOR: INSULATION REMOVAL CORPORATION SUPERVISOR: LIZAURO C. Rock: GUEZ
Intent to remove ACM on site and complete? Date Pre-abatement samples taken: NA. Disposal site: No AT HORAL WASCO COUNTY AREA ISOLATION CORRECTION REQUIRED NO YES BARRICADES & SIGNS: AIRLOCKS: COVERINGS ON FLOORS & WALLS: NON-MOVABLE EQUIP. COVERED: ALL OPENINGS SEALED: AIR HANDLING EQUIP. OFF/SEALED: O A COMMENT OF SEALED: AIR HANDLING EQUIP. OFF/SEALED: O A COMMENT OF SEALED: O A COMMENT OF S	PERSONNEL & REQUIRED METHODS NO YES WORKER PROTECTION ADEQUATE: () PERSONAL AIR MONITORS USED: () PROTECTIVE CLOTHING: () PERSONNEL USING DECON: () EQUIP. MAINTAINED PROPERLY: () WETTING, PRIOR & DURING: () EXCESSIVE DEBRIS: () BAGGING OPERATION: () NEGATIVE AIR ADEQUATE: () DECON ADEQUATE: () CLEAN ROOM ADEQUATE: () SHOWER FILTERED AND ADEQUATE: () Respiratory Protection in use: 1/2 Face (2) Full Face () PAPR () Type C ()
	ILE. LIZAURO RODRIGUEZ
1737: IRC & TRE (IRUIN JON) INVIRONMENTAL OFFICE, HIGH SCHOOL. 1752: IRC & TRE BERLUED FI 1755: IRC & TRE DISCUSSED S	TN ROWER TO WEST LINN
. •	SIGNATURE: \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \

ENVIRONMENTAL

Project Log

CLIENT: W.L. W. S.Q 357

ATTN: TIM WOODLEY

TRE JOB NO:/020-80

PURCHASE ORDER NO:

CONTRACTOR: /RC

REPORT DATE:

PROJECT: WESTLIAN HIGHSChool PAGE NO: ZOF 2 AB HF & PIPE INSULATION REMarks

1840:	TRE BROUGHT BOUIPMENT INTO SCHOOL TWO HU-PUMPS
	ONE MICROSCOPE ONE QUICK FIX. ZO 20 MM CASSETTS FROM
	TWO GETENSION CORDS.
19 <i>9</i> 0	CALIBRATED HU-23 STARTED SAMPLE # 1 SW CORNER
2010	CONTAINMENT COMPLETE. GLOUE BAGS HUNG. READY TO START. ABOTMENT. IRC ON BREAK. TRECHECKED GLOUE BAGS LOOKS GOOD.
2020	IRC BACK FROM BREAK READY TO START ABATEMENT.
2020	CALIBRATED MU-ZZ STARTED SAMPLE#2 CENTER OF CONTAINMENT.
2022	PEROXEMENTLY 25 OF PIPE INSULATION.
2100	CALIBRATED HU-Z3. STOPPED SAMPLE # 1, STRATED SAMPLE #3 SAME LOCATION AS SAMPLE #1.
2110	ABOUT 70% LOMPLETIE.
2/45	ABATEMENT COMPLETE. CLEAN UP COMMENCING.
22/5	ABATMENT LOOKS GOOD COMMONCING CLEANUP.
2230	CLEAN UP COMPLETE.
रहऽऽ	IRC OFF SITE.
2242	TRE OFF SITE.
2303	TRE (IRUIN JOHES) AT TRE OFFICE
······································	

FULL SCALE (>40 ln. feet or 80 sq. feet)

ASBESTOS ABATEMENT SUMMARY Work Order No.: 1020-45

Job Location: WEST LINN SCH	00L	Floor: BOILER RM. BUSEMENT
Project: GLOVE BAG OF TSI	IN BOILER RM	AND BOYSLOCKER RM,
ABATEMENT OF MASTIC.	IN BOILER ROO	<u>m</u>
For pipe provide: Total linear fe	et 24 0 LN FT	and pipe size 4 "
For other materials provide: Total s	square feet: 40 sa	FT
Type of ACM: 751, SURF.		
Start Date: <u>MAY 7 1999</u>	Comp	letion Date: MAY 21, 1999
Methods to Control Emissions: (o)	UE BAG, WET	METHODS, HEAR VACCUUMN
Give name of Contractor of Subcontra	ractor:	
Name: KEYSTONE Co		wc.
Address: 417 NW 2	09th ST.	
City: RIDGEKIELD		zip: <u>98642</u>
Phone (360) 887-086	S Contact perso	n: LARRY TINGLEY
Name of Monitoring Lab: TH RE	E RIVERS E	UVIDENMENTAL
Anticipated Disposal Site: HILL	SBORD LANDF	ILL, HILLSBORD OR.
Supervisor in charge of job: <u>BoB</u>	CRAFT, ROD	Stensaud
Project Manager: Mall John St	ON, ROBER	T MONTGOMERY
Name:	Date: MAY, 7th, 18	1 21 st Phone: (603) 557-2396
Asbestos Program Manager: 102		· · · · · · · · · · · · · · · · · · ·
Nama	Doter	Phone (503) 638-8869

Attach pre-abatement and post-abatement air sample results



West Linn-Wilsonville School District TRE JOB NO: 1020-45

ATTN:

Joe Simmons

P.O. NO: Verbal

CONTRACTOR: Keystone Contracting, Inc. REPORT NO:

PROJECT: West Linn High School

Patch & Repair-Locker Room

PAGE NO: 1 OF 2

SampleIDNo: 1	SampleIDNox 2	SampleIDNo: 3	Sample:IDNo:
LaboratoryNox RM99-0256	LaboratoryNo RM99-0257	LahomoryNix RM99-0258	Laboratory No. RM99-0
Sample Location: 20' SE of W. double doors, boy's locker room AD	Sample Location 40' N. of E. ramp entrance, boy's locker AD	Sample Location Dale Dean 519-94-1112 FL	Sample Location: Blank
WorkPerforment N/A	WorkPerformed N/A	WorkPerformed TSI Glovebag 1/2 face	WorkPerformed: N/A
DateSampled: 5/21/1999	DateSampled: 5/21/1999	DateSamplest 5/21/1999	DateSampled 5/21/1
Sampledby: R. Montgomery	Sampledby: R. Montgomery	Sampled by: R. Montgomery	Sampled by: R. Montgor
PumpNo HV-09	PumpNia HV-03	PumpNa LV-05	PumpNix
StartTime: 16:00	StartTime: 16:00	StartTime: 16:45	Start Time:
StopTime: 18:00	StopTime: 18:00	Stop Time: 17:15	Stop Time:
MinutesSampled: 120	MinutesSampled: 120	Minutes Sampled: 30	MinutesSampled:
Start How Rate (LPM) 10	Start Flow Rate: (LPM) 10	StartHowRate (LPM) 2	StartFlowRate (LPM)
Stop Flow Rate (LPM) 10	Stop Flow Rate (LPM) 10	Stop-How Rate (LPM) 2	Stop Flow Rate (LPM)
Average: How Rate (LPM) 10	Average Flow Rate: (LPM) 10	AvezageHowRate (LPM) 2	Average How Rate: (LPM)
Volume 1200 L	Volume 1200 L	Valume 60 L	Volume N/A I
DateAnalyzet 5/21/1999	DateAnalyzed 5/21/1999	Date:Analyzed 5/21/1999	Date Analyzed 5/21/1
Graticule Field Area: 0.00817	GraniculeFieldArea 0.00817	GraticaleFieldArea 0.00817	GraticuleFieldArex 0.00
Total Fibers: 7/100	Total Fibeas: 9/100	Total Fibes: 2.5/100	Total Fibers 0/
Coefficient of Variations LOQ	Coefficient of Variation: LOQ	Coefficient of Variation: LOD	Coefficient of Variation:
Fibers/cc: <0.0039 f/ee	Fibers/cc: <0.0039 f/ee	Fibersicc 0.196 f/cc	Fibers/cc: N/A

NAE-Negativeairexhaust, PA-postabatementareasample BG-Background LOQ Limitof Quantification, LOD Limitof Detection

Comments

Analyzedby: Robert Montgomery



CLIENT: West Linn-Wilsonville School District TRE JOB NO: 1020-45

ATTN: Joe Simmons

P.O. NO: Verbal

REPORT NO:

CONTRACTOR: Keystone Contracting, Inc.

PROJECT: West Linn High School

Patch & Repair-Locker Room

PAGE NO: 2 OF 2

SampleIDNox	B2 S	mpleIDNo:		SampleIDNo:		SampleIDNo:	
LaboratoryNox RM99-0	260 L	aboratory No.		LaboratoryNox		Laboratory No:	
Sample Location: Blank	S	ample Location		Sample Location		Sample Location:	
WorkPerformed: N/A		/orkPerformed:		WorkPerformed		WorkPerforment	
DateSampled: 5/21/1	L 999 [2	nteSampled:		DateSampled		DateSampled	
Sampledby: R. Montgon	nery S	ampled by:	=	Sampled by:		Sampled by:	
PumpNa]	V/A P	ampNcx	=	PumpNo:		PumpNo:	
StartTime:]	V/A S	art Time:		Start There:		Start Time:	
Stop Tiene:	N/A S	opTime:		Stop Time:		Stop Time:	
MinutesSampled:]	N/A	finutesSampled:		MinutesSampled:		MinutesSampled	
Start Flow Rate: (LPM)	V/A S	art RowRate (LPM)		Start How Rate: (LPM)		StartFlowRate (LPM)	1
StopHowRate (I.PM)	V/A S	opFlowRate (LPM)		Stop Flow Rate: (LPM)		StopFlowRate: (LPM)
AverageHowRate (IPM)	N/A A	verageHowRate (LPM	1)	AvezageFlowRate (LPA	A)	Average How Rate: (L	PM)
Valume N/A L	V	olume:	L	Volume	L	Volume	L
Date Analyzed 5/21/1	999 E	ate Analyzect		Date:Analyzed		DateAmilyzed	
Graticule Field Area: 0.00	817	aticuleFieldAæa		GanicaleFieldArea		Graticule Field Area:	
Total Fibers: 0/	100 T	otal Fibers		Total Fibers:		Total Fibers:	
Coefficient of Variation:	V/A	cefficient of Variation:		Coefficient of Variation:		Coefficient of Variatio	OC .
Fibers/cc: N/A 1	f/ce F	lbers/cc:	f/cc	Fibers/cc:	f/ce	Fibers/cc:	f/e

AP-Areasample prior to abatement, AD-Areasample during abatement, C-Clearance, P-Personal sample from breathing zone, EL-Excussion limit NAE-Negative airextraust, PA-postabatement areasample, BG-Background, LOQ-Limit of Quantification, LOD-Limit of Detection

Comments

Analyzedby: Robert Montgomery

ASBESTOS ABATEMENT SUMMARY Work Order No.: 1020 · 닉

	Job Location: LIDEST LIND HIGH SCHOOL Floor: MAIN BLDG, NW WING
	Project: REMOVAL DISPOSAL OF TSI BOILER TANK INS. , TSI LINE INSULATION
В	ACRM FLOOR TILE AND MASTIC AND ACRM WINDOW CASING AND CAULK THROUGHOUT BY'S LOCKER RM, BOILER RM, HVAC MECH SPACE TUNNELS AND ENTIRE NW SECTION OF SEMBOL For pipe provide: Total linear feet 5980 and pipe size 3", 4", 6"
	For other materials provide: Total square feet: 76,700
	Type of ACM: TSI, MISC, SURF,
	Start Date: 22 March 1999 Completion Date: 30 July 1999
	Methods to Control Emissions: FULL CONTAINMENT, WET METHODS, HEPA VACOUM
	Give name of Contractor of Subcontractor:
	Name: PERFORMANCE ABATEMENT SERVICES
	Address: 8015 SW HUNZIKER RA
	City: TIGARD State: ORE. Zip: 97223
	Phone (503) 620-7933 Contact person: MICHAEL STOCKER
	Name of Monitoring Lab: THREE RIVERS ENVIORUMENTAL
,	Anticipated Disposal Site: HILLS BORD LANDFILL, HILLS ROPO OR.
	Supervisor in charge of job: MICHAEL SWAYZE
	Project Manager: MATT JOHNSON, SAMMBLOCK, JOEL SHERIDAN
	Name: Date 32 MAP 30 JUL 99 Phone: (503) 557-2396
	Asbestos Program Manager: JOB SIMMONS
	Name: Date: Phone:503) 638-8869
	Attach pre-abatement and post-abatement air sample results
	SUB-CONTRACTOR:
	PACE CITU CONTINUE TOIC

HOSE CITY CONTRACTIVE INC 8900 SW BURNHAM RD. #E-3 TILARD OP. 97223 (503) 624-6527

THREE RIVERS

ENVIRONMENTAL, Inc.

Air Sample Analysis Report

CLIENT: Rose City Contracting

TRE JOB NO: 1490-12

ATTN:

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO: 1

PROJECT: West Linn High School

PAGE NO: 1 OF 1

SampleIDNo: 1	SampleIDNix 2	SampleIDNo: B1	SampleIDNo: B2
LaboratoryNox JS99-0045	LaboratoryNox JS99-0046	LaboratoryNox JS99-0047	LaboratoryNo. JS99-0048
Sample Location: Luis Reyes 673-92-7401 P	Sample Location Luis Reyes 673-92-7401 P	Sample Location Blank	Sample Location Blank
WorkPerformed Tile 1/2 mask	WorkPedomed Tile 1/2 mask	WorkPerformed N/A	WorkPerformed: N/A
Date-Sarrupled: 6/28/99	DateSampled: 6/28/99	DateSampled 6/28/99	DaseSumpled 6/28/99
Sampled by: Armondo	Sampledby: Armondo	Sampledby: J. Sheridan	Sampledby: J. Sheridan
PumpNix N/A	PumpNa N/A	PumpNa N/A	PumpNa N/A
Start Time: 07:00	StartTime: 12:00	StartTime: N/A	StartTime: N/A
Stop Time 12:00	StopTime: 17:00	StopTime: N/A	StopTime: N/A
MinutesSampled: 300	MinutesSampled 300	MinutesSampled N/A	MinutesSamplect N/A
StartHowRate (LPM) 2.5	StartFlowRate (LPM) 2.5	StartHowRate (LPM) N/A	StartFlowRate (LPM) N/A
StopFlowRate (LPM) 2.5	StopFlowRate (LPM) 2.5	StopFlowRate (LPM) N/A	StopFlowRate (LPM) N/A
Aveage: Flow Rate: (LPM) 2.5	Average How Rate (LPM) 2.5	AverageHowRate (LPM) N/A	Average FlowRate (LFM) N/A
Volume 750 L	Volume 750 L	Volume N/A L	Volume N/A L
DateAnalyzed 7/13/99	Date-Analyzed 7/13/99	DateAnalyzed 7/13/99	DateAnalyzed 7/13/99
Graticule Field Area: 0.00817	GraticuleFieldArea 0.00817	GraticuleFieldArea: 0.00817	GraticuleFieldArea 0.00817
Total Fibras 1/100	Total Fibers 25/100	Total Fibers 0/100	Total Fibers 0/100
Coefficient of Variation: LOD	Coefficient of Variation: 0.44	Coefficient of Variation: N/A	Coefficient of Variation: N/A
Fibersica 0.0063 f/ce	Fiberson 0.016 f/ce	Fibersoc: N/A f/ee	Fiberson N/A f/ee

Abbreviations

AP-Areasomple prior to abovement, AD-Areasomple during abovement, C-Clearance, P-Personal sample from breathing zone, EL-Excusion limit, NAE-Negative airextraust, PA-post abovement areasomple, BG-Background, LCQ-Limit of Quantification, LCD-Limit of Detection

Comments < Sample calculated at Limit of Quantification (10 fibers/100 fields)

Analyzedby: Joel Sheridan

THREE RIVERS ENVIRONMENTAL, Inc.

CLIENT: Rose City Contracting

TRE JOB NO: 1490-12

ATTN:

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO: 2

PROJECT: West Linn High School

PAGE NO: 1 OF I

SampleIDNo: 1	SampleIDNox 2	SampleIDNo: B1	SampleIDNox B2
LaboratoryNix JS99-0049	LaboratoryNo. JS99-0050	Laboratory No. JS99-0048	Laboratory Nix JS99-0049
Sample Location: Luis Reyes 673-92-7401 P	Sample Location: Luis Reyes 673-92-7401 P	Sample Location Blank	Sample Location Blank
WorkPerformed Tile & mastic 1/2 mask	WorkPerformed Tile & mastic 1/2 mask	WorkPerformed N/A	WorkPerformed N/A
DateSarrapked 6/29/99	DateSampled 6/29/99	Date Sampled 6/29/99	DateSampled: 6/29/99
Sampled by: Armondo	Sampledby: Armondo	Sampled by J. Sheridan	Sampledby: J. Sheridan
PumpNox N/A	PrampNcs N/A	PampNa N/A	PumpNo: N/A
Start Time: 07:00	StartTime: 12:00	StartTime: N/A	StartTime: N/A
StopTime: 12:00	Stop Time: 17:00	Stop Time: N/A	Stop Time: N/A
Minutes Sampled: 300	MinutesSampled: 300	MinutesSampled: N/A	MinutesSampled: N/A
Start Flow Rate (LPM) 2.5	Start HowRater (LPM) 2.5	Start How Rate (LPM) N/A	Start Flow Rate (LPM) N/A
StopFlowRate (LPM) 2.5	StopFlowRate:(LPM) 2.5	Stop How Rate (LPM) N/A	StopFlowRate (LPM) N/A
AvezgeHowRate (LPM) 2.5	AverageHowRate (LPM) 2.5	Average Flow Rate: (LPM) N/A	Average Flow Rate (LPM) N/A
Volume 750 L	Volume 750 L	Volume: N/A L	Volume N/A L
Date:Analyzed 7/13/99	DateAnalyzed 7/13/99	Date Analyzed 7/13/99	Date.Analyzeci 7/13/99
Grancule Field Area: 0.00817	GraticuleFieldArex 0.00817	GraticuleFieldArex 0.00817	GraticuleFieldArea 0.00817
Total Fibers: 14.5/100	Total Fibers: 10/100	Total Fibers 0/100	Total Fibers 0/100
Coefficient of Variation 0.55	Coefficient of Variation: 0.63	Coefficient of Variation: N/A	Coefficient of Variation: N/A
Hiberson: 0.0091 f/ce	Fibers/cc 0.0063 f/ee	Fibers/cc: N/A f/ee	Fibersice: N/A f/ce

Abbreviations

AP-Areasomple prioritoalistement. AD-Areasomple during abatement, CK Gearance, P-Personal sample from breathing zone, EL-Fix cursion limit. NAE-Negative directionst. PA-post abatement areasomple, BG-Background LCQ-Limit of Quantification, LOD-Limit of Detection.

Comments

Analyzouby: Joel Sheridan

THREE RIVERS ENVIRONMENTAL Inc.

Air Sample Analysis Report

Rose City Contracting CLIENT:

TRE JOB NO: 1490-12

ATTN:

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO:

PROJECT: West Linn High School

PAGE NO: 1 OF 1

Sample IDNo:	Sample IDNo:	2 SampleIDNix	B1	Sample IDNix	B2
LaboratoryNix JS99-0053	LaboratoryNo: JS99-	0054 Laboratory No.	JS99-0055	LaboratoryNo: JS	399-0056
Sample Location Miguel Tellez 472-37-2902 P	Sample Location Miguel Tellez 472-37-2902 P	Sample Location Blank	:	Sample Location Blank	
WorkPerformed Tile & mastic 1/2 mask	WorkPerformed Tile & mastic 1/2 mask	WorkPerformed N/A		WorkPerformed N/A	
DateSampled 6/30/99	DateSampled 6/3	0/99 DateSampled	6/30/99	DateSampled	6/30/99
Sampled by: Armondo	Sampled by: Arm	ondo Sampledby:	J. Sheridan	Sampled by: J.	Sheridan
PumpNica N/A	PumpNa	N/A PumpNia	N/A	PumpNo:	N/A
StartTime: 07:00	Start Time:	2:00 Start Time:	N/A	StartTime:	N/A
StopTime: 12:00	Stop Time:	7:00 Stop Time:	N/A	Stop Time:	N/A
VinutesSamplect 300	MinutesSampled	300 MinutesSamples	t N/A	Minutes Sampled:	N/A
Stant-HowRate (LPM) 2.5	Start Flow Rate: (LPM)	2.5 Stant Flow Rate: 0	LPM) N/A	Start How Rate (LPM	0 N/A
Stop Flow Rate: (LPM) 2.5	StopFlowRate: (LPM)	2.5 Stop-Row Rate: (LPM) N/A	StopFlowRate (LPM	¹) N/A
Average How Rate: (LPM) 2.5	AverageHowRate (LPM)	2.5 AverageFlowRa	e(LPM) N/A	AverageFlowRate(L	PM) N/A
Volume: 750 L	Volume 750	L Volume 1	V/A L	Volume: N/A	\ L
Date Analyzect 7/13/99	Date Analyzed: 7/	3/99 Dute-Analyzed	7/13/99	Date Amilyzed	7/13/99
Grzácule Field Airezr 0.00817	GraticuleFieldAreat 0.0	0817 GraticuleFieldAr	ea 0.00817	Criticale Field Area:	0.00817
Total Fibers: 14/100	Total Fibers 12.5	700 Total Fibers	0/100	Total Fibers	0/100
Coefficient of Variation: 0.55	Coefficient of Variation:	0.58 Coefficient of Va	atiation: N/A	Coefficient of Variation	on N/A
Fibers/cc: 0.0088 f/cc	Fibers/cc 0.0079	f/cc Fibers/oc N	I/A f/ee	Fibers/cc N/A	f/cc

Comments

Analyzedby: Joel Sheridan

NAE-Negative arrechaust PA-post abutement areas imple, BG-Background, LOQ-Limit of Quantification, LOD-Limit of Detection

THREE RIVERS
ENVIRONMENTAL, Inc.

CLIENT: Rose City Contracting

TRE JOB NO: 1490-12

ATTN: And

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO: 4

PROJECT: West Linn High School

PAGE NO: 1 OF 1

Sample/DNo: 1	SampleIDNox 2	SampleIDNo: B1	Sample/DNo: B2
abonatoryNix JS99-0057	LaboratoryNo: JS99-0058	LaboratoryNo JS99-0059	LaboratoryNox JS99-0060
Angel Barraza 544-27-1222 P	Sample Location: Angel Barraza 544-27-1222 P	Sample Location: Blank	Sample Location Blank
WorkPerformed Tile & mastic 1/2 mask	WorkPerkuned Tile & mastic 1/2 mask	WorkPerformed N/A	WorkPerformed N/A
Date:Sampled: 7/6/99	DateSampled 7/6/99	DateSampled 7/6/99	DateSampled: 7/6/99
Sampled by: Armondo	Sampled by: Armondo	Sampledby: J. Sheridan	Sampledby: J. Sheridan
PumpNo: N/A	PamapNix N/A	PumpNα N/A	PumpNa N/A
StartTime: 07:00	StartTime: 12:00	StartTime: N/A	StartTime: N/A
Stop Time: 12:00	Stop Time: 17:00	SkopTime: N/A	Stop Time: N/A
MinutesSampled: 300	MinutesSampled: 300	MinutesSampled: N/A	MinutesSampled: N/A
StartHowRate (LPM) 2.5	Start Flow Rate (LPM) 2.5	Start Flow Rate (LPM) N/A	Start Flow Rates (LPM) N//
StopHowRate (LPM) 2.5	StopFlowRate:(LPM) 2.5	StopHowRate (LPM) N/A	Stop How Rate (LPM) N//
AverageHowRate (LPM) 2.5	AverageFlowRate (LPM) 2.5	Average:FlowRate:(LPM) N/A	AverageFlowRate (LPM) N/A
Volume 750 L	Volume 750 L	Volume N/A L	Volume N/A L
Date:Analyzed 7/13/99	DateAnalyzed 7/13/99	DateAnalyzed 7/13/99	DateAnalyzed: 7/13/9
Graticulo Field Area: 0.00817	GraticuleFieldArea 0.00817	GizticuleFieldArea 0.00817	GraticuleFieldArea 0.0081
Total Fibers 14.5/100	Total Fibers 16/100	Total Fibers 0/100	Total Fibras: 0/10
Coefficient of Variation: 0.55	Coefficient of Variation: 0.53	Coefficient of Variation: N/A	Coefficient of Variation: N//
Fibers/cc: 0.0091 f/ee	Fibers/cc 0.010 f/ee	Fibers/cc: N/A f/cc	Fibers/cc N/A f/c

Abbreviations:

AP-Areasample priortoalement, AD-Areasampleduring abatement, C-Clearance, P-Personal sample from breathing zone, EL-Excursion limit, NAE-Negative air extraost, PA-postabatement areasample, BG-Background, LOQ-Limit of Quantification, LOD-Limit of Detection

Comments

Analyzedby: Joel Sheridan



CLIENT: Rose City Contracting

TRE JOB NO: 1490-12

ATTN:

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO:

PROJECT: West Linn High School

PAGE NO: 1 OF 1

SampleIDNox 1	SampleiDNo. 2	Sample IDNo: B1	Sample IDNo:
LaboratoryNox JS99-0061	LaboratoryNo JS99-0062	LaboratoryNα JS99-0063	LaboratoryNo: JS99-0
Sample Location Miguel Tellez 472-37-2901 P	Sample Location Miguel Tellez 472-37-2901 P	Sample Location: Blank	Sample Location: Blank
WorkPerformed Tile & mastic 1/2 mask	WorkPerformed Tile & mastic 1/2 mask	WorkPerformed N/A	Wank/Performed N/A
DateSampliedt 7/7/99	Date Sampled 7/7/99	Date:Samplied: 7/7/99	DateSampled: 7/*
Sampled by: Armondo	Sampled by: Armondo	Sampledby: J. Sheridan	Sampled by: J. Sheri
PampNia N/A	PumpNa N/A	PumpNa N/A	Ρυπορίλία]
StartTime: 07:00	StartTime: 12:00	StartTime: N/A	StartTime:]
StopTime 12:00	Stop Time: 17:00	StopTime: N/A	Stop Time:
MinutesSampled: 300	MinutesSampled: 300	MinutesSampled: N/A	Minutes Sampled:
Start Flow Rate: (LPM) 2.5	Start How Rate (LPM) 2.5	Start Flow Rate (LPM) N/A	Start FlowRate (LPM)
StopFlowRate (LFM) 2.5	StopFlowRater(LPM) 2.5	StopPlowRater(LPM) N/A	Stop Flow Rate (LPM)
AverageHowRate:(LPM) 2.5	AverageHowRate (LPM) 2.5	Average FlowRate (LPM) N/A	Average HowRate (LPM)
Volume 750 L	Volume 750 L	Volume N/A L	Volume N/A I
DateAnalyzed: 7/13/99	Date:Analyzed 7/13/99	Date:Anniyzed: 7/13/99	Date:Analyzed 7/13
Graticule Field Area: 0.00817	GraticuleFieldArea: 0.00817	GraticuleFieldArea 0.0081"7	GraticuleFieldArex 0.00
Total Fibers 20/100	Total Fibers 10.5/100	Total Fibers: 0/100	Total Fibers: 0/
Coefficient of Variation: 0.48	Coefficient of Variation: 0.62	Coefficient of Variation: N/A	Coefficient of Variation:
Fibers/cc: 0.013 f/ee	Hbers/on 0.0066 f/ee	Fibers/cc N/A f/cc	Fibers/cc N/A

AP-Areasample prior to abatement, AD-Areasample during abatement, C-Clearance, P-Personal sample from breathing zone, EL-Excursion limit, NAB-Negativeairexhaust, PA-postabatementareasample, BG-Background, LOQ-Limitof Quantification, LOD-Limitof Detection

Comments

Analyzedby: Joel Sheridan

THREE RIVERS ENVIRONMENTAL, Inc.

Rose City Contracting CLIENT:

TRE JOB NO: 1490-12

ATTN:

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO:

PROJECT: West Linn High School

PAGE NO: 1 OF 1

Sample IDNix 1	Sample(DNo. B1	Sample IDN: B2	SampleIDNix 2
Laboratory No. JS99-0065	LaboratoryNo JS99-0066	LaboratoryNo: JS99-0067	LaboratoryNo: *
Sample Location Luis Reyes 673-92-7401	Sample Location Blank	Sample Location Blank	Sample Location Missing
WorkPerformed Tile & mastic 1/2 mask	WorkPerformed N/A	WorkPerformed N/A	Workl'edormed *
DateSampledt 7/8/99	DateSampled 7/8/99	DracSampled: 7/8/99	DateSampled *
Sampled by: Armondo	Sampledby: J. Sheridan	Sampledby: J. Sheridan	Sampled by: *
PumpNia N/A	PampNo N/A	PumpNo N/A	PumpNo: *
StartTime: 07:00	StartTime: N/A	StartTime: N/A	StartTime: *
Stop Time: 12:00	Stop Time: N/A	Stop Time: N/A	Stop Time: *
MinutesSampled: 300	MinutesSampled N/A	MinutesSompled N/A	MinutesSampled: *
StartHowRate (LPM) 2.5	Start Flow Rate (LPM) N/A	StartFlowRate (LPM) N/A	Start How Rate (LPM) *
StopFlowRate (LPM) 2.5	Stop Flow Rate: (LPM) N/A	StopFlowRate (LPM) N/A	StopPlowRate (LP/vi) *
Average Flow Rate: (LPM) 2.5	AverageHowRate (LPM) N/A	AverageHowRate (LPM) N/A	Average Flow Rate (LPM) *
Volume 750 L	Volume N/A L	Volume N/A L	Volume * L
Due Aralyzect 7/13/99	Date-Analyzect 7/13/99	Date Analyzed 7/13/99	Date-Analyzed 7/13/99
Granicuske Field Area: 0.00817	GenticuleFieldArea 0.00817	GraticuleFieldArea 0.00817	GraticuleFieldArea: 0.00817
Total Fibers 17.5/100	Total Fibers: 0/100	Total Fibras 0/100	Total Fibers *
Coefficientof Variation: 0.61	Coefficient of Variation: N/A	Coefficient of Variation: N/A	Coefficient of Variation: *
Fibersoc: 0.011 f/ec	Fiberson N/A f/cc	Fibersycc: N/A f/cc	Fibers'cc * f/ce

Abbreviations

AP-Areasample prior to abatement, AD-Areasample during abatement, C-Clearance, P-Personal sample from breathing zone, EL-Excussion limit. NAE-Negative cirectrust, PA-postabatement areasample, BG-Background, LOQ Limit of Quantification, LOD Limit of Detection

Comments *Sample #2 from 7/8/99 has been lost

Analyzedby: Joel Sheridan

ENVIRONMENTAL Inc.

Air Sample Analysis Report

CLIENT: Rose City Contracting

TRE JOB NO: 1490-12

ATTN:

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO:

PROJECT: West Linn High School

PAGE NO: 1 OF I

SampleIDNa 1	Sample IDNo: 2	SampleIDNo: B1	Sample IDN x B2
Laboratory.No. JS99-0163	LaboratoryNo. JS99-0164	LaboratoryNox JS99-0291	Laboratory No. JS99-0292
Sample Location: Angel Borraza 544-27-1222 P	Sample Location Angel Borraza 544-27-1222 P	Sample I reation Blank	Sample) Contion Blank
WorkPerformed Tile & mastic removal	WorkPerformed Tile & mastic removal	WorkPerformed N/A	WorkPerloamed N/A
DineSumpled 7/9/99	DateSampled 7/9/99	DateSampled: 7/9/99	DateSampled 7/9/99
Sampled by: A. Reyes	Sampled by: A. Reyes	Sampledby: J. Sheridan	Sampledby: J. Sheridan
PumpNia 1	PumpNia 1	Pump Nica N/A	PumpNa N/A
StartTime: 07:00	StartTime: 12:00	StartTime: N/A	StartTime: N/A
Stop Time: 12:00	StopTime: 17:00	Stop Time: N/A	Stop Time: N/A
MinutesSampled 300	MinutesSampled: 300	MinutesSampled: N/A	MinutesSampled: N/A
Start Flow Rate (LPM) 2.5	Stant Flow Rate: (LFM) 2.5	Start How Rate (LPM) N/A	Stant-How Rote (LPM) N/A
StopFlowRate (LPM) 2.5	StopFlowRate (LPM) 2.5	StopFlowRate (LPM) N/A	StopFlowRate (LPM) N/A
Average Flow Rate: (LPM) 2.5	Avenge How Rate (LPM) 2.5	Average Flow Rate (LPM) N/A	Average Flow Rate (LPM) N/A
Volume: 750 L	Volume 750 L	Volume N/A L	Volume: N/A L
Date Analyzed 7/27/99	Date:Annivært 7/27/99	Date Analyzect 7/27/99	Date:Analyzed 7/27/99
Ganticule Field Arex 0.00817	GraniculeFieldArea 0.00817	GraniculeFieldArea 0.00817	GraniculeFieldArea 0.00817
Total Fibers: 7.5/100	Total Fibers: 10.5/100	Total Fibers 0/100	Total Fibers 0/100
Coefficient of Variation: LOQ	Coefficient of Variation: 0.62	Coefficient of Variation: N/A	Coefficient of Variation: N/A
Fibers/cc: 0.0047 f/ce	Fiberson 0.0066 f/ce	Fibasycc N/A f/ce	Fiberson N/A f/ee

Abbreviations:

AP-Areasample prior to abatement, AD-Areasample during abatement, CK-fearance, P-Personal sample from breathing zone, EL-Excussion firmit. NAE Negative airextraust, PA-post abutement area sample, BG-Background, LCQ-Limit of Quantification, LCD-Limit of Detection

Comments < Sample calculated at Limit of Quantification (10 fibers/100 fields)

Analyzedby: Joel Sheridan

ENVIRONMENTAL, Inc.

Air Sample Analysis Report

Rose City Contracting CLIENT:

TRE JOB NO: 1490-12

ATIN:

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO:

PROJECT: West Linn High School

PAGE NO: 1 OF 1

Sample IDNo: j	SampleIDNox 2	SampleIDNo: B1	SampleIDNo: B2
LaboratoryNox JS99-0165	LaboratoryNo: JS99-0166	Laboratory No. JS99-0293	Laboratory No. JS99-0294
Sample Location Miguel Telles 412-37-2901	Sample Location Miguel Telles 412-37-2901	Sample Location Blank	Sample Location Blank
WorkParlamed Tile & mastic removal	WorkParkemed Tile & mastic removal	WorkPerformed: N/A	WorkPerformed: N/A
DateSampled 7/12/99	DateSampled 7/12/99	DateSampled 7/12/99	DateSampled 7/12/99
Sampled by: A. Reyes	Sampledby: A. Reyes	Sampledby: J. Sheridan	Sampledby: J. Sheridan
PampNix 1	PumpNix 1	PumpNa N/A	PumpNa N/A
Start Time: 07:00	StartTime: 12:00	StartTime: N/A	StartTime: N/A
Stop Time: 12:00	Stop Time: 17:00	StopTime: N/A	Stop Time: N/A
A funutes Sampled: 300	MinutesSampled: 300	MinutesSampled: N/A	MinutesSampled N/A
Stant Flow Rate: (LPM) 2.5	Stant Flow Rate (LPM) 2.5	Start Flow Rate: (LPM) N/A	Start, Flow Rate (LPM) N/A
StopFlowRate:(LPM) 2.5	StopFlowRate (LPM) 2.5	StopFlowRate (LPM) N/A	StopFlowRate (LPM) N/A
AverageHowRate (LPM) 2.5	AverageHowRate (LPM) 2.5	Average Flow Rate (LPM) N/A	Average How Rate (LPM) N/A
Volume 750 L	Volume 750 L	Volume: N/A L	Volume N/A L
Date Analyzed 7/27/99	Date Analyzed: 7/27/99	Date:Analyzed 7/27/99	Date Analyzed 7/27/99
Graticule Field Area: 0.00817	GraticuleFieldArear 0.00817	GraticuleFieldArea: 0.00817	Granicule Field Area: 0.00817
Total Fibras 19/100	Total Fibers 14.5/100	Total Fibers 0/100	Total Fibers: 0/100
Coefficient of Variation 0.49	Coefficient of Variation: 0,55	Coefficient of Variation: N/A	Coefficient of Variation: N/A

Abbreviations:

Fiberson:

AP-Areasample prior to abatement. AD-Areasample during abatement. C.C. Carrance, P-Personal sample from breathing zone. EL-Liscours for limit, WAE-Negative airexhaust, PA-post abatement are usample BG-Background LOQ-Limit of Quantification, LOD-Limit of Detection

N/A

f/cc

Fibersoc

N/A

Fibersycc:

Comments

0.012

Analyzedby: Joel Sheridan

Fiberson:

0.0091

f/cc

THREE RIVERS ENVIRONMENTAL, Inc.

Air Sample Analysis Report

CLIENT: Rose City Contracting

TRE JOB NO: 1490-12

ATTN:

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO:

PROJECT: West Linn High School

PAGE NO: 1 OF 1

SampleIDNix 1	SampleIDNix 2	Sample IDNox B1	SampleIDNox B2
LahonatoryNo JS99-0295	LaboratoryNox JS99-0296	LaboratoryNex JS99-0295	Laboratory Nix JS99-0296
Sample Location Miguel Telles 412-37-2901 P	Sample Location Miguel Telles 412-37-2901 P	Sample Location Blank	Sumple Location Blank
WorkPerformed Tile & mastic removal	WorkParformed Tile & mastic removal	WorkPerformed N/A	WorkPerformed N/A
DateSampled: 7/13/99	DateSampled 7/13/99	DateSampled 7/13/99	DateSampled 7/13/99
Sampled by: A. Reyes	Sampledby: A. Reyes	Sampledby: J. Sheridan	Sampledby: J. Sheridan
Рипр Ха 1	PumpNo. 1	PumpNia N/A	PumpNa N/A
StartTime: 07:00	StartTime: 12:00	Sent Turn: N/A	StartTime: N/A
Stop Time: 12:00	Stop Time: 17:00	StopTime: N/A	Stop Time: N/A
MinutesSampled: 300	MinutesSampled: 300	MinutesSampled N/A	Minutes Sampled: N/A
Start How Rate (LPM) 2.5	Start How Rate (LPM) 2.5	Start How Rate (LPM) N/A	Start Flow Rate: (LPM) N/A
StopFlowRate(LPM) 2.5	Stop Flow Rate (LPM) 2.5	StopFlowRate (LPM) N/A	StopHowRate (LPM) N/A
Average Flow Rate: (LFM) 2.5	AverageHowRate (LPM) 2.5	Average Flow Rate (LPM) N/A	Average How Rate (LPM) N/A
Volume 750 L	Volume: 750 L	Volume N/A L	Volume N/A L
Dire Amilyzest 7/27/99	Date Analyzed 7/27/99	Dute-Analyzed 7/27/99	Date Analyzed 7/27/99
Graticule Field Arext 0.00817	GraticuleFieldArea 0.00817	Grazionie Field Area: 0.00817	GraticuleFieldArex 0.00817
Total Fibers 8/100	Total Fibers: 9/100	Total Fibers: 0/100	Total Fibers 0/100
Coefficient of Variation LOQ	Coefficient of Variation: LOQ	Coefficient of Variation: N/A	Coefficient of Variation: N/A
Fibers/cc 0.0050 f/cc	Fiberson: 0.0057 f/ce	Fibersica: N/A f/cc	Fibers/oc: N/A f/ee

Abbreviations

AP-Areasample prior to a batement, AD-Areasample during abatement, C-Clearance, P-Personnal sample from breathing zone, FL-Excursion limit, NAE-Negativesire draust J'A-post abnorment areas ample, BG-Background LOQ-Limit of Quantification, LOD-Limit of Detection

Comments

Analyzedby: Joel Sheridan



Air Sample Analysis Report

CLIENT: Rose City Contracting

TRE JOB NO: 1490-12

ATTN:

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO:

PROJECT: West Linn High School

PAGE NO: | OF |

Sample IDN x [SampleIDNor 2	SampleIDNix B1	SampletDNa B2
LaboratoryNx JS99-0169	LaboratoryNo: JS99-0170	Laboratory No. JS99-0297	Laboratory No. JS99-0298
Sample Location Angel Borraza 544-87-1222 EX	Sample Location Angel Borraza 544-87-1222 P	Sumple Location Blank	Sample Location Blank
WorkPerformed Tile & mastic removal	WorkPerformed Tile & mastic removal	WorkPerformed N/A	WorkPerformed: N/A
DateSampled 7/19/99	DateSampled 7/19/99	DateSampled 7/19/99	DateSampled: 7/19/99
Sampledby: A. Reyes	Sampledby: A. Reyes	Sampledby: J. Sheridan	Sampledby: J. Sheridan
PumpèNa I	PumpNa 1	PumpNia N/A	PunnpNo: N/A
StartTime: 11:30	StartTime: 12:00	StartTime: N/A	StartTime: N/A
Stop Time: 12:00	Stop Time: 16:30	StopTime: N/A	Stop Time: N/A
A finutes Sampled 30	MinutesSampled 270	MinutesSampled: N/A	MinutesSampled N/A
Start Flow Rate (LPM) 2.5	Start Flow Rate (LPM) 2.5	Start How Rate (LPM) N/A	Start Flow Rate (LPM) N/A
StopFlowRate (LPM) 2.5	Stop Flow Rate (LPM) 2.5	StopFlowRate (LPM) N/A	StopFlowRate (LPM) N/A
Average Flow Rate (LPM) 2.5	Average Flow Rate (LPM) 2.5	Avenge FlowRate (LPM) N/A	Average Flow Rate (LPM) N/A
Volume: 75 L	Volume 675 L	Volume N/A L	Volume N/A L
Date Analyzect 7/27/99	Date: Analyzed 7/27/99	Date: Amelyzect 7/27/99	Date Analyzed 7/27/99
Granicule Field Area: 0.00817	GraticuleFieldArea 0.00817	Graticale Field Area 0.00817	GraniculeFieldArea: 0.00817
Total Fibers 20/100	Total Fibers 5/100	Total Fibers: 0/100	Total Fibers 0/100
Coefficient of Variation: 0.48	Coefficient of Variation: LOQ	Coefficient of Variation: N/A	Coefficient of Variation: N/A
Fibersec 0.13 f/ee	Fibersice 0.0035 f/ce	Fibervox N/A f/ec	Hiberson N/A f/ee

Abbreviations

AP-Areasample prior to abatement, AD-Areasample during abatement, C-Clearance, P-Personal sample from breathing zone, EL-Excursion limit, NAE-Negative air extraust, PA-post abatement areas ample, BG-Background LOQ-Limit of Quantification, LOD-Limit of Decicion

Comments < Sample calculated at Limit of Quantification (10 fibers/100 fields)

Analyzxby: Joel Sheridan

ENVIRONMENTAL, Inc.

Air Sample Analysis Report

CLIENT: Rose City Contracting

TRE JOB NO: 1490-12

ATTN:

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO:

PROJECT: West Linn High School

PAGE NO: 1 OF 2

Sample IDNo:	SampleIDNo: 2	Sample DNix 3	SampleIDNo: B
LaboratoryNo JS99-0171	LaboratoryNo JS99-0172	LaboratoryNo JS99-0173	LaboratoryNo: JS99-029
Sample Location: Jose Sanchez 542-55-4880 EX	Jose Sanchez 542-55-4880 P	Sample Location Jose Sanchez 542-55-4880 P	Sample Location Blank
WorkPerformed Tile & mastic removal	WorkParkemed Tile & mastic removal	WorkPerformed Tile & mastic removal	WorkPerformed N/A
DateSampled 7/20/99	DateSampled 7/20/99	DateSampled 7/20/99	DateSampled 7/20/9
Sampled by: A. Reyes	Sampledby: A. Reyes	Sampledby: A. Reyes	Sampledby: J. Sherida
PumpNia 1	PumpNa 1	PumpNix 1	PumpNα N/
StartTime: 07:00	StartTime: 07:30	StartTime: 12:30	SentTime: N/
StopTime: 07:30	StopTime: 12:30	Stop Time: 17:30	Stop Time: N/
MinutesSampled: 30	MinutesSampled: 300	MinutesSampled: 300	MinutesSampled: N/
Start Flow Rate (LPM) 2.5	Start FlowRate (LPM) 2.5	Start How Rate: (LPM) 2.5	Start Flow Rate: (LPM) N/
StopHowRate (LPM) 2.5	StopFlowRate (LPM) 2.5	StopFlowRate:(LPM) 2.5	StopFlowRater(LPM) N/
AverageHowRate (LPM) 2.5	AverageHowRate (LFM) 2.5	AverageHowRater(LPM) 2.5	Average How Rate (LPM) N/
Volume 75 L	Volume: 750 L	Volume: 750 L	Volume N/A L
Date Analyzect 7/27/99	Date:Analyzed: 7/27/99	DateAnalyzed 7/27/99	Date Analyzed 7/27/9
Granicule Field Area: 0.00817	GraticuleFieldArea 0.00817	GraticuleFieldArea: 0.00817	GraticaleFieldAsex 0.008
Total Fibers 9/100	Total Fibers 15.5/100	Total Fibers: 17.5/100	Total Fibers 0/10
Coefficient of Variation: LOQ	Coefficient of Variation: 0.53	Coefficient of Variation 0.51	Coefficient of Variation: N/
Fibers/cc 0.057 f/ce	Fibers/cc: 0.0097 f/cc	Fibers/cc 0.010 f/cc	Fibers/cc: N/A f/6

NAE-Negativeairexhaust, PA-postabatementareasample, BG-Background, LOQ-Limitof Quantification, LOD-Limitof Detection

Comments

Analyzedby: Joel Sheridan

THREE RIVERS ENVIRONMENTAL inc.

Air Sample Analysis Report

CLIENT: Rose City Contracting

TRE JOB NO: 1490-12

ATTN:

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO: 11

PROJECT: West Linn High School

PAGE NO: 2 OF 2

Sample IDNa B2	Sample IDNo:	SampleIDNix	Sample IDNo:
LaboratoryNox JS99-0300	Laboratory No:	LaboratoryNo:	LaboratoryNo:
Sample Location: Blank	Sample Location	Sample Location:	Sample Location:
WorkPerformed: N/A	WorkPerformed	WorkPerformed	WorkPerformed
DaveSampled: 7/20/99	DateSampled	DateSampled	DateSampled
Sampled by: J. Sheridan	Sampled by:	Sampled by:	Sampled by:
PumpNα N/A	PumpiNix	PumpNix	PumpNa
StartTime: N/A	StartTime:	Start Time:	StartTime:
StopTime: N/A	Stop Time:	Stop Time:	Stop Time:
Minutes Samplect N/A	MinutesSampled	MinutesSarrapted	MinutesSampled
Stant How Rose (LPM) N/A	Start FlowRate: (LPM)	Start How Rate: (LPM)	Start Flow Rate (LPM)
StopFlowRate (LPM) N/A	StopFlowRate (LPM)	StopFlowRate (LPM)	StopFlowRate (LPM)
AverageHowRate (LPM) N/A	Average How Rate (LPM)	AvezgeFlowRate (LPM)	Average-HowRate (LPM)
Volume N/A L	Volume L	Volume	Volume L.
Date:Amilyaed: 7/27/99	DateAnalyzed	Date Analyzect	DateAnalyzed
GraticuleFieldArea: 0.00817	Graticule Field Avex.	Graticule Field Area.	Ciraticalel TeldArea
Total Fibers: 0/100	Total Fibers:	Total Fibers	Total Fibers:
Coefficient of Variation: N/A	Coefficient of Variation:	Coefficient of Variation:	Coefficient of Variation:
Fibers/cc: N/A f/ee	Fiber/cc: f/cc	Fibers/cc f/cc	Fibers/cc: f/c
		gabatement,C-Gearance,P-Personal sample iG-Background,LOQ-LimitofQuantification	

Air Sample Analysis Report

THREE RIVERS
ENVIRONMENTAL, Inc.

CLIENT: Rose City Contracting

TRE JOB NO: 1490-12

ATTN:

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO: 12

PROJECT: West Linn High School

PAGE NO: 1 OF 2

SampleIDNix 1	SampleIDNo: 2	SampleIDNix 3	SampleIDNo: B
aboratoryNox JS99-0174	LaboratoryNo: JS99-0175	LaboratoryNo: JS99-0176	LahoratoryNo: JS99-017
Jose Sanchez 542-55-4880 EX	Sample Location Jose Sanchez 542-55-4880 P	Sample Location Jose Sanchez 542-55-4880 P	Sample Location Blank
WorkPerformed Tile & mastic removal	WorkPerformed Tile & mastic removal	WorkPerformed Tile & mastic removal	WorkPerformed N/A
Date Sampled: 7/22/99	DateSampled 7/22/99	DateSampled: 7/22/99	DateSampled 7/22/99
Sampled by: A. Reyes	Sampledby: A. Reyes	Sampled by: A. Reyes	Sampled by: J. Sheridan
PumpNice 1	PumpNix 1	PumpNo: 1	PumpNa N/A
StartTime: 07:00	StartTime: 07:30	StartTime: 12:30	StartTime: N/A
StopTime: 07:30	Stop Time: 12:30	StopTime 17:30	Stop Time: N/A
vimutesSampled: 30	MinutesSampled: 300	MinutesSampled: 300	MinutesSampled: N/A
StartHowRate (LPM) 2.5	Start Flow Rate (LPM) 2.5	StartHowRate (LPM) 2.5	Start How Rate (LPM) N/A
topHowRate(LPM) 2.5	StopFlowRate (LFM) 2.5	StopFlowRate (LPM) 2.5	StopFlowRate (LPM) N/
Average How Rate: (LPM) 2.5	AverageHowRate (LPM) 2.5	AverageHowRate (LPM) 2.5	Average How Rate (LPM) N/
volume 75 L	Volume: 750 L	Volume 750 L	Volume N/A L
Date:Amilyzed: 7/27/99	Date:Analyzed: 7/27/99	Date Analyzed 7/27/99	Date Analyzed 7/27/9
Sisticule Field Area: 0.00817	GesticaleFieldArex 0.00817	GeniculeFieldAsex 0.00817	Graticule Field Auex 0.0081
otal Fibers: 6/100	Total Fibers 12.5/100	Total Fibers: 42.5/100	Total Fibers: 0/10
Coefficient of Variation: LOQ	Coefficient of Variation: 0.58	Coefficientof Variation: 0.36	Coefficient of Variation: N/
Fibersica: 0.038 f/ee	Fibers/cc: 0.0079 f/ee	Fiberson 0.026 f/ce	Fibers/cc: N/A f/c

Abbreviations

AP-Areasample prior to altriement, AD-Areasample during abstement, C-Clearance, P-Personal sample from breathing zone, EL-Excursion limit, NAE-Negative airextraust PA-postabatement areasample, BG-Background, LOQ-Limit of Quantification, LOD-Limit of Detection

Comments <Sample calculated at Limit of Quantification (10 fibers/100 fields)

Analyzedby: Joel Sheridan

THREE RIVERS ENVIRONMENTAL, inc.

Air Sample Analysis Report

CLIENT: Rose City Contracting

TRE JOB NO: 1490-12

ATTN:

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO: 12

PROJECT: West Linn High School

PAGE NO: 2 OF 2

SampleID:Nix B2	SampleIDNo:	Sample IDNo:	Sample IDNica
Laboratory Nor JS99-0178	LaboratoryNox	Laboratory/No.	Laboratory No:
Sample Location Blank	Sample Location:	Sample Lixention:	Sample Location
WorkPerformed N/A	WorkPerformed	WorkPalomed	WorkPerformed
DateSampled: 7/22/99	DateSampled	DateSampled	DateSampled
Sampledby: J. Sheridan	Sampled by:	Sampled by:	Sampled by:
PumpNo: N/A	PumpNicx	PumpNix	PumpNc
StartTime: N/A	Start Time:	StartTime:	Start Time:
Stop Time: N/A	Stop Time:	Stop Time:	Stop Turne:
MinutesSampled: N/A	MinutesSampled	MinutesSampled	MiratesSampled
Start How Rate (LPM) N/A	Start Flow Rate (LPM)	Start How Rate (LPM)	Start How Rate (LPM)
StopFlowRate (LPM) N/A	Stop Flow Rate: (LPM)	Stop How Rate (LPM)	StopFlowRate (LPM)
AvengeFlowRate (LPM) N/A	AverageFlowRate (LPM)	Average FlowRate (LPM)	Average Flow Rate (LPM)
Volume: N/A L	Volume L	Volume L	Volume L
Date Analyzed 7/27/99	DineAnalyzet	Date: Amalyzect	DateAnalyzed
GraniculeFieldAreac 0.00817	Graticule Field Alex	GeniculeFieldAsea	Gesticale Field Area
Total Fibers 0/100	Total Fibers	Total Fibers	Total Fibers
Coefficient of Variation: N/A	Coefficient of Variation:	Coefficient of Variation:	Coefficient of Variation
Fibas/cc: N/A f/ee	Fibers/cc f/ee	Fiberson: f/ee	Fiberson f/ee
		ngabaement,C-Cleurance,P-Personal sampl ,BG-Background,LOQ-LimitofQuantificatio	
Comments			

Air Sample Analysis Report



CLIENT: Rose City Contracting

TRE JOB NO: 1490-13

ATTN:

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO:

PROJECT: West Linn High School

PAGE NO: [OF]

SampleIDNox 1	SampleIDNo: B1	SampleIDNox B2	SampleIDNox
abomeoryNix JS99-0277	LaboratoryNox JS99-0278	Laboratory No. JS99-0279	LaboratoryNox
Armondo Reyes 521-05-2847 P	Sample Location Blank	Sample Location: Blank	Sample Location:
WorkPurkomed Transite clean-up 1/2 mask	WorkPerformed N/A	WorkParloamed: N/A	Work Performed
DateSampled 8/10/99	DateSampled: 8/10/99	DateSamplet 8/10/99	DateSampled
Sampled by: Armondo	Sampledby: J. Sheridan	Sampledby: J. Sheridan	Sampled by:
PampaNo. N/A	Рипріха N/A	PumpNix N/A	Pump!vic
ianTime: 03:00	Stantime: N/A	StantTime: N/A	Start Time:
StopTime: 07:00	Stop Time: N/A	Stop Time: N/A	Stop Time:
finutesSampled 240	MinutesSampled N/A	MinutesSampled N/A	MinutesSampled:
tent Flow Rate (LPM) 2.5	Start Flow Rate (LPM) N/A	Start How Rate (LPM) N/A	Start Flow Rate: (LPM)
topPlowRate (LPM) 2.5	StopFlowRate (LPM) N/A	Stop Flow Rate (LPM) N/A	StopFlowRate (LPM)
weageFlowRate(LPM) 2.5	AverageHowRate (LPM) N/A	Average:FlowRater(LPM) N/A	Average Flow Rate (LPM)
oiume 600 L	Volume N/A L	Volume N/A L	Volume L
Me Analyzed 8/11/99	Date Analyzei 8/11/99	Date:Analyzed 8/11/99	Dae Areivezt
inaticule Field Area: 0.00817	GraticuleFieldAtear 0.00817	CiraticuleFieldArex 0.00817	Graticale Feld Area
oral Fibras: 18/100	Total Fibers 0/100	Total Fibers 0/100	Total Fibers:
cefficient of Variation: 0.5	Coefficient of Variation: N/A	Coefficient of Variation: N/A	Coefficient of Variation:
iberson 0.014 f/ce	Fibersyce N/A f/ee	Fiberson N/A f/ee	Fibersoc f

Abbreviations

AP-Areasample prior to abatement, AD-Areasample during abatement, C-Clearance, P-Personal sample from breathing zone, EL-Excussion limit, NAE-Negative air extra ust, PA-post abatement areasample, BG-Background, LCQ-Limit of Quantification, LCD-Limit of Detection

Comments Contractor's samples

Analyzaby: Joel Sheridan

Air Sample Analysis Report



CLIENT: Rose City Contracting

TRE JOB NO: 1490-13

ATTN:

Andy Chaff

P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO: 2

PROJECT: West Linn High School

PAGE NO: 1 OF 1

ampleIDNo:	1	Sample IDNo:	B1	Sample:IDNo:	B2	SampleIDNo:	
abonatory.Nox JS99	-0280	LaboratoryNo: JS9	99-0281	Laboratory No. JS99	9-0282	Laboratory No:	
ampieLocation Luis Reyes 673-92-7401 P		Sample Location: Blank		Sample Location Blank		Sample Location:	
VorkPerforment Transite clean- 1/2 mask	up	WorkPerformed N/A		WorkPerformed: N/A		WorkPerformed	
Date Sampled 8	/11/99	DateSampled	8/11/99	DateSampled 8	3/11/99	DateSampled	
ampledby: Am	nondo	Sampled by: J. S	Sheridan	Sampled by: J. Sh	neridan	Sampled by:	
штир:Ха	N/A	PumpNice	N/A	Pump/viox	N/A	PumpNica	
anTime:	11:00	SanTinu:	N/A	StartTime	N/A	SenTime	
op Time:	12:00	Stop Time:	N/A	Stop Time:	N/A	Stop Time:	
inuesSampiect	60	Minutes Sampled:	N/A	MinutesSampled	N/A	Nimutes Sampled	
art How Rate: (LPM)	2.5	Start Flow Rate (LPM)	N/A	Start Flow Rate (LPM)	N/A	Start How Rate (LPM)	
opFlowRate:(LPM)	2.5	Stop Flow Rate: (LPM)	N/A	StopFlowRate:(LPM)	N/A	StopFlowRates (LPM)	
verage How Rate (LPM	2.5	Average How Rate (LP	M) N/A	Average Flow Rate: (LP)	1) N/A	Average Flow Rate (LPM)	
otume 150	L	Volume N/A	L	Volume N/A	L	Volume	L
acAnalyzed 8	/11/99	DaeAnalyzed	8/11/99	Dose Analyzed: {	3/11/99	Date Analyzed	
micule Field Arex 0.	00817	Controle Field Area (0.00817	GraniculeFieldArea ()	.00817	Graticule Field Arex	
tal Fibers:	10/100	Total Fibers	0/100	Total Fibers:	0/100	Total Fibers:	
vellicient of Variation:	0.63	Coefficient of Variation	T N/A	Coefficient of Variation:	N/A	Coefficient of Variation	

Abbreviations:

AP-Areasample prior to abatement, AD-Areasample cluring abatement, C-Clerizance, P-Personal sample from breathing zone, EL-Excussion limit, NAE-Negative airex haust, PA-postabatement areasample, BG-Background, LOQ-Limit of Quantification, LOD-Limit of Detection

Comments Contractor's samples

Analyzadoy: Joel Sheridan

ASBESTOS ABATEMENT SUMMARY Work Order No.: 1020-67

Job Location: WEST LINN HIGH SCHOOL Floor: EXCAVATION MESA
Project: TSI REMOURL TUNNEL SYSTEM EXPOSED DURING
EXCAUATION OF NW CORNER OF ROTUNDA
For pipe provide: Total linear feet 250 wfT and pipe size 4"
For other materials provide: Total square feet:
Type of ACM: TSI, DEBRIS
Start Date: 9-24-99 Completion Date: 9-24-99
Methods to Control Emissions: WET METHODS
Give name of Contractor of Subcontractor:
Name: KEYSTONE CONTRACTING INC.
Address: 417 NW 209th STREET
City: RIDGE FIELD State: WA. Zip: 98642
Phone: (360) 887-0868 Contact person: LARLY TINGLEY
Name of Monitoring Lab: THREE RIVERS ENUIDANMENTAL
Anticipated Disposal Site: HILLS BORD LANDFILL, HILLS BORD OR.
Supervisor in charge of job: DALE DEAN
Project Manager: KOBERT MONTGOMERY
Name: Date: 9-24-99 Phone (503) 557-2396
Asbestos Program Manager:
Name: Date: Phone (503) 638-8869

Attach pre-abatement and post-abatement air sample results

THREE RIVERS ENVIRONMENTAL Inc.

Air Sample Analysis Report

CLIENT: West Linn-Wilsonville School District TRE JOB NO: 1020-67

ATTN: Joe Simmons P.O. NO: Verbal

CONTRACTOR: Keystone Contracting, Inc. REPORT NO: 1

PROJECT: West Linn High School

PAGE NO: 1 OF 2

Excavation Area
TSI removal in tunnel

Sample IDNox 1	SampleIDNo: 2	SampleIDNx 3	Sample IDNo.
LaboratoryNo: RM99-0873	LaboratoryNo RM99-0874	TabonatoryNo RM99-0875	LaboratoryNo: RM99-0
Sample Location 25' SW of rotunda W. side excavation area AD	Sample Location: 20' W. of rotunda W. side excavation site AD	Sample Location Carlos Mendoza 610-28-9238 EL	Sample Location Carlos Mendoza 610-28-9238 P
WorkPerformed N/A	WorkPerkumed N/A	WorkPerformed Glovebag 1/2 face	WorkPerformed Glovebag 1/2 face
DateSampled 9/22/99	DateSampled 9/22/99	DateSampled 9/22/99	DateSampled 9/22
Sampledby: R. Montgomery	Sampledby: R. Montgomery	Sampledby: R. Montgomery	Sampled by: R. Montgor
PumpNa HV-23	PampNa HV-22	PampNa LV-03	Ρυπρλία LV
StartTime: 17:40	StantTime: 17:45	StartTime: 19:00	StartTime: 19
StopTime 19:45	StopTime: 19:45	StopTime: 19:30	Stop Time: 21
MinutesSampled 125	MinutesSampled 120	Minutes Sampled: 30	MinutesSamplect
Statt Flow Rate (LPM) 12	StartHowRate (LPM) 12	Start Flow Rate (LPM) 2	Stant-How Rate (LPIVI)
Stop Flow Rate: (LPM) 12	StopFlowRate(LPM) 12	StopHowRate (LPM) 2	Stop How Rate (LPM)
AverageHowRate (LPM) 12	AverageHowRate (LPM) 12	Average-RowRate (LPM) 2	AverageFlowRate (LPM)
Volume: 1500 L	Volume: 1440 L	Volume 60 L	Volume 270 I
Date Analyzed 9/23/99	DateAnalyzed 9/23/99	Date Analyzed 9/23/99	Date Analyzed: 9/23
CraniculeFieldArea: 0.00817	GraticuleFieldArear 0.00817	GraticuleFieldArex 0.00817	GraniculeFieldArea 0.00
Total Fibras: 6/100	Total Fibers 2.5/100	Total Fibers 2.5/100	Total Fibers: 12/
Coefficient of Variation: LOQ	Coefficient of Variation: LOD	Coefficient of Variation: LOID	Coefficient of Variation: 0
Fibersica: <0.0031 f/ee	Fibers/cc: <0.0033 f/ee	Fibers/cc 0.020 f/cc	Fibers/oc: 0.021 1

Abbreviations

AP-Areasample prior to abatement, AD-Areasample during abatement, C-Clearance, P-Personal sample from breathing zone, EL-Excursion limit, NAE-Negative air exhaust, PA-post abatement areas sample, BG-Background, LOQ-Limit of Quantification, LOD-Limit of Detection

Comments <Sample calculated at Limit of Quantification (10 fibers/100 fields)

Amlyzedby: Robert Montgomery

ENVIRONMENTAL, Inc.

Air Sample Analysis Report

West Linn-Wilsonville School District TRE JOB NO: 1020-67

ATTN:

Joe Simmons

P.O. NO: Verbal

CONTRACTOR: Keystone Contracting, Inc. REPORT NO:

PROJECT: West Linn High School

PAGE NO: 2 OF 2

Excavation Area TSI removal in tunnel

Sample IDNo: 5	SampleIDNo: 6	Sample IDNix B1	Sample IDNo:
Laboratory No. RM99-0877	Laboratory No. RM99-0878	Laboratory Nix RM99-0879	Latenatory No. RM99-088
Sample Location 25' SW of rotunda in excavation area AD	Sample Location: 20' W. of rotunda in excavation area AD	Sample Location Blank	Sample Location: Blank
WorkPerformed N/A	WorkPerformed N/A	WorkPerformed N/A	WorkPerformed N/A
DateSanupled: 9/22/99	Date:Sampledi 9/22/99	DateSampled 9/22/99	DateSampled 9/22/9
Sampledby: R. Montgomery	Sampled by: R. Montgomery	Sampledby: R. Montgomery	Sampled by: R. Montgome
PumpNia HV-23	Ритр Ха НV-22	PampNα N/A	PumpNo: N/
Start Time: 19:45	StartTime: 19:45	StartTime: N/A	Startime: N/
StopTime 21:45	StopTime 21:45	StopTime: N/A	StopTime: N/
MinusesSampled: 120	Minutes Sampled: 120	Minusters Samplect N/A	MinatesSampled N/
Start Flow Rate: (LPM) 12	Start Flow Rate (LPM) 12	Start How Rate (LPM) N/A	Start How Rate: (LPM) N/
Stop Flow Rate: (LPM) 12	StopFlowRate (LPM) 12	StopFlowRate (LPM) N/A	StopFlowRate (LPM) N/
Average Row Rate (LPM) 12	Average Flow Rate: (LPM) 12	AverageRowRate:(LFM) N/A	Average Flow Rate: (LPM) N/
Volume 1440 L	Volume 1440 L	Volume: N/A L	Volume N/A L
Date Analyzed: 9/23/99	DateAnalyzed 9/23/99	Date Analyzed 9/23/99	Date Analyzect 9/23/9
Canticule Field Asea: 0.00817	GraticuleFieldArea 0.00817	GraticaleFieldArea 0.00817	GraticuleFieldArea 0.008
Total Fibers 8/100	Total Fibers 17.5/100	Total Fibers: 0/100	Total Fibras: 0/10
Coefficient of Variation: LOQ	Coefficientof Variation: 0.51	Coefficient of Variation: N/A	Coefficient of Variation: N/
Fibers/cc: <0.0033 f/ee	Fibers/cc 0.0060 f/cc	Fibers/cc N/A f/ee	Fibers/cc: N/A f/

NAE-Negative airexhaust, PA-postabatementare a sample, BG-Background, LOQ-Limit of Quantification, LOD-Limit of Detection

Comments < Sample calculated at Limit of Quantification (10 fibers/100 fields)

Analyzedby: Robert Montgomery THREE RIVERS ENVIRONMENTAL

PROJ. No: 1020-67

DATE: 9-22-99 Pg. 1 of 2

See air monitoring reports of this date

ASBESTOS PROJECT CHECKLIST

PROJECT NAME: WEST LUN HIGHS SCHOOL , TSI	PROJ. MGR: POBSET C. MONTGOIMERY
PEMOUAL, TUNNEL - EXCAUATION AT NEW CONSTENCTION SITE.	ON SITE: 5.30 OFF SITE: 3300
OWNER PROVIDED ON-SITE CONTACT:	CONTRACTOR: KZYSTOWE CONTRACTING
NAME: JOE SIMMONS	SUPERVISOR: DALE DEAN
Intent to remove ACM on site and complete? Date Pre-abatement samples taken: Disposal site: HILLS BORD LANDFILL, HILLS BORD	PERSONAL AIR MONITORS USED: (Y) ()
AREA ISOLATION CORRECTION REQUIRED NO YES	PROTECTIVE CLOTHING: () () PERSONNEL USING DECON: () N/A () EQUIP. MAINTAINED PROPERLY: () () WETTING, PRIOR & DURING: () EXCESSIVE DEBRIS: ()
BARRICADES & SIGNS: AIRLOCKS: COVERINGS ON FLOORS & WALLS: NON-MOVABLE EQUIP. COVERED: ALL OPENINGS SEALED: AIR HANDLING EQUIP. OFF/SEALED: () N/A ()	BAGGING OPERATION: () () NEGATIVE AIR ADEQUATE: () N/N () DECON ADEQUATE: () N/A () CLEAN ROOM ADEQUATE: () N/A () SHOWER FILTERED AND ADEQUATE: () N/A () Respiratory Protection in use: 1/2 Face (*) Full Face () PAPR () Type C ()
PROJECT MA	ANAGEMENT LOG
PAR TO REMOVE. DALE DE DESCRICA CAPE ASSIBLED TO ABATE THIS 1740: STATED/CALIBRATED HU-23 ON THE CONSTRUCTION 1745: STARTED/CALIBRATED HU-22	· WITH SAMPLE #2 20 W OF ROTUNDA
EXPOSED AND COUSERVATIUS L.F. THE PLAN IS TO CUT AN WHAT HAS NO REEN EXPOSE	UY PUT THE LENGTH MOONE 80'

Project Log

THREE RIVERS ENVIRONMENTAL CLIENT:

ATTN:

TRE JOB NO:

PURCHASE ORDER NO:

CONTRACTOR:

REPORT DATE:

PROJECT:

PAGE NO: OF

1895: THE CREW IS CUTTING AND WEARPING NUMBERUS SECTIONS. THEY HAVE GLOVE BALGED THE 90'S AND HAVE
THE UNES,
THE IMMEDIATE AREA, AND REQUIRES QUITE A BIT OF WEITING AND RETURNS. STARTED EL ON CARLOS.
1930 PULLED THE EL SAMPLE OF CARLOS MEUDOZA
1945! RE-CALIBRATED AND FULLED SAMPLES # AND THE RESTARTED AND CALIBRATED SAMPLE #5 ON HV-23 AND SAMPLE # 6 ON HV-22 SAME LOCATIONS.
2000: CREW IS NOW CUTTING AND WEAPPING WHICH ALE ACCESIBLE THE LIVES WEIGH ARE ABOUT GROWN) ARE BEING GLOUT BAGGED AND CLEANED AS FATH OD, TO COMPLETE THE JOB WILL RE- COURE THE REMINUIOG SLAD TO BE PULLED OFF AND THE DEBRIS PERMONED FROM THE CHASE DEFORE ALL OF THE ASSUMED MATERIAL CAN HE REMOVED.
2030: DALE AND JOSE ARE DISCOURDING MORE AND MORE TS! LINE AS THEY PREPARE EXPOSED PIAE TO BE CUT.
2045: CRELOS HAS FINISHED CUTTING ALL THE EXPOSED TSI LIVE AND ALL OF THE CREW IS NOW BALLWING AND WRAPPING FREED PHING TO BE LOADED AND REMOVED.
2100 (PEW IS STILL BAGGING MATERIAL AND EXPOSING MORE PIPE.
A 130: THE EXPOSED PIPE HAS BEEN CLEANED AND STACKED. TOMMORADILY THE EXCAUATION CREW WILL DZZD TO PEEL ROCK MORE OF THE CEMENT AND EXPOSE THE REMAINING TS LINES.
REBAR WITHIN THE AREA.
ACCOMPLISHED. FINAL INSA WILL FOLLOW,
2300: DEDARTING THE HIGH SCHOOL Reportly: Detect Clan govern

ENVIRONMENTAL Inc.

Air Sample Analysis Report

West Linn-Wilsonville School District TRE JOB NO: 1020-67

ATTN: Joe Simmons P.O. NO: Verbal

CONTRACTOR: Keystone Contracting, Inc. REPORT NO:

PROJECT: West Linn High School

Excavation Area TSI removal in tunnel PAGE NO: 1 OF 3

Sample IDNo: 1	Sample IDNo: 2	SampleIDNo: 3	Sample IDNo:
LatoratoryNo: IJ99-0342	LaboratoryNox IJ99-0343	LatoratoryNo IJ99-0344	LaboratoryNix IJ99-03
Sample Location Sam Hammond 546-45-3305 P	Sample Location N.E. corner of covered slab, tunnel area AD	Sample Location: Center of abatement area AD	Sample Location: Sam Hammond 546-45-3305 P
WorkPerformed TSI mnvl. glovebag 1/2 face	WorkPerformed N/A	WorkPerformed N/A	WorkPerformed TSI rmvl. gloveba 1/2 face
DateSamplect 9/24/99	DateSampled 9/24/99	DateSampled 9/24/99	DateSampled 9/24
Sampled by: I. Jones	Sampled by: I. Jones	Sampledby: I. Jones	Sampled by: I. Jo
PumpNix LV-07	Ритр Ма НV-07	PumpNa HV-04	Ритр Ха НV
Start Time: 09:30	StartTime 09:45	StartTime: 09:45	Start Time: 10
Stop Time: 10:30	StopTime: 11:45	StopTime: 11:45	Stop Times 11
MinutesSampled 60	MinutesSaropleci 120	Minutes Samplect 120	MinutesSampled:
Start Flow Rate (LPM) 2	Start Flow Rate: (LPM) 10	Start Flow Rate: (LPM) 10	Start Flow Rate (LPM)
StopFlowRate (LFM) 2	Stop Flow Rate: (LPM) 10	Stop Flow Rate: (LPM) 10	Stop Flow Rate: (LPM)
Average: How Rate: (LPM) 2	Average Flow Rate (LPM) 10	Average Flow Rate (LPM) 10	Average Flow Rate (LPM)
Volume 120 L	Volume: 1200 L	Volume 1200 L	Volume: 60 L
Date Analyzed: 10/2/99	Date:Analyzed 10/2/99	Date:Analyzed 10/2/99	Date:Analyzed 10/2
GzaticuleFieldArea: 0.00817	GraticuleFieldArea 0.00817	CanticuleFieldArea 0.00817	GraticuleFieldArex 0.008
Total Fibers: 1.5/100	Total Fibers .5/100	Total Fibers: 1/100	Total Fibers .5/1
Coefficient of Variation: LOD	Coefficient of Variation: LOD	Coefficient of Variation: LOD	Coefficient of Variation:
Fibers/cc <0.0031 f/ee	Fibers/oc <0.0033 f/ce	Fibers/cc: 0.020 f/ec	Fibers/cc 0.021 f

Abareviolisms

AP-Areasample priorto-abatement, AD-Areasample during abatement, C-Clearance, P-Personal sample from breathing zone NAE-Negativeairexhaust, PA-postabatementareasample, BG-Background, LOQ-Limitof Quantification, LOD-Limitof Detection

Comments < Sample calculated at Limit of Quantification (10 fibers/100 fields)

Analyzedby: Irvin Jones

Air Sample Analysis Report

ENVIRONMENTAL, Inc.

West Linn-Wilsonville School District TRE JOB NO: 1020-67 CLIENT:

P.O. NO: Verbai ATTN: Joe Simmons

CONTRACTOR: Keystone Contracting, Inc. REPORT NO:

PROJECT: West Linn High School

Excavation Area TSI removal in tunnel PAGE NO: 2 OF 3

SampleIDNo: 5	Sample IDNa 6	SampleIDNo 7	SampleIDNo:
LaboratoryNix IJ99-0346	LaboratoryNox IJ99-0347	LaboratoryNix IJ99-0348	LaboratoryNo IJ99-034
Sample Location Sam Hammond 546-45-3305 P	Sample Location: N.E. corner of covered slab, tunnel area AD	Sample Location Center of abatement area AD	Sample Location Sam Hammond 546-45-3305 P
WorkParlormed TSI rmvl. glovebag 1/2 face	WorkPerformed: N/A	WorkPerformed: N/A	WorkPerformed TSI rmvl. glovebag 1/2 face
DateSampled 9/24/99	DateSampled 9/24/99	DateSampled: 9/24/99	DateSampled 9/24/
Sampled by: I. Jones	Sampledby: I. Jones	Sampledby: I. Jones	Sampled by: I. Jon
PumpNo: LV-07	PumpNo: HV-04	PempNa HV-04	PampNa LV-
StartTime: 12:15	StartTime 12:20	Start Firme: 09:45	StartTime: 13:
Stop Time: 13:45	Stop Time: 14:50	Stop Time: 11:45	Stop Time: 14:
MinutesSampled 90	MinutesSampled 150	Minutes Sampled: 120	MinutesSampled
Start Flow Rate: (LPM) 2	Start How Rate: (LPM) 10	Start Flow Rate (LFM) 10	Start How Rate (LPM)
Stop Flow Rate (LPM) 2	StopFlowRater (LPM) 10	StopFlow Rate: (LPM) 10	StopFlowRate (LPM)
AvengeRowRate (LPM) 2	Average-HowRate (LPM) 10	Average/HowRate (LPM) 10	AverageFlowRate (LFM)
Volume 180 L	Volume 1500 L	Volume 1200 L	Volume 1200 L
DateAnniyzeci 10/2/99	Date Analyzed 10/2/99	Date Analyzed 10/2/99	Date Analyzed 10/2/
Granicale Field Area: 0.00817	GraticuleFieldAren 0.00817	GizticuleFieldArez 0.00817	CranicaleFieldArea: 0.008
Total Fibers 3/100	Total Fibers 1.5/100	Total Fibers 1/100	Total Fibers: 3/1
Coefficient of Variation: LOD	Coefficient of Variation: LOD	Coefficient of Variation LOD	Coefficient of Variation LC
Fibers/cc: 0.0094 f/cc	Fibers/cc <0.0031 f/ce	Fibers/oc <0.0031 f/cc	Fibers/cc: 0.012 f/

AP-Areasample prior to abatement, AD-Areasample during abatement, C-Clearance, P-Personal sample from breathing zone, I NAE-Negative air exhaust, PA-post abatement areas ample, BG-Background LOQ Limit of Quantification, LOD-Limit of Detection

Comments <Sample calculated at Limit of Quantification (10 fibers/100 fields)

Analyzedby: Irvin Jones

THREE RIVERS ENVIRONMENTAL Inc.

Air Sample Analysis Report

CLIENT: West Linn-Wilsonville School District TRE JOB NO: 1020-67

ATTN: Joe Simmons

P.O. NO: Verbal

CONTRACTOR: Keystone Contracting, Inc. REPORT NO:

PROJECT: West Linn High School

PAGE NO: 3 OF 3

Excavation Area
TSI removal in tunnel

Sample IDNot	9	Sample IDNo:	10	Sample IDNor	B1	SampleIDNo:	B2
Laboratory No.	1J99-0350	LaboratoryNox	IJ99-03 <i>5</i> 1	LaboratoryNox	IJ99-03 <i>5</i> 2	LaboratoryNo	LJ99-03 <i>5</i> 3
Sample Location:	II	Sample Location:		Sample Location	· · · · · · · · · · · · · · · · · · ·	Sample Location:	
N.E. corner slab, tunnel AD	1	N.E. corner of	of abatement	Blank		Blank	
WorkPerformed:		WorkPerformed		WorkPerformed		WorkPerformed	
	I/A	N/	Ά.	3	I/A	1	I/A
DeteSampled	9/24/99	Date Sampled:	9/24/99	DateSampled:	9/24/99	DateSampled:	9/24/99
Sampled by:	I. Jones	Sampled by:	I. Jones	Sampled by:	I. Jones	Sampled by:	I. Jones
Ритр Ма	HV-07	PampNa	HV-04	PumpNa	N/A	Ρωπρινία	N/A
Start Time:	15:00	Start Time:	15:00	Start Time:	N/A	Start Time:	N/A
Stop Time:	16:00	StopTime	16:00	Stop Time:	N/A	Stop Time:	N/A
VinutesSampled	60	MinutesSanapled	60	MinutesSampled	N/A	MinutesSampled	N/A
Start.Flow.Rate.(L	PM) 10	Start How Rate: (LF	M) 10	Start Flow Rate: (I.	PM) N/A	Stant Flow Rate: (1	PM) N/A
Stop Flow Rate: (I	PM) 10	StopFlowRate: (LI	M) 10	Stop Flow Rate: (I	PM) N/A	StopFlowRate (I	PM) N/A
Average How Rate	e(LPM) 10	Average Flow Rate:	(LPM) 10	Avezage Row Rat	e(LPM) N/A	AverageFlowRat	e(LPM) N/A
Volume 6	00 L	Volume 60)0 L	Volume N	I/A L	Volume N	I/A L
DateAnalyzed	10/2/99	DateAnalyzedt	10/2/99	DateAnalyzect	10/2/99	Date Analyzed	10/;2/99
Gzaticule Field Are	≈ 0.00817	Graticule Field Area	0.00817	Graticale Field Are	a 0.00817	Graticale Field Are	a 0.0081
Total Fibers	6.5/100	Total Fibers	2.5/100	Total Fibers	0/100	Total Fibers:	0/100
Coefficient of Van	iation LOQ	Coefficient of Varia	tion: LOD	Coefficient of Va	iation: N/A	Coefficient of Van	iation N/A
Fibers/cc:	0.0079 f/cc	Fibers/cc: _0	.0079 f/cc	Fibers/cc: N	/A f/ec	Fibers/cc: N	/A f/co

Abbreviations

AP-Areasample prior to a batement, AD-Areasample during a batement, C-Clearance, P-Personal sample from breathing zone, FL-Excussion limit NAE-Negative air exhaust, PA-postabatement areasample, BG-Background, LOQ-Limit of Quantification, LOD-Limit of Detection

Comments < Sample calculated at Limit of Quantification (10 fibers/100 fields)

Analyzedby: Irvin Jones

PROJ. Not. 1 P 20 - 67

DATE: 9-24.90 Pg. / of See air monitoring reports of this date X

ASBESTOS PROJECT CHECKLIST

PROJECT NAME: WEST LINN HIGH School	PROJ. MGR: III JONES
	ON SITE: <u>69/0</u> OFF SITE:
OWNER PROVIDED ON-SITE CONTACT:	CONTRACTOR: Key Towe Confronting
NAME BRAD RAYMOND	SUPERVISOR: Dale
Intent to remove ACM on site and complete? Date Pre-abatement samples taken:	PERSONNEL & CORRECTION METHODS REQUIRED NO YES
Disposal site: H.Zhoboea hard F.Zh	WORKER PROTECTION ADEQUATE: (*) (*) PERSONAL AIR MONITORS USED: (*) (*) PROTECTIVE CLOTHING: (*) (*)
AREA ISOLATION CORRECTION REQUIRED NO YES	PERSONNEL USING DECON: () MA. () EQUIP. MAINTAINED PROPERLY: () MA. () WETTING, PRIOR & DURING: () EXCESSIVE DEBRIS: ()
BARRICADES & SIGNS: () () AIRLOCKS: () N/A () COVERINGS ON FLOORS & WALLS: () N/A () NON-MOVABLE EQUIP. COVERED: () N/A () ALL OPENINGS SEALED: () N/A () AIR HANDLING EQUIP. OFF/SEALED: () N/A ()	BAGGING OPERATION: NEGATIVE AIR ADEQUATE: DECON ADEQUATE: CLEAN ROOM ADEQUATE: SHOWER FILTERED AND ADEQUATE: Respiratory Protection in use: 1/2 Face (** Full Face (**) PAPR (**) Type C (**)
PROJECT MAN	AGEMENT LOG
0100 - GRRIVEI AT TRE OFFICE 0810 - L'EUSTONE CONTINTION H Supravisor Two Wood 0812 - TRE Contacted Keyston ASKED FOR PERMIT IS	PARILIED TRE, THREE ONE KERS. NE Supervison Supervison. Respect TRE NOR KROSTONE
Hed ONE CONTacted W. Kieg & YONE IN FROLES OF	Tifing to get one-
1910 - TRB DODANG TOS 1216	The to With HS
William Regulation of the Park	SIGNATURE: Sandh
	In was James

THREE RIVERS ENVIRONMENTAL

PROJ. No: 1020-47

DATE: 9-24-89 Pg. 2-of 3

See air monitoring reports of this date 1

PROJECT MANAGEMENT LOG

0420	W.L	H S .	(Seysti	ARRICA	1 5 7 0 0	م محر	
0930	TRB.	Lowked	•		Approx		, 5
	Piping		le Acc	0-712.03	BBATA	et on	<u>-</u>
0950	Villa	Worker	-5 Am			Mech	
0930	Crohibe 2 NW · Cost	Led HV.	07 SF	B-Ldry	ample side	2- e	
10 15 C	CALISENSON	neal Pro	STARTAN	Sample	3 <u>(</u> e	nter	
1 <u>030 R</u>	eiered N	Of Goralian	OF Per	m. t. From	lacysto	Ne	· · · · · · · · · · · · · · · · · · ·
10410 TB	E Decen	DeR.	e Beaus	akt Copy	5 Per.	mT To	
	ے	off Site					***
	_	(TRE) O					
	J /	Back on S					
1200 1	eastone Sl.	Prop ma ing	To Con	trave a	17th HBA	1 ment a	
COLBRO		out if Hu-	07 Sta	Ned Sam	gles lo	<u> </u>	
1300 A WRA	LOW. HA	10' QF UB TO B TACHE 14	ELSUE B	Bated og Then	Cut for	Other	
1305	Kcystone	Super	1.50R	w Con	rehed]	lone-	
1402	DALE (ON	Site Super		a Key S	Tode) a	ne To l	sh-
1430 14	eystone	ON BO	enk				
1445 11	ieus tone	13x /2 6	TWORK	2 (WOR!	ing		
1500	CAL: BRAT	EJ HU-04	19 HU107	8 mates	SAMPL	es 9510	
1550 T	SI Remo	of Compl	ded (o amen	on Cheno	un	
& hate	Entry	V		SIGNATURE:	Sam	Lun	
	,					Invan	Jones

THREE RIVERS ENVIRONMENTAL

PROJ. No: 1020-67

DATE: 9-24-99 pg. 3 of 3

See air monitoring reports of this date 1

PROJECT MANAGEMENT LOG

1600	Cabboned	WV-0791	10-04	STOPPED B	o Th
	Pum T.	Publed 15	amples		<u> </u>
				, ,,	
1605	Chean 1	IP Honos	TINISh.	-d Kc457	
	Tiekines	U.P Tomas	\ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \		
		<u> </u>	<u> </u>		
1630	Kestone	9 TRE	- 1-6-	5 76 78	8. 11/P. C.
20.30	70 1175	1/11//	Back	25 0 - 6	2 IN MOUNT
	0 (- 10/1120 (2		noton hers
	Vicas Bon	FOR HE	amphas a	bortskie.	
		<u></u>			
					
					
	······································				
*			· · · · · · · · · · · · · · · · · · ·		
				····	
					
 					
			<u></u>		
					<u></u>
	· · · · · · · · · · · · · · · · · · ·		· · · · · · · · · · · · · · · · · · ·		
		<u></u>			
		<u> </u>			
- <u></u>			·		
				· · · · · · · · · · · · · · · · · · ·	
					
				· 	
	· · · · · · · · · · · · · · · · · · ·				
				<u> </u>	
					<u></u>
					·
				····	
					······································
				······································	
· · · · · · · · · · · · · · · · · · ·		<u> </u>		······································	
				······································	 · · · · ·
	·····		<u> </u>		
					
			 <u> </u>		

SIGNATURE:

170 E. Arlington Gladstone, Oregon 97027 (503) 656-4601

Irvin Jones

ASBESTOS ABATEMENT SUMMARY Work Order No.: 1020-6니

Job Location: WEST WWW A	HIGH SCHOOL	Floor: CONST. SITE NW ENDS.
Project: ASBESTOS MATE	RIAL RECOURRY, 1	UW END OF ROTUNDA
DEMOLOTION SITE.	<u>.</u>	
For pipe provide: Total linear	feet <u>N/A</u> a	nd pipe size <u>N/A</u>
For other materials provide: Tot	al square feet: 40 5Q	FT
Type of ACM: TSI DEBR	15	
Start Date: 8 SEPT 1990		n Date: 8 SEAT 1999
Methods to Control Emissions:	WET METHODS	
Give name of Contractor of Subco	ontractor:	
Name: ROSE CITY	CONTRACTING	INC.
Address: <u>8900 S.U</u>	U. BURNHAM RA	. ≠ E-3
City: TIGARD	State: OR.	<u>Zip: 97223</u>
Phone: (503) 624-6	6527 Contact person:	
Name of Monitoring Lab: THR	EE RIVERS ENVIOR	LUMENTAL
Anticipated Disposal Site: HILL	SBORD LANDFIL	L, HILLSBORD OR.
Supervisor in charge of job:		•
Project Manager: ROBERT 1	MONTGOMERY	
Name:	Date: <u>56AT 8 - 99</u>	Phone (50 3) 557-2396
Asbestos Program Manager:	JOE SIMMONS	
Name:	Date	Phone: 638-8869

Attach pre-abatement and post-abatement air sample results



Air Sample Analysis Report

West Linn-Wilsonville School Disrict TRE JOB NO: 1020-64

ATTN: Joe Simmons P.O. NO: Verbal

CONTRACTOR: Rose City Contracting

REPORT NO:

PROJECT: West Linn High School

PAGE NO: 1 OF 1

Asbestos Material Recovery

Construction Site

Methodofanalysis: NiOSi	17400 Limit	of Detection: 5.5 Fibers;	Limitof Quantificat	tion: 10.0 fibers: Specif	ication Range: 100-	:f/mm2<1300
SampleIDN:cc	1	Sample IDNo:	2	Sample!DNc:	B 1	SampleIDNo

9/8/99

Laboratory Not RM99-0818 Laboratory Nov RM99-0817

LakuranyiNa RM99-0819

B2 Laboratory No. RM99-0820

Sample Location: Jose Rodriguez 613-92-5726 EL

Sample Location Jose Rodriquez 613-92-5726 P

Sample Location: Blank

Sample Location: Blank

WorkPerformed Asbestos debris 1/2 face clean-up

WorkPerforment Asbestos debris 1/2 face clean-up

DateSampled

WorkPerformed N/A

DateSampled

WorkPerformed N/A

Date Sampled

PumpNo:

DateSampled 9/8/99 Sampled by: R. Montgomery

Sampled by: R. Montgomery

Sampledby: R. Montgomery

9/8/99

Sampled by: R. Montgomery

9/8/99

PampNox LV-06 Start Time: 15:50 PampNo LV-06 StartTime: 16:25

PumpNo N/A Start Time: N/A

N/A Start Time: N/A

Stop Time: 16:20 Minutes Sampled: 30

Stop Time: 17:10 Minutes Sampled: 45

Stop Time: N/A Minutes Sampled: N/A SkopTime N/A MinutesSampled N/A

Start Flow Rate: (LPM) 2 Stop Flow Rate: (LPM) 2

Start Flow Rate (LPM) Stop Flow Rate (LPM) Start Flow Rate: (LPM) N/A Stop:FlowRate:(LPM) N/A

Start Flow Rate: (LPM) N/A StopFlowRate (LPM) N/A

Average Flow Rate: (LPM) 2 Volume: 60

Average Flow Rate (LPM) 2 Volume: 90 L

Average Flow Rate (LPM) N/A Volume N/A L

AverageHowRate(LPM) N/A

L

9/8/99

Date Attalyzed 9/8/99

Date Analyzect 9/8/99 Granicule Field Asea

Volume N/A Date Analyzed:

Granicule Field Area: 0.00817 Total Fibers 101.5/43

Total Fibers 38*.5*/100

0.00817

f/cc

GezticuleFieldAuer 0.00817 Total Fibers: 0/100

9/8/99

GraticaleFieldArea 0.00817Total Fibers

Coefficient of Variation: 0.26Fibers/cc 1.85 f/cc

Coefficient of Variation: 0.37

0.20

Coefficient of Variation: N/A Fibers/cc N/A f/cc

0/100'Coefficient of Variation: N/A Fibers/cc: N/A f/cc

Abbeviolions

AP-Areasample prior to abatement, AD-Areasample during abatement, C Clearance, P-Personal sample from breathing zone, FL-Excursion limit, NAE-Negativesireshuust, PA-postabatementateasample, BG-Background, LOQ-Limitof Quantification, LOD-Limitof Detection

Date Analyzed

Comments

Analyzedby: Robert Montgomery

Fibers/cc:

THREE RIVERS ENVIRONMENTAL

PROJ. No: 1020-64

DATE: 9-8-99 Pg. 1 of 2

See air monitoring reports of this date 1

ASBESTOS PROJECT CHECKLIST

PROJECT NAME: WEST LOW HILH SCHOOL.	PROJ. MGR: ROBERT C. MONTBOOMERY
RECOURLY OF ALL DEBEIS	ON SITE: <u>/530</u> OFF SITE:
OWNER PROVIDED ON-SITE CONTACT: NAME: TOB SIMMONS	CONTRACTOR: ROSE CITY JUC. SUPERVISOR: PODE RODE PODE TOUEZ
Intent to remove ACM on site and complete? Date Pre-abatement samples taken: Disposal site: HILLS BORD WANFILL	PERSONNEL & CORRECTION REQUIRED NO YES WORKER PROTECTION ADEQUATE: () ()
AREA ISOLATION CORRECTION REQUIRED NO YES	PERSONAL AIR MONITORS USED: PROTECTIVE CLOTHING: PERSONNEL USING DECON: EQUIP. MAINTAINED PROPERLY: WETTING, PRIOR & DURING: EXCESSIVE DEBRIS: () () () () () () () () () (
BARRICADES & SIGNS: () () AIRLOCKS: () A/A () COVERINGS ON FLOORS & WALLS: () D/A () NON-MOVABLE EQUIP. COVERED: () A/A () ALL OPENINGS SEALED: () A/A () AIR HANDLING EQUIP. OFF/SEALED: () N/A ()	BAGGING OPERATION: NEGATIVE AIR ADEQUATE: DECON ADEQUATE: CLEAN ROOM ADEQUATE: SHOWER FILTERED AND ADEQUATE: Respiratory Protection in use: 1/2 Face (Full Face () PAPR () Type C ()
PROJECT MAN	NAGEMENT LOG
1530: OU SITE AT WEST LIND HILUS TWILL SHOW THE ABATEMENT	CREW THE AREAS TO BE CLEANED OF 17,
1545: SHOWED THE CREW WHAT IT IS USING WET METHODS TO CONTROL BALS.	THAT WE ARE RECOVERING, THEY ARE THE AB AND DEPOSITING IT IN LARGE
1550: CALIBRATED STARTED JAMPE / OR REDALDO LOPEZ 15 THE OTHER	U LV-Db, JOSE CODZIOUEZ 15 BEING MODITORES.
THE ASBESTOS CLEAN-UP	OSE CITY ALSO PERIUED TO ASSIST IN

SIGNATURE ROBERT C. MODICOMERY

and the	مالم		PROJ. No: 1020-64
Marie .		,•	DATE: 9-8-99 PR. 2 JF 2
سالت	The state of the s	•	See air monitoring reports of this date
	THREE RIVERS	PROJECT MANAGEMENT L	
	ENVIRONMENTAL	ASSISTANCE OF THE	
	1630: I EULISTED THE	A 20'X 10' AREA 8	-12" DEED IN THE
	AREA WHICH EXPO	SED AT LEAST 1/2 BA	16 FULL OF STOS WHICH
	THE EXPOSES A	LE CREW 15 NOW CLEA	WING UP THE REST OF
	1700 L L IN FORMED THE	E TRACK HOE OPERATOR WAS PECOUERFA AND	F INGE CLUMPS
	COME UP DURI		DECEM US AND WED
	TAKE CARE O	FIT	·
	1000 CALIBRATED / JA	MALE #2 BEFORE PEN	MOUING THE SAMPLE
	FROM LV-06.	JUFORMED THE CLEI	U WE WOULD MEET AT
	G-DAE ON FRITTI		
	17 S: DEANLIED THE	HIGH SCHOOL.	
164		**************************************	
NY.	£	<u>*************************************</u>	
			· · · · · · · · · · · · · · · · · · ·
	e.		
		<u> </u>	
Karata Karata			
	3		
	<u> </u>		
	<u> </u>		
	•		· · · · · · · · · · · · · · · · · · ·
		<u> </u>	
	M		:
			A Court
		SIGNATURE	det Wantonion 1
	And the second s		PORCAT C. M. PTIME BU

P.O. Box 216 Claristone, OR 97027 (503) 557-2396 Fax 557-3025

ASBESTOS ABATEMENT SUMMARY Work Order No.: 1020-80

Job Location: West Linn High Sch	<u> 1001 </u>	Floor: 1st	
Project: Removal of approxi	mately 25' of TSI & 5 ha	rd fittings	
For pipe provide: Total linear i	feet <u>25</u>	_ and pipe size	4"
For other materials provide: Tota	l square feet:		
Type of ACM: TSI		· - , ···,	
Start Date: 10-29-99	Compl	etion Date:	10-29-99
Methods to Control Emissions:	Enclosure (glove bags	& HEPA vac)	
Give name of Contractor of Subcor	ntractor:		
Name: Insulation R	emoval Corporation	···	
Address:19645 S.E.	Sunnyside Rd.		
City: Boring	State: Oregon	1	Zip: <u>97009</u>
Phone: (503) 658-6608	Contact person	n: <u>JulieA</u>	nn A.
Name of Monitoring Lab:	Three Rivers Environ	mental, Inc.	
Anticipated Disposal Site:	Northern Wasco Cour	nty Landfill	
Supervisor in charge of job:	Lizauro C. Rodriguez	<u> </u>	
Project Manager:			
Name: <u>Irvin Jones</u>	Date:10-29-99	Phone:	: <u>(503) 557-2396</u>
Asbestos Program Manager:	West Linn-Wilsor	ıville School Di	strict 3Jt
Name: <u>Joe Simmons</u>	Date:10-29-99	Phone:	: <u>(503) 673-7013</u>

Attach pre-abatement and post-abatement air sample results

Air Sample Analysis Report

THREE RIVERS
ENVIRONMENTAL, Inc.

CLIENT: West Linn-Wilsonville School District TRE JOB NO: 1020-80

ATTN: Tim Woodley P.O. NO: Verbal

CONTRACTOR: Insulation Removal Corp. REPORT NO: 1

PROJECT: West Linn High School PAGE NO: 1 OF 2

TSI & H.F. Pipe Insulation Rmvl.

Sample IDN or 1	SampleIDNo: 2	SampleiDNox 3	SampleIDNo: B	
Laboratory Nix IJ99-0416	LuboratoryNo: 1J99-0417	LaboratoryNor LJ99-0418	LaboratoryNo. UJ99-0419	
Sample Location S.W. corner of mezzanine BG	Sample Location: Center of containment AD	SampleLocation S.W. corner of mezzanine AD	Sample Location Blank	
WorkPerionment N/A	WorkPerformed N/A	WorkPeriormed N/A	WorkPerformed: N/A	
Date-Samplect 10/29/99	DateSampled: 10/29/99	DateSampled: 10/29/99	DateSampled 10/29/99	
Sampledby: I. Jones	Sampled by: I. Jones	Sampledby: I. Jones	Sampledby: I. Jone	
PampNα HV-23	PumpNix HV-22	PumpNa HV-23	PumpNot N/A	
Sant firme: 19:00	StartTime: 20:20	StartTime: 21:00	Start Time: N/A	
Stop Time: 21:00	Stop Time: 22:20	Stop Time: 22:30	Stop Time: N//	
MinutesSampled: 120	MinutesSampled 120	MinutesSampled 90	MinutesSampled N/A	
Start Flow Rate: (LPM) 10	Start Flow Rate (LPM) 10	Start Flow Rate (LPM) 10	Start Flow Rate (LPM) N//	
Stop Flow Rate (LPM) 10	StopFlowRate (LPM) 10	StopFlowRate (LPM) 10	StopFlowRate(LPM) N//	
Average Flow Rater (LPM) 10	Average Flow Rate (LPM) 10	Average FlowRate: (LPM) 10	Avenge Flow Rate (LPM) N/A	
Volume 1200 L	Volume 1200 L	Volume 900 L	Volume N/A L	
Date Analyzext 10/29/99	Date Analyzect 10/29/99	Date Analyzect 10/29/99	Date:Analyzed [0/29/9	
Genicule FieldAren 0.00817	GraticuleFieldAtea: 0.00817	GraticaleFieldArex 0.00817	CarticuleFieldAtea 0.0081	
Total Fibers: 8/100	Total Fibers: 9.5/100	Total Fibers: 5.5/100	Total Fibers: 0/10	
Coefficient of Variation: LOQ	Coefficient of Variation: LOQ	Coefficient of Variation: LOQ	Coefficient of Variation: N/	
Fibers/00: <0.0039 f/ec	Fibers/oc: <0.0039 f/ee	Fibers/cc: <0.0052 f/ee	Fibers/cc: N/A f/c	

Abbreviations

AP-Areasomple prior to abatement, AD-Areasomple during abatement, C-Clearance, P-Personal sample from breathing zone, EL-Excutsion limit, NAE-Negative air extraust, PA-post abatement areasomple, BG-Background, LOQ-Limit of Quantification, LOD-Limit of Detection

Comments < Sample calculated at Limit of Quantification (10 fibers/100 fields)

Analyzedby: Irvin Jones

THREE RIVERS ENVIRONMENTAL, Inc.

Air Sample Analysis Report

CLIENT: West Linn-Wilsonville School District TRE JOB NO: 1020-80

ATTN: Tim Woodley

P.O. NO: Verbal

CONTRACTOR: Insulation Removal Corp.

REPORT NO: {

PROJECT: West Linn High School

PAGE NO: 2 OF 2

TSI & H.F. Pipe Insulation RmvI.


Sample!DNo: B2	Sample IDNo:	SampleIDNix		SampleIDNo	
LaboratoryNox IJ99-0420	LaboratoryNo	LaboratoryNox		Laboratory No:	
Sample Location Blank	Sample Location:	Sample Location:		Sample Location:	
WorkParliamed N/A	Work Performent	WorkPerforment		Worki Parformed	
DateSimpled: 10/29/99	DateSampled:	DateSampled		DateSampled	
Sampled by: I. Jones	Sampled by:	Sampled by:		Sampled by:	
PumpNox N/A	PumpNa	PumpiNce		PumpNa	
Start Time: N/A	SanTime:	StartTime		StartTime:	
Stop Time: N/A	Stop Time:	Stop Time:		Stop Time:	
MinutesSorrpieci N/A	MinutesSamplect	MinutesSampled:		MinutesSampled	
Start How Rate (LFM) N/A	Start Flow Rate (LPM)	Start Flow Rate: (LPM)		Start How Rate (LPM)	
Stop Flow Rate (LPM) N/A	StopFlowPate (LPM)	StopFlowRate (LPM)		Stop Flow Rate: (LFM)	
Average Flow Rate (LPM) N/A	AveageFlowRate (LPM)	Average Flow Rate: (LPM)	<u> </u>	AverageHowRate (LPM)	
Volume: N/A L	Volume: L.	Volume	L	Volume	L
Date Arraityzext 10/29/99	Date Amilyzed	DateAnalyzed		Date Analyzed	
Graticule Field Area: 0.00817	Graticule Field Area	Graticule Field Arex		Ciraticule Field Area:	
Total Fibers: 0/100	Total Fibers	Total Fibers:		Total Fibers:	
Coefficient of Variation: N/A	Coefficient of Variation:	Coefficient of Variation:		Coefficient of Variation:	
Fibers/cc: N/A f/cc	Fibersicc f/	cc Fibers/cc:	f/cc	Fibers/cc:	f/c


AP-Areasample prior to abutement. AD-Areasample during abutement, C-Clearance, P-Personal sample from breathing zone, EL-Excussion limit NAE-Negative airextraust. PA-postabatement areasample, BG-Background, LOQ-Limitof Quantification, LOD-Limitof Detection

Comments


Analyzedby: Irvin Jones

POSSIBLE RESPONSE ACTIONS

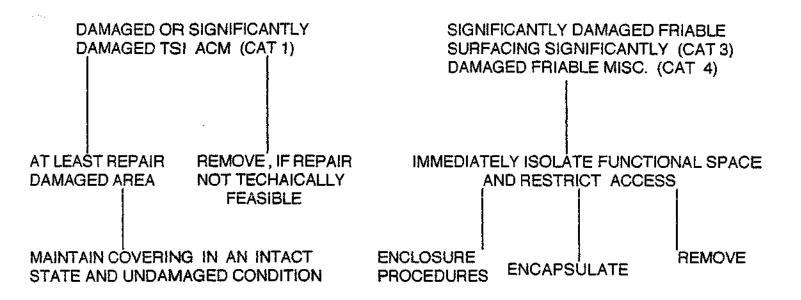

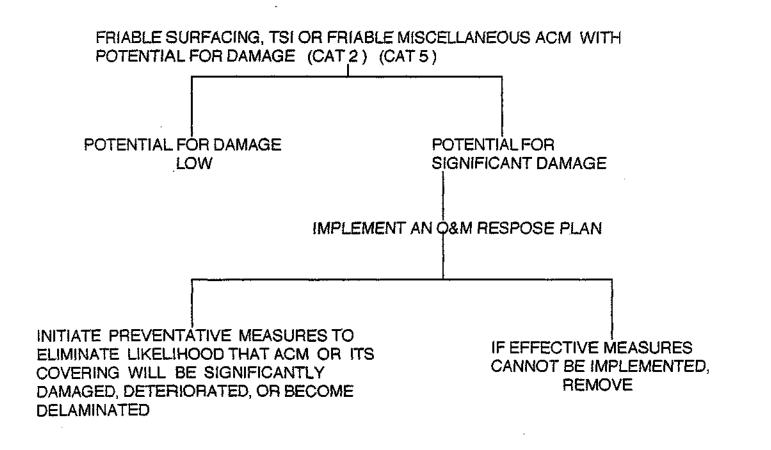

AMAGED FRIABLE SURFACING OR DAMAGED FRIABLE MISC. ACM (CAT 2) (CAT 7)
ENCLOSURE ENCAPSULATION REMOVAL REPAIR

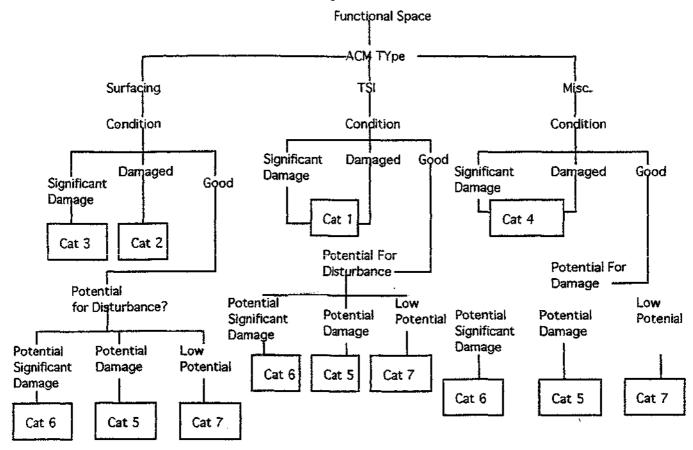

Physical Assement Categories

Cat 1 : Damaged or Significatly damaged thermal system insulation ACBM

Cat 2 : Damaged friable surface ACBM

Cat 3 : Significantly damaged friable surfacing ACBM

Cat 4 : Damaged or significantly damaged friable miscellaneous ACBM

Cat 5 : ACBM with potenial for damage

Cat 6 : ACBM with potential for significant damage

Cat 7 : Any remaining friable ACBM or friable suspected ACBM

SMALL SCALE SHORT DURATION

This section reflects requirements outlined in 40 CFR 763.91 and 763.95

The idea of small scale, short duration projects are jobs involving small quantities of asbestos. Generally, these are projects where the primary intent is not to disturb asbestos and if disturbed, worker exposure levels are not to exceed the PEL (0.1 f/cc).

DEQ/EPA

DEQ described small scale short duration activities as maintenance work that does not require a certified supervisor to oversee the work. IF the maintenance work is less than 3 square or 3 linear feet of friable material at any one time then certification is not required, nor is notification to the Department. (OSHA still requires some training).

DEQ does require that all persons disturbing asbestos be certified if they are not doing maintenance work and/or they disturb more than 3 square or 3 linear feet of friable material at any one tie.

DEQ/EPA defines "small scale short duration activities" means a task for which the removal of asbestos is not the primary objective of the job, is less than 3 square or 3 linear feet, including, but not limited to:

- removal of small quantities of insulation on beams or above ceilings;
- replacement of a gasket on a valve;
- installation or removal of a small section of wallboard;
- removal of thermal system insulation not to exceed amounts greater than those which can be contained in a single glove bag.
- minor repair to damaged thermal system insulation which does not require removal
- repair to wallboard;
- replacement of a gasket on a valve:
- repair involving encapsulation, enclosure or removal, to small amounts of friable material in performance of emergencies of routine maintenance activity and not intended solely as asbestos abatement. Such work may not exceed amounts greater than those which can be contained in a single prefabricated mini-enclosure. Such an enclosure shall conform spatially and geometrically to the localized work area, in order to perform its intended containment function.

AHERA (schools K-12) defines small scale job according to EPA's definition listed above. Those activities that will fit inside a single glove bag or mini-enclosure; no more then 3 square or 3 linear feet of ACM. Neither a supervisor or clearances are required, but it does need to be recorded.

OR-OSHA/OSHA

OR-OSHA does not really have a definition for small scale short duration activities that would be recognized as such by DEQ. OR-OSHA's versions of small scale short duration/maintenance activities could be classified as Class III, Class I, or Class II asbestos work.

IF a person is doing maintenance activities then it is **Class III** asbestos work. If a worker intends to disturb TSI or surfacing material, but it is not the primary purpose of the work, then they must use the general work practices outlined OR-OSHA asbestos rules 1926.1101 (g) (9).

- A competent person-who has complete a minimum 16-hour/AHERA type course. (However we are still bound by the DEQ that if we disturb more than 3 square/linear feet then certified supervisor/workers must be used.)
- OR-OSHA specifies that the following work procedure s can be used:
 - standard glovebags on straight runs of piping
 - negative air glovebags
 - negative air glove boxes
 - water spray process systems
 - negative air mini-enclosure
 - approved alternate methods
- OR-OSHA still requires than an adjacent equipment room or area to the regulated area be available for the decontamination of employees and their contaminated equipment. The area needs to be of appropriate size so as not to spread contamination and the floor covered with an impermeable drop cloth. A three chamber decontamination unit/hygiene facility is not required as long as the total work involves less than 25 linear or 10 square feet.

If a person intends to disturb TSI or surfacing material, then it is **Class I** as bestos work regardless of the size of the project. The worker must use the work practices outlined OR-OSHA as bestos rules 1926.1110 (g) (4) & (5).

- A competent person/a supervisor-who has completed an EPA/DEQ five day supervisor course.
- OR-OSHA specifies that the following work procedures can be used:
 - negative pressure exposure (NPE)
 - standard glovebags on straight runs of piping
 - negative air glovebags
 - negative air glove boxes
 - water spray process systems
 - negative air mini-enclosure
 - approved alternate methods
 - a three-chamber decontamination unit/hygiene facility is not required as long as the total work involves less than 25 linear or 10 square feet. An adjacent equipment room or area to the regulated area must be available for the decontamination area.

If a person intends to disturb asbestos material that is not TSI or surfacing material, the it is Class II asbestos work regardless of the size of the project. This includes flooring (vinyl, sheet vinyl, asphalt), roofing (shingles built-up, felts), cement asbestos (transite), gaskets, wallboard, construction mastics, etc.

- A competent person/a supervisor-who has completed an EPA/DEQ five day supervisor course. (However DEQ does not require a certified supervisor if the material is kept non-friable.)
- The worker must use the general work practices outlined OR-OSHA asbestos rule 1925.1101 (g) (7) & (8).

An adjacent equipment room or area to the regulated area must be available for the decontamination area. A three-chamber decontamination unit/hygiene facility is not required.

7. OPERATIONS AND MAINTENANCE PLAN

TABLE OF CONTENTS

I. INTRODUCTION	
II. DEFINITIONS	. 1
III. PROGRAM ELEMENTS	
A. WORKER PROTECTION B. TRAINING C. INITIAL CLEANING D. ADDITIONAL CLEANING E. OPERATIONS AND MAINTENANCE ACTIVITIES F. WASTE DISPOSAL G. RECORDKEEPING H. WARNING LABELS I. BUILDING INVENTORY J. PERIODIC SURVEILLANCE K. EMERGENCY RESPONSE L. EQUIPMENT LIST M. AIR MONITORING PLAN N. MEDICAL MONITORING O. O&M CODES	. 3 . 3 . 7 . 8 . 9 . 9 . 9 . 11 11

IV. FORMS

L INTRODUCTION

With the enactment of the Asbestos Hazard Emergency Response Act regulations, Local Education Agencies are charged with producing a plan of action that will facilitate the safe and effective management of asbestos materials in their school systems. The most effective way of managing the problem is to completely remove all asbestoscontaining materials from the building, thus removing the problem in its entirety. In some cases, however, this wholesale removal is not economically feasible or even desirable from a building usage standpoint. When asbestos-containing materials can not be completely removed, a comprehensive Operations and Maintenance Program as required by 40 CFR 763.91 will allow the local education agency to control the asbestos problem until removal of the materials is feasible.

II. DEFINITIONS

Several definitions pertinent to an Operations and Maintenance Program are identified in 40 CFR 763.83. These are as follows:

Asbestos-Containing Material (ACM) when referring to school buildings means any material which contains more than one percent asbestos.

Asbestos-Containing Building Material (ACBM) means surfacing ACM, thermal system insulation ACM, or miscellaneous ACM that is found in or on interior structural members or other parts of a school building.

Asbestos Debris means pieces of ACBM that can be identified by color, texture, or composition: or means dust, if the dust is determined by an accredited inspector to be ACM.

Operations and Maintenance Program means a program of work practices to maintain friable ACBM in good condition, to insure cleanup of asbestos fibers previously released, and to prevent further release by minimizing and controlling damage to friable ACBM.

Fiber Release Episode means any uncontrolled or unintentional disturbance of ACBM resulting in visible emissions.

Enable, when referring to material in a school building, means that the material, when dry, may be crumbled, pulverized, or reduced to powder by hand pressure, and includes previously non-friable material after such previously non-friable material becomes damaged to the extent that, when dry, it may be crumbled, pulverized or reduced to powder by hand pressure.

High-Efficiency Particulate Air (HEPA) refers to a filtering system capable of trapping and retaining at least 99.97% of all non-dispersed particles 0.3 millimeters in diameter or larger.

Ramoval means the taking out or the stripping of substantially all ACBM from a damaged area, a functional space, or a homogeneous area in a school building.

Repair means returning damaged ACBM to an undamaged condition or to an intact state so as to prevent fiber release.

Response Action means a method, including removal, encapsulation, enclosure, repair, operations and maintenance, that protects human health and the environment from friable ACBM.

Routine Maintenance Area is an area, such as a boiler room or mechanical room, that is not normally frequented by students and in which maintenance employees or contract workers regularly conduct maintenance activities.

III PROGRAM ELEMENTS

A. WORKER PROTECTION

40 CFR 763.91(b) serves to extend the protection provided by 40 CFR 763.121 (for worker protection during asbestos abatement projects) to employees of local education agencies who perform Operations and Maintenance and repair activities involving ACM who are not covered by the OSHA Asbestos Construction Standard 29 CFR 1926.58. This standard will be adhered to during all Operations and Maintenance or repair operations involving the disturbance of friable ACBM.

During initial cleaning (and additional cleaning as necessary) of all buildings, those employees performing the cleaning will be supplied with and will use the following personal protective equipment:

<u>Disposable Coveralls</u> - a "Tyvek" brand or similar disposable coverall will be worn over the clothes to prevent capturing asbestos fibers on the clothing.

Respirator - an individual personalized respirator will be provided to all workers doing the cleaning. The respirator will be appropriately fit-tested to ensure that it functions effectively for that individual. Each respirator will be supplied with disposable cartridges approved for asbestos dust by NIOSH and will be worn at all times during the cleanup operation.

Following cleanup each day, all used disposable respiratory cartridges and coveralls will be disposed of in six-mil asbestos disposal bags.

B. TRAINING

Prior to the implementation of any Operations and Maintenance provisions of the Management Plan, all members of the maintenance and custodial staff who, during the performance of their duties, may work in a building containing ACBM will receive general awareness training of not less than two hours in duration. As well, similar training will be given to all new maintenance/custodial personnel within 60 days of their start date. As per 40 CFR 763.92 (a)(i-v), the accepted course for this level of training is "Developing an Operations and Maintenance Plan" given by Hall-Kimbrell Environmental Services, Inc., 4840 West 15th Street, Lawrence, Kansas, 66044, and will include as a minimum:

- Information on asbestos, its forms, and uses.
- Information on the health affects of asbestos exposure.
- Locations of ACBM in the school buildings in which they work.
- Recognition of damage, deterioration, and delamination of ACBM.

- Name and telephone number of the LEA person designated to carry out LEA responsibilities under 40 CFR 763.84.
- Availability and location of the Management Plan.

All members of the maintenance/custodial staff who are likely to conduct any activities that may disturb ACBM will receive the previously described general awareness training and an additional 14 hours as required by 40 CFR 763.92 (2)(i-iv). The accepted course for this level of additional training is "Operations and Maintenance Training" given by Hall-Kimbrell Environmental Services, 4840 West 15th Street, Lawrence, Kansas, 66044, and will include as a minimum:

- Descriptions of proper methods of handling ACBM,
- Information on the use of respiratory protection as contained in the EPA/NIOSH Guide to Respiratory Protection for the Asbestos Abatement Industry, September 1986 (EPA 560-OPTS-86-001), and other personal protective equipment and measures.
- The provisions of the following pieces of legislation:
 - 40 CFR 763.91, Appendices A, B, C,
 D of Subpart E
 - EPA regulations in 40 CFR Part 763.
 Subpart G
 - EPA regulations in 40 CFR Part 61, Subpart M
 - OSHA regulations in 29 CFR 1926.58
- Hands-on training in the use of respiratory protection, other personal protective equipment and measures, and good work practices.

All types of training will emphasize the necessity to not disturb ACBM or assumed ACBM during routine maintenance activities. Employees will be instructed on the following at a minimum:

 Avoid performing any activities on ACM or assumed ACM that may cause abrasion or physical deterioration of the material.
 This includes sanding, nailing, drilling, cutting, or otherwise damaging the material.

- Avoid damaging ACM during maintenance activities <u>NOT</u> directly involving the ACM such as installing drapes, carpets, moving furniture, etc.
- To always use a HEPA-vacuum and wet methods to clean up asbestos dust or debris. <u>NEVER</u> use a regular vacuum or dry method.
- To avoid any activities that may inadvertently release asbestos fibers into the air such as removing ventilation filters, drying and/or shaking the filters, and removing suspended ceiling tiles below ACM without taking the proper precautions and using the proper personal protective equipment.

C. INITIAL CLEANING

In accordance with 40 CFR 763.91, all buildings under the direction of the School District will undergo an initial cleaning process prior to commencing with any response actions, with the exception of Operations and Maintenance and detailed in the repair. as Inspection Report/Management Plan Data. The initial cleaning will be done in all areas of all buildings where friable ACBM, damaged or significantly damaged thermal system ACM, or friable suspected ACBM assumed to be ACM, were determined to be present following the completion of an inspection, sampling and analysis program performed in accordance with 40 CFR 763.85 through 40 CFR 763.87.

The following procedures will be followed for the initial cleaning of all appropriate areas of each building:

- All carpets will be HEPA vacuumed and/or steam cleaned.
- 2. All horizontal surfaces including sills, frames, door tops, wall protrusions, signs, air vents, suspended light fixtures, and other immovable fixtures will be HEPA vacuumed. Following HEPA vacuuming, the same areas will be wet cleaned in order to remove any residual fibers not picked up during the vacuuming process.
- All walls will be wet wiped, except for those with sprayed-on or trowelled-on materials or with other applications with high liquid absorption potential.

- 4. All uncarpeted floors will be wet mopped.
- 5. All debris, filters, wer mon heads, dust mops, cloths, etc., will be sealed, while still wer, in leak-tight containers. Disposal containers will be six-mil polyethylene bags labelled in such a fashion that they illustrate their usage as asbestos storage containers. These bags will be kept in a single location, in a routine maintenance area in each building and will always be kept closed and tied. When the bag becomes full, it will be tied shut and placed into another six-mil bag and tied again. Full bags will be placed in a 55gallon steel or fiberboard drum. When full, the drum will be transported to an EPA-approved asbestos landfill site and the material will be disposed of as asbestos-containing waste.

D. ADDITIONAL CLEANING

In all areas where friable ACM exists, normal daily cleaning procedures will be altered as necessary to ensure that fiber entrainment in the air will be minimized. Sweeping and dry mopping will not be allowed in areas containing friable ACM. Until all ACM is removed from ceilings, etc., all daily mopping will be carried out with dampened, disposable mop heads. These mop heads will not be used in asbestos-free areas and will be changed at the end of the day and disposed of as asbestos-contaminated waste in six-mil polyethylene disposal bags. In addition, certain areas will receive additional cleaning on a regular basis as per the O&M supplement at the end of this section.

E. OPERATIONS AND MAINTENANCE ACTIVITIES

 Small-Scale, Short Duration Activities and Minor Fiber Release Episodes

Appendix B to Subpart E of 40 CFR 763.91 defines small-scale, short duration maintenance activities as, but not limited to:

- Removal of ACM insulation on pipes
- Removal of small quantities of ACM insulation on beams or above ceilings
- Removal of ACM gaskets on a valve

- Removal or installation of a small section of drawall
- Installation of electrical conduits through or proximate to ACM.

Small scale is further subdefined in Appendix B of Subpart E as:

- Removal of small quantities of ACM only if required as part of maintenance activity not intended as asbestos abatement
- Removal of ACM thermal system insulation in quantities no greater than can be contained in one glove bag
- . Minor repairs to damaged thermal system insulation requiring no removal.
- Repairs to ACM wallboard
- Repairs involving encapsulation, enclosure, or removal, to small amounts of friable ACM only if required in performance of an emergency or a routine maintenance activity not intended as asbestos abatement. The work may not exceed amounts greater than those which can be contained in a single prefabricated mini-enclosure. This enclosure must conform spatially and geometrically to the localized work area, in order to perform its intended containment function.

Section 40 CFR 763.91 (f)(i) defines a minor fiber release episode as the falling or dislodging of less than or equal to three square or linear feet of friable ACBM.

During the process of performing small-scale, short duration asbestos renovation or maintenance tasks, the following procedures will be utilized:

- The area will be isolated with physical barriers, whenever possible, restricting entry only to those persons necessary to perform the task. Warning signs will be posted at all entry points to the area.
- All HVAC ducts, windows, and other sources of air circulation to the area will be sealed. Where necessary, the air handling systems will be shut off or modified to meet this need.
- If a fiber release has occurred, the entire area will be precleaned using those techniques described in Section C. under

initial Cleaning. HEPA vacuum and/or wet methods will always be employed for any type of cleaning. All workers directly involved with the cleaning will always use the prescribed personal protective equipment.

- All objects in the area will be removed from the area to protect them from contamination during the maintenance activity. Where it is not possible or feasible to move the objects, the objects will be completely covered with six-mil polyethylene plastic sheeting prior to commencement of the maintenance activity. This will include all fixtures and other components that exist in the immediate work area.
- Next, a layer of six-mil polyethylene plastic sheeting will be placed on the floor beneath the item or area affected by the maintenance activity. This sheeting will be at least one foot wide and long for each foot above the floor where the work is to be conducted, but will not under any circumstances, be less than six feet by six feet. When the work area is confined by walls, the plastic sheeting will extend up the walls at least one foot, and will be sealed along the top edges with duct tape.
- All work activities involving the ACM will be performed using wet methods, HEPA vacuums, glove bags, mini-enclosures, and/or protective clothing as appropriate to the maintenance activity. These methods are detailed in Section E-3 of Operations and Maintenance Activities.
- All repair work done on the damaged or affected ACM will be done with materials such as asbestos-free spackling, plaster, cement, or insulation. The existing ACM affected by the maintenance activity will be sealed with latex paint or an encapsulant, or the appropriate response action as identified in the Management Plan will be implemented.
- All asbestos-containing debris will be saturated with amended water and sealed in double six-mil polyethylene disposal bags. These bags will be labelled as ACM and will be disposed of at an EPA

approved landfill site. All plastic, duct tape, etc., used to cover objects, floors, etc., will be treated as asbestos-contaminated waste and will be disposed of in like manner.

 Maintenance Activities other than Small Scale, Short Duration and Major Fiber Release Episodes.

Section 40 CFR 763.91 (f)(2) defines a major fiber release episode as the falling or dislodging of more than three square or linear feet of friable ACM.

For those maintenance activities other than small scale, short duration or for a major fiber release episode, all response actions will be designed by persons accredited to design response actions and conducted by persons accredited to conduct response actions.

Regardless of the response action designed for the specific activity or repair, the areas involving the work will be sealed off and restricted with signs posted, and prepared for the work in a manner consistent with the procedures outlined for small-scale short duration activities in Section E-1 of Operations and Maintenance Activities.

3. ACM Removal Procedures

a. Wes Methods.

Regardless of the removal method employed, wet methods will always be used where practical during any maintenance activity that involves the disturbance of ACM. In some cases, wet methods will not be employed (working on live electrical equipment, for example) and this will be determined prior to the commencement of the activity.

At all times, amended water will be used as the wetting agent. Amended water is water that has a surfactant added that restricts evaporation and enhances the penetration of the water into the ACM. Commercially available products such as those containing a concentrate of a 50-50 mixture of polyoxyethylene esters and polyoxyethylene ethers with three percent emulsifier will be used. These products

will be added to normal tap water and used as per manufacturer's instructions.

Amended water will be applied to all ACM using an airless sprayer to minimize disturbance of the ACM. During the maintenance or repair activity, the material will continue to be wetted, as needed, to ensure that all ACM is wet during the activity and remains wet until final disposal.

b. Giove Bag Techniques

The glove bag techniques will be used for removal of ACM on small scale activities mainly involving pipes, valves. Tees, fixtures, or other small components of mechanical systems as detailed in Appendix B of Subpart E of 40 CFR 763. Prior to installation and use of the glove bag, signs will be posted and the work area will be sealed off and prepared as detailed in Section E-1 of Operations and Maintenance Activities. The worker(s) performing the glove bag operation will be equipped with a disposable Tyvek-type suit and a personal respirator equipped with disposable cartridge filters NIOSH approved for use with asbestos dust.

After performing all preparatory work and donning personal-protective equipment, the glove bag is cut along the sides to fit around the pipe or fixture to be worked on. All tools necessary to perform the work, as well as a quantity of bridging encapsulant, are inserted into the attached inside pocket of the bag.

The giove bag is then attached around the work area by folding the open edges together and sealing with staples and tape. The side edges of the glove bag are then sealed using duct tape and/or Velcro ties to form a tight seal. The bottom seam of the bag is also taped to ensure its integrity. Once a tight seal is obtained, the end of a smoke tube is inserted through the marked entry port and a small amount of smoke is squeezed into the bag. After tape sealing the port (and removing the smoke tube), the bag is gently squeezed to allow the smoke to exit through any available leak holes. Leaks identified in this way are sealed with more duct tape, the entry port is opened, and the bag is squeezed lightly to remove excess smoke. Next, the portable sprayer nozzie is put through the port and the work area is completely wetted with amended water. The nozzie is removed and the HEPA vacuum hose is inserted into the port and sealed tightly with duct tape.

The worker's arms are inserted into the armholes and gloves and the ACM is removed from the work area. When necessary, the amended water spray nozzle is inserted into the bag during removal to ensure that the ACM is kept wet at all times.

When all necessary ACM is removed and the item cleaned of all visible material, a spray nozzle from the encapsulant sprayer is inserted and the pipe fixtures, etc., are sprayed with encapsulant. The rough edges of the cut ACM are then coated/sealed with the bridging encapsulant.

The worker then removes his arms from the armholes and turns on the HEPA vacuum, to remove air from the bag. As the air is being removed from the bag, the bag is squeezed near the top, and twist sealed and taped closed. The HEPA vacuum is turned off, the nozzle removed, and the entry port is sealed tightly. Then the bag is cut along the top and removed from the working area, then placed in a six-mil polyethylene bag for disposal with other contaminated waste materials.

c. Mini-Enclosures

This methodology is employed in areas where glove bags are not practical, such as for the removal of asbestos from a small ventilation system or a short length of duct as detailed in Appendix B of Subpart E of 40 CFR 763.

The mini-enclosure will vary in construction, shape, and size, depending upon the specific requirements of an individual activity. In general, all mini-enclosures will be constructed according to the following criteria:

 The structure will consist of six-mil polyethylene plastic sheeting supported by a preconstructed framework of 2" by 4" studs formed around the work area. The plastic will be stapled and taped to the framework. Two layers of sheeting will be used, one attached to the studs on the inside of the minienclosure and the other on the outside.

- The structure will be minimized in size so as to allow entry to only the number of workers directly involved with the maintenance activity.
 Where possible, the number of workers will be restricted to one or two maximum.
- The floor inside the mini-enclosure will be covered with two layers of sixmit plastic and will extend no less than one foot up each wall where it will be tape sealed to the wall's plastic. All penetrations into or through the mini-enclosure, such as pipe runs, will be sealed with duct tape.
- A small change room (approximately three feet by three feet by seven feet) will be constructed contiguous to the mini-enclosures. Entry to the change room and from the change room to the mini-enclosure will be through double plastic-sheeted entryways. The first layer of plastic in the entryway will be sealed to the doorway at the top and on the right side, the second layer will be sealed at the top and on the left side.
- After completing the maintenance or repair activity, the worker will enter the change room. HEPA vacuum his disposable coveralls, and remove them prior to leaving the change room. He will then wet wipe his respirator, leaving it on until exiting the change room.
- During the ACM removal, the workers will protective wear cartridge coveralls and dual NIOSH-rated respirators Wet methods of asbestos dust. removal using amended water will be used at all times in the minienclosure. As in glove bag removal,

following the removal of ACM the working areas will be sprayed with encapsulant and exposed cut ACM will be coated with a bridging encapsulant when appropriate.

- Next, all debris in the mini-enclosure will be placed in double six-mil polyethylene bags labelled appropriately for disposal of ACM. The bags will be wet cleaned before removal from the work area through the change room. All interior surfaces of the mini-enclosure will then be cleaned using HEPA vacuum and or wet cleaning techniques.
- Inside the mini-enclosure, the air will be sprayed with water using an airless sprayer. The worker will start at the top and spray the entire volume down to the floor level in order to remove any airborne asbestos fibers prior to dismantling the mini-enclosure.
- The worker will then proceed to the change room and HEPA vacuum his coveralls and clean and spray the room in the same fashion as the mini-enclosure. He will then wet wipe his respirator while still wearing it, HEPA-vacuum and remove his coveralls, and exit the change room.
- The mini-enclosure will then be dismantled from the outside by removing the plastic and bundling it inwards, rolling it, and placing it in a six-mil bags, labelled for asbestoscontaminated waste and disposed of appropriately. The 2" by 4" studs will be dismantled and stored for further use.
- Following the dismantling of the mini-enclosure the worker removes his respirator and disposes of the cartridges as asbestos-contaminated waste.

F. WASTE DISPOSAL

All asbestos-containing waste material is double-bagged in six-mil polyethylene plastic bags. These

bags are preprinted to show that they contain aspestos-containing material. Asbestos waste is kert in a controlled location in a routine maintenance area of the facility. Filled bags of waste are carried to this area and placed in sociable metal or fiber 55-gallon drums. When the drums are full, they are sealed, labelled, and transported to a landfill site approved for asbestos by EPA. Upon arrival at the landfill site, the bags are removed from the drums and handed over to the landfill operator. The drums are wet wiped and returned to the school for re-use. The drums are not re-used if, upon opening, it is observed that one or more of the bags has ruptured inside of the drum. In this case, the drum is resealed and disposed of along with all bags inside of it.

The waste containers are transported to the landfill site in a covered, lockable vehicle and all transported containers are accompanied by a proper chain of custody form that details the origin of the material, date and quantities of transport, types of containers and destination of containers. If transported by a third party hauler, information on the hauler is also included on the form. The chain of custody form is signed at each transfer point and after final transport to the landfill site, a copy of the form is maintained in our records as evidence of receipt at the site. A sample copy of this form is included.

Prior to any transportation of asbestos-containing material, notification will be made to the following parties:

- Regional US EPA office written notification will be sent detailing the name and location of the landfill site to be used and the approximate weight and volume of aspectos involved.
- EPA Certified Landfill Site Prior to each transport the landfill supervisor will be notified of the weight and volume of the material, the expected date and time of arrival at the site, and the types of containers to be transported.

G. RECORDKEEPING

Permanent records will be kept regarding Operations and Maintenance activities in facilities under the control of the LEA. These include:

- I. Whenever any cleaning activity as prescribed in 40 CFR 763.91 (c) is undertaken records will contain the name of the individuals performing the cleaning, the dates of the cleaning, the locations cleaned, the methods utilized, and any other information pertinent to that particular cleaning episode. A copy of the O&M Cleaning Report Form is attached.
- 2. Whenever any Operations and Maintenance activity is undertaken as outlined in 40 CFR 763.91 (d) records will contain the name and duties of each person involved; the start and completion date and time of the activity; the locations where the activity occurred; a description of the activity; preventive measures used: amount (if any) of ACM removed; and the name and location of the storage or disposal site for the ACM. A copy of the Small-Scale O&M Activity Report Form is attached.
- 3. Whenever a major activity as described in 40 CFR 763.91 (e) is undertaken, records will indicate the name, signature, state of accreditation, and accreditation number of each person involved; the start and completion date and time; the locations where the activity occurred: a description of the activity; preventive measures used; whether ACBM was removed; and the name and location of the storage or disposal site for the removed material. A copy of the Major O&M Activity Report Form is attached.
- 4. For every fiber release episode described in 40 CFR 763.91 (f), the records will detail the date, time, and location of the episode; the method of repair; preventive measures or response action taken; the names of those persons doing the work; whether ACBM was removed; and the name and location of the storage or disposal site for the removed material. A copy of the Fiber Release Episode Report Form is attached.
- Copies of all inspection reports, results and amendments will be kept in the file with the Operations and Maintenance Program and activity reports. This also includes results of any re-inspections or

- periodic surveillance as prescribed in 40 CFR 763.85 (b) and 40 CFR 763.92 (b).
- o Current lists of all custodians and maintenance personnel including name, address, date of hire, asbestos training course, and dates, as well as copies of certificates from any special related courses taken by the employees. A copy of the Maintenance/Custodial Staff Training Report Form is attached.
- 7. A current list of all areas where asbestos removal, enclosures, or encapsulation has taken place. A copy of the Asbestos Abatement Activity Record Form is attached.
- A current inventory of equipment available for Operations and Maintenance activities.
- Copies of ACM disposal records and/or chain of custody documentation.

All records will be maintained in a single location at the LEA site. Copies of all records and information pertinent to individual facilities will also be maintained at those facilities by the designated campus asbestos coordinator.

H. WARNING LABELS

Warning labels will have been attached immediately adjacent to any friable and non-friable ACBM and assumed ACM located in routine maintenance areas as per 40 CFR 763.95. The labels will be of a size, print, and color which is readily visible to persons entering an area containing ACBM. The labels will read as foilows:

CAUTION

ASBESTOS HAZARDOUS

DO NOT DISTURB WITHOUT PROPER

TRAINING AND EQUIPMENT

I. BUILDING INVENTORY - ALL ACM

See "List of School Buildings and ACM Status" in Section: Management Plan Introduction.

J. PERIODIC SURVEILLANCE

All facilities will undergo a semi-annual surveillance in order to detect deterioration taking place on any ACM in the facility. This will consist of a visual evaluation of the materials and specific records will be maintained detailing the material type, damage, or deterioration noted, as well as any repair or response action undertaken. This semi-annual surveillance will be performed utilizing the protocol defined in the "plan for periodic surveillance" in the management plan.

K. EMERGENCY RESPONSE

In the event of the occurrence of an asbestosrelated emergency in a facility under the direction of the LEA, the following procedures will be employed:

- Immediately upon notice of the emergency, the party involved will vacate the area of involvement and immediately contact the LEA Coordinator and/or his designee at the facility.
- 2. If the person(s) observing the incident is trained to handle ACM activities, that person(s) will take action to immediately isolate the area of involvement from the rest of the building by evacuating any unnecessary personnel from the area, turning off or isolating all air-moving equipment in the area, isolating the area by closing all entryways, and posting warning signs indicating the presence of a hazardous area.
- 3. If the person(s) observing the incident is not trained to handle ACM activities, that person will immediately contact a member of the staff who has the appropriate training and alert that person to the problem. The trained staff member will then proceed to take the actions indicated in 2.

- 4. If the occurrence is of such a size that a response action must be designed by an accredited designer, no further work will be done and the area will remain isolated as in 2, until the appropriate response action can be determined. Otherwise, the appropriate repair/maintenance activity will commence following the performance of the procedures detailed in Section E-1 of Operations and Maintenance Activities.
- Following completion of the repair/maintenance activities, the appropriate forms will be completed as per Section G-7 Recordkeeping. These forms will become a part of the permanent Operations and Maintenance records.

L. EQUIPMENT LIST

An Operations and Maintenance Plan involves "specialized" equipment and supplies to resolve and/or control the problems. The materials can be purchased from a number of asbestos or industrial safety supply houses and some can be found in hardware stores. The following materials and equipment are commonly associated with successful operations and maintenance planning.

OPERATIONS AND MAINTENANCE PLANNING MATERIALS AND EQUIPMENT LIST

- 1. Twek disposable coveralls
- Rubber gloves
- Half-face dual cartridge negative pressure respirators with NIOSH-approved cartridges
- Safety goggles
- 5. Surfactant
- Misting spray bottle
- Misting spray tank
- 8. Dust mop/broom
- 9. Polyethylene sheeting (six-mil)
- 10. Asbestos disposal bags (six-mil)
- 11. Fiber or metal disposal drums
- 12. Glove bags
- 13. HEPA Vacuum with attachments
- 14. Duct tape
- 15. Hand tools
- 16. Warning signs and labels
- 17. Scrim cloth for pipe wrap
- 18. Foil tape for pipe wrap
- 19. Encapsulant bridging and penetrating
- 20. Smoke tube kits

OPERATIONS AND MAINTENANCE PLANNING COST AND MATERIALS CHECKLIST

PURCHASED Initial Ongo

URCHASED PER BUILDING
1 Ongoing Unit Cost Quantity

Disposable Tyvek Coveralls w/Hood Bottles X-large

Rubber gioves

Half-face negative pressure dual cartridge respirators

Respirator filters

Safety goggies

Surfactant

Misting spray bottle

Misting spray tank

Polyethylene sheeting (six-mil)

Asbestos disposal bags (six-mil)

Fiber disposal drums

Glove bags

HEPA vacuum with attachments: vacuum bags

vacuum filters cone attachment

Vacuum bags

Vacuum filters

Cone attachment

Duct tabe

Hand tools

"DANGER: ASBESTOS..." signs & labels

Scrim cloth for pipe wrap

Foil tape for pipe wrap

Eacapsulant

- penetrating

- bridging

Smoke rabe kirs

M. AIR MONITORING

A requirement of 40 CFR 763.91 is that the LEA ascertain, through monitoring or historical data, the airborne concentration of asbestos fibers during all maintenance and repair activities involving ACBM or assumed ACBM. Coverage of EPA's worker protection rule at 40 CFR 763.121 is extended to maintenance and custodial staff at schools who perform Operations and Maintenance activities.

These regulations establish a Permissible Exposure Limit (PEL) of 0.2 fibers per cubic centimeter (f/cm³) over 8-hours for abatement project workers and an action level of 0.1 f/cm³ that, once met or exceeded, triggers a number of required work practices including air monitoring, regulated work areas, engineering and work practice controls, respiratory protection, protective clothing, hygiene facilities and practices, training, medical surveillance and recordkeeping.

In response to the requirement of these regulations, 8-hour "time weighted average" air sampling will be conducted in all routine maintenance areas and in general occupancy areas of all buildings so that initial background concentrations of asbestos resulting from the existence of the ACBM may be determined. As well, during any small-scale, short-duration maintenance activity involving ACM, air monitoring will be performed as follows:

- Personal samples will be collected from the breathing zone of the employee(s) performing the maintenance activity.
- Area samples will be collected in the vicinity of the maintenance activity so that a determination may be made of the level of contamination expected to be produced in surrounding areas as a result of the activity.

All air monitoring will be done in accordance with 40 CFR 763.121 including collection on 0.8 micrometer 25-millimeter filters mounted in an open-face filter holder and analysis using the NIOSH 7400 method. The samples will be taken for the determination of the 8-hour time weighted average concentrations and ceiling concentrations of asbestos fibers.

Following analysis of the air filters, results of all analyses will be recorded on the O&M Maintenance Activity form for inclusion in the Operations and Maintenance Program's permanent records. A copy of the Air Monitoring Data and Log is attached.

N. MEDICAL MONITORING

Medical monitoring is required for all employees working on or around ACBM where exposure is likely to exceed the OSHA action level of 0.1 f/cm², 8-hour TWA during the course of work. This is required through 40 CFR 763.91's extension of Epa's Worker Protection Rule at 40 CFR 763.121 to maintenance and custodial staff at schools who perform operations and maintenance activities.

This medical monitoring program will be provided to all persons at the cost of the LEA as required by the regulations. The program will consist of the following elements:

- Preplacement Examination will be provided within 30 days of commencement of employment and will include a medical history, chest X-ray, and pulmonary function test as per 40 CFR 763.121(J)(2).
- Annual Examinations will be provided at least annually and will include medical history, chest X-ray, and pulmonary function tests as per 40 CFR 763.121(J)(3).
- Termination Examination will be provided within 30 days pre or post termination date and will include medical history, chest X-ray, and pulmonary function tests as per 40 CFR 763.121(J)(4).

Where determined by medical examination that an individual cannot work while wearing a respirator, that person will not be required or allowed to perform maintenance activities involving ACBM.

Medical records will be maintained in the personnel files and be made available to the Environmental Protection Agency, the Assistant Secretary of Labor for Occupational Safety and Health, the Director of NIOSH, authorized physicians, and upon the request of the employee (or former employee) to his physician. All records will be maintained for at least 20 years as required by 40 CFR 763.121(f)(6).

OPERATIONS AND MAINTENANCE CODES

The following codes are intended for use as reference to the general requirements for Preventive Measures by material types. The codes are referenced in the inspection results location of the Management Plan and are presented here for convenience.

The codes given are for all friable ACBM and non-friable ACBM that have the potential to become friable during school maintenance activities involving the material. In all cases, the description of activities in the Operations and Maintenance Codes refers back to the specific requirements detailed in the Operations and Maintenance program and 40 CFR 763.

OMA - Pipe Insulations and Mudded Joint Fittings

Work area preparation and cleaning must in accordance with the requirement of 40 CFR 763.91(d).

Repair minor dents and tears in the protective jacket with duct tape or bridging encapsulant with glass cloth reinforcement. Duct tape should only be used for temporary control until the bridging encapsulant is installed.

For small-scale, short-duration activities, if glove bag removal is not feasible, wrap uncovered pipe insulation with protective jackets consisting of a bridging encapsulant with glass cloth reinforcement. If a glove bag is used, it must be used in accordance with Section E-3 of Operations and Maintenance Activities.

Wrap moderately water damaged or contact damaged pipe insulations with new protective jackets, or re-insulate affected areas. Eliminate the source of the water damage. Any activity other than small-scale, short-duration requires design by a person accredited to design response actions. The activity must be undertaken by those accredited to perform them. Therefore, those types of activities will not be undertaken on a routine basis.

Monitor the condition of the asbestos-containing materials, under procedures outlined in the "Plan for Periodic Surveillance" located in the Management Plan.

Clean area, as necessary, using procedures detailed in Section D of Additional Cleaning.

OMB - Insulation on Boilers, Breeching, Ducts, etc.

Work area preparation and cleanup must be in accordance with the requirements of 40 CFR 763.91 (d).

Repair minor dents and tears in insulation on boilers and breeching with a bridging encapsulant with glass cloth reinforcement. Duct tape or nonaspestos mastic should only be used for temporary control until the protective jacket is applied.

Wrap uncovered insulations with new protective jackets or coverings consisting of a bridging encapsulant with glass cloth reinforcement.

Minor damage to duct work insulated with ACM should be repaired with a bridging encapsulant with glass cloth reinforcement. Duct tape or non-asbestos mastic should only be used for temporary control until the protective jacket is applied.

If any small-scale removal is required as a part of the repair process or maintenance activity, then a glove bag or mini-enclosure must be used as described in Section E-3 of Operations and Maintenance Activities. Clean the area, as necessary, using procedures detailed in Section D of Additional Cleaning.

Monitor the condition of the asbestos-containing materials, under procedures outlined in the "Plan for Periodic Surveillance" located in the Management Plan.

OMC - Fireproofing

Work area preparation and cleaning must be in accordance with the requirements of 40 CFR 763.91(d).

The fireproofing may be sprayed with an encapsulant if the fireproofing is well-bonded to its substrate and is less than one inch thick. This is to be considered a temporary control measure with a life expectancy of five to six years. Test results have shown that, due to the impact of the spray, spraying with an encapsulant can, on occasion, cause more fibers than a gross wet removal project. ACM removal, enclosure or encapsulation, can only be performed if it is classified as a small-scale, short-duration maintenance activity NOT intended as asbestos abatement as defined in Appendix B to Subpart E of 40 CFR 763.91. In cases where the activity is not small-scale, the activity must be designed and performed by an accredited person.

Use caution when work involved hanging ducts, conduit or pipes, etc. from surfaces sprayed with fireproofing. Avoid disturbing fireproofing whenever possible.

All materials must be monitored as detailed in the section "Plans for Periodic Surveillance" located in the Management Plan.

Clean the area, as necessary, using procedures detailed in Section D of Additional Cleaning.

OMD - Acoustical Plasters (Sprayed On/Trowelled On)

If the plaster is in good condition, with no delamination, deterioration or signs of water damage, it should be left alone but carefully monitored for signs of change in status. This must be performed as detailed in the "Plan for Periodic Surveillance" in the Management Plan.

If the plaster is water damaged and/or is becoming delaminated from the substrate, it should be removed rather than encapsulated. Encapsulation can make the condition worse by increasing the rate of delamination. The source of the water damage must be eliminated. Unless the required removal is a part of a required small-scale, short-duration maintenance activity then the removal/repair must be designed and performed by an accredited person.

Avoid disturbing acoustical plaster by not hanging plants, drilling holes in the ceiling, moving furniture, etc. Work area preparation and cleanup for all types of maintenance work must be in accordance with the requirements of 40 CFR 763.912(d). When the plaster must be disturbed, mist the affected area with amended water and use a HEPA vacuum to collect fibers being released.

All materials must be monitored as detailed in the section "Plans for Periodic Surveillance" located in the Management Plan,

Clean the area, as necessary, using procedures detailed in Section D of Additional Cleaning.

OMF - Debris

Work area preparation and cleanup must be in accordance with the requirements of 40 CFR 763.91(f) for minor fiber release episodes (three square or linear feet or less of friable ACM).

Small amounts can be cleaned up using a HEPA vacuum and wet wiping or set mopping. Dispose of larger pieces by misting and carefully moving the pieces to an asbestos disposal bag to be properly discarded. Repair of the damaged material that resulted in the debris must be performed as per 40 CFR 763.91 (f)(iv).

OMG - Ceiling Tiles

Work area preparation and cleanup must be in accordance with the requirements of 40 CFR 763.91(f) for minor fiber release episodes (three square or linear feet or less of friable ACM).

When ceiling tiles are noted as asbestoscontaining materials, precautions can be taken to greatly minimize exposure from the tiles.

Whenever the tiles are cut, broken, or damaged, they should be disposed of properly and replaced by new tiles. Replacement tiles must be asbestos free. Tiles should never be broken to fit into an asbestos disposal bag. Any activity other than small-scale, short-duration maintenance activities must be designed and performed by an accredited person.

All materials must be monitored as detailed in the section "Plans for Periodic Surveillance" located in the Management Plan.

OMH - Tape/Woven Paper

Work area preparation and cleanup must be in accordance with the requirements of 40 CFR 763.91(f).

Asbestos-containing tape is used primarily for sealing seams on duct work. Loose or frayed ends of the tape must be wetted with amended water, cut, and properly disposed. Care must be taken not to damage the tape by ripping or tearing it during this procedure.

Damaged tape should be carefully painted with a bridging encapsulant with minimal overspray or overbrushing. When the tape must be disturbed, mist it with amended water (unless the disturbance is due to the encapsulation process) and use a HEPA vacuum to collect fibers being released.

OMI - Miscellaneous/ Cementitious Materials

Fiber release from cementitious (non-friable) materials is normally extremely low, unless these materials are broken, drilled, sanded or otherwise disturbed. During disturbance, the material should be thoroughly dampened and a HEPA vacuum used to collect fibers being released. Work area preparation and cleanup must be in accordance with 40 CFR 763.91(d). Some examples of cementitious materials that may contain asbestos are:

- Floor tiles
- Tile underlay
- Wall plasters (some)
- Transite pipes
- Scratch coats
- Drywail plaster (some)
- Transite panelling
- Linoleum
- Asbestos cement pipes

OMZ - Other Materials

This code applies to miscellaneous ACM that rarely creates a significant problem but can pose an exposure risk when being damaged or removed. Listed are some of the asbestoscontaining materials that fall into classification. If an asbestos-containing material is not directly addressed in the operations and maintenance codes. an operations. maintenance procedure may be applied using one or more of the codes that involve similar materials. All disposal must be in accordance with Section F of Waste Disposal.

Batt Insulation - Cutting or tearing the asbestoslayered paper backing can cause fiber release. Wet the backing with amended water and wear a half-face respirator if batting needs to be cut or moved.

Fnable Wallboard - Precautions must be taken to minimize exposure from the wallboard. Replace broken or damaged wallboard with a non-asbestos material. If removal is necessary, wet the material and try to remove it in one piece. The wallboard must never be broken up to fit into an asbestos disposal bag.

Vibration Joint Cloth - Vibration joint cloth is most often found on duct work near air handlers. Loose or frayed ends should be wet with amended water or a diluted encapsulant. Carefully cut and remove the joint cloth and dispose of properly.

Earth Floors - When mechanical insulations located in crawl spaces or tunnels deteriorate or are damaged, the earth floors beneath them can become contaminated. Often the asbestos materials are broken up and ground into the loose earth by maintenance workers performing work in these areas. All work involving contaminated soil must be designed and performed by accredited persons.

Vinyl Asbestos Floor Tiles (VAT) - Damaged, vinyl floor tiles can become friable and could present a problem when a small-scale, short-duration maintenance activity requires removal of small areas of VAT, work area preparation and cleaning must be in accordance with 40 CFR 763.91 (d). Mix amended water to a slightly stronger than normal strength. Spray the entire surface of the tiles to be removed, wait six to eight hours and repeat the spraying. Most vinyl

asbestos tile glues are water soluble and the tiles will loosen so that they may be physically removed, placed in a sealed plastic bag, and disposed of as asbestos waste. When the tiles are loose, the ends will curl up or under. Always dispose of the paper underlay material with the VAT, as it usually contains asbestos. In most cases, VAT removal will be designed and performed by accredited persons.

INITIAL/ADDITIONAL CLEANING RECOMMENDATIONS

(Supplement to O&M Plan)

This section is provided as a supplement to the Operations and Maintenance Plan included in this document, as required by 40 CFR 763.91 (c) and 763.93 (e)(9).

The AHERA regulations require that each LEA which after inspection was found to contain areas with friable ACBM, damaged or significantly damaged thermal system insulation ACM, or friable suspected ACBM assumed to be ACM, the area(s) will be asbestos cleaned at least once after the completion of the inspection and before the initiation of any response action other than O&M Procedures or repair. The procedures for the required cleaning are found in 40 CFR 41852; however, a more detailed description is found in the body of the O&M Plan, "Initial Cleaning".

Hall-Kimbrell and the accredited Management Planner agree with the EPA to the need for a thorough asbestos cleaning of the areas described above. That initial cleaning measure is necessary in order to collect and remove as much of the settled asbestos dust and fibers as possible that have been deposited over the past months or years. However, all materials containing asbestos should not be treated equally under this provision, since depending on the material's degree of friability, accessibility, asbestos content, condition. and other variables, the amount of asbestos contamination in and around the area will vary greatly. The accredited inspector performed an assessment of the materials taking into consideration these and other variables which contribute to the likelihood/probability of routine or accidental fall out and possible building occupant exposure. The relative degree of exposure potential and, therefore, past fall out probability are inter-related in that a material whose damage category has been determined to

be damaged or significantly damaged has a very high probability of having produced a higher degree of area contamination than a similar material with a rating of "potential for damage".

In order to aid the school district in understanding the relative degrees of exposure and/or contamination potential and probability. Hall-Kimbrell has provided three (3) priority ranking categories. Hall-Kimbrell's recommendation for cleaning in and around the areas is as follows:

Priority 1 Materials/Areas

- A) Initial cleaning as described in the O&M Plan as soon as feasible but in no event later than July 9, 1989.
- B) Additional cleaning as was performed initially at least once every two months until materials are abated.

Priority 2 Materials/Areas

- A) Initial cleaning as described in O&M Plan no later than July 9, 1989. NOTE: For economic efficiency, the LEA should perform the initial cleaning at the same time as the Priority I materials/areas are cleaned.
- B) Additional cleaning, as was performed initially, at least once every six months thereafter until materials are abated.

Priority 3 Materials/Areas

Since these materials are either non-friable ACBM, non-friable assumed ACM, or other well-bound miscellaneous material with a low likelihood of exposure potential or contamination under routine use, Hall-Kimbrell does not feel that initial nor additional cleaning is absolutely necessary. However, since past renovations, remodeling, or other possible disturbance may have occurred and unknown to Hall-Kimbrell the school district should use its best judgement based on past activities in determining whether these Priority III materials should be treated otherwise.

LE.A	Response	to Cleaning	Recommendations
	-		

The AHERA regulations require that the LEA provide a response to the management planner's cleaning aning out an of the

based altern	on the schedule recommended indicate	ecommendations provided and agree to conduct the necessary ele- e by checking the first block. If you do not agree and plan to carry of ase indicate by checking the second block and provide a description of
_	I do agree with the recommendation that schedule.	ons and cleaning schedule and will carry out the plan according to
<u>X</u>	I do not agree with the recommende	ed schedule for additional cleaning and elect the following:
	nitial cleaning will be performed prior to dditional cleaning will be performed w	to the initiation of any response act other than O&M or repair, then it is deemed necessary by the LEA.
_		
By:	LEA Designated Person:	Signature
Ву:	Management Planner	Samuel Nutt? Name Signature John Newlin
		Name

OPERATIONS AND MAINTENANCE PROGRAM

FORMS

ASBESTOS ABATEMENT ACTIVITY RECORD.

District Name:	Campus Name:									
LEA Asbestos	Coordinator: Phone:									
8uilding	Abatement	Abatement		Abatement	Date of	Abatement	ALACM			
Name	Location	Method	Abatement	Contractor	Abatement	Cost	Removed			
	<u> </u>		<u> </u>							
				<u> </u>						
		· . · · · · · · · · · · · · · · · · · ·								
	<u> </u>	,			<u>! </u>	<u> </u>				
			<u> </u>		<u> </u>	<u> </u>	<u> </u> 			
	<u> </u> 			<u> </u> -			 			
	İ	ı	<u> </u>							
							ļ			
	İ			1						
			1		<u> </u>	<u> </u> 	[
				<u> </u> 	<u> </u>	<u> </u>	1			
	1				<u> </u>	<u> </u>				
	<u> </u>									
<u> </u>			 	<u> </u>						
				<u> </u>			<u> </u>			
<u> </u>			1	<u></u>			<u> </u>			
			1	ļ	<u></u>					
			1		 					

^{*} This record includes all asbestos abatement undertaken that was not associated with a small-scale maintenance activity

MAINTENANCE/CUSTODIAL STAFF TRAINING RECORD

mpus Name:	npus Name:			Building Name:					
									_
Name	Oate	Training	Location	EPA	Duration		Refre	sher Co	urses
····	of Hire	Received	<u>-{</u>	Accred.	(hours)	Taken	Cate	Date	Cate
<u></u>			<u> </u>						<u> </u>
						<u>_</u>			
								,	
		<u></u>	<u> </u>						<u> </u>
<u></u>	<u> </u>			<u> </u>	+	<u> </u>			
			<u> </u>	<u> </u>		<u> </u>	<u> </u> 	<u> </u>	<u> </u>
				<u> </u>	<u> </u>	<u> </u>	1	<u> </u> 	
									<u> </u>
									<u> </u>
		_							
		•							
		•		Ì		<u> </u>			<u> </u>
				1	-		 	 	
			<u> </u>	<u> </u> 		<u> </u>	 	<u> </u>	
						<u> </u>		Ì.	
				<u> </u>	<u> </u>	<u> </u>	İ	<u> </u>	<u> </u>
						<u> </u>	<u> </u>	<u> </u>	-
					ļ				
<u></u> "		<u>.</u>							1
		·						1	1
				<u> </u>	+		 	-	+
				- -		<u> </u>	<u>. L</u>	<u> </u>	
		<u></u>		 	 	 	-	-	 -
<u> </u>						<u> </u>			<u> </u>

ACM WASTE DISPOSAL

CHAIN OF CUSTODY RECORD

Campus		Building:							
Asbesios Coordinator		Address.	Phone	್ಷ ೯೬೧೭೯					
	Materij	Il Summary							
Material Origint		Cate of Release:							
Container Type(s):		Quantity:	-						
-			- -						
Total No. of Containers:	Tar	tal: Guantity: Volume	Weight						
_									
	Yes								
Bags Qoubled & ਸ਼ਿਵਰ: [Not Applicable							
Containers Labeled: [」Yes ∐ No								
	Material	Destination							
Name of Landfill Site:		Address:	· · · <u>· · · · · · · · · · · · · · · · </u>	·					
Landfill Site Supervisor		Phone:							
	EPA Cartified for Asbestos Disposat: YES / NO* If NO, Exptain:								
	CHAIN O	F CUSTODY							
Relinquished By	Date and Time	Received By	Date and Time	Carrier					
Relinquished By	Oate and Time	Received By	Oate and Time	Carrier					
Relinquished By	Cate and Time	Received By	Date and Time	Carner					
Relinquished By	Oate and Time	Recaived By	Date and Time	Camer					

O&MICLEANING REPORT

Campus:	Building:	Building:			
Locations:		Cate(s):			
	Staff Assigned	-			
Name	Title	Outies			
	Cleaning Methods				
Location	Methods .	Used			
Comments:	•				

Signature:

Oate:

SMALL-SCALE O & M ACTIVITY REPORT

Campus:	· · · · · · · · · · · · · · · · · · ·	Building:		
Location:		start Cate: Time:		
	Maintenar	nce Activity		
Description of Activity:				
ACM Removed: YES/N	NO Quantity:_	Removal	Method:	
			VF	
	Equipment/Preve	entive Measures		
Area isolated	Signs Posted	HEPA Vacuum	Isolate Air Handlers	
Tyvek Suits	Respirators	Goggies	Poly sheeting	
Disposal Bags	Oisposal Drums	Duct Tape	Tools(detail below)	
Encapsulant-Bridging	Encapsulant-penetr.	Minienclosure	Change Room	
Enclosure	Glove Bag	Amended Water	Repair Materials(de	tail below)
Tools and Repair Materials	-List All		_	
				
				
	Staff A	ssigned	,	
Name	Title		Duties	Date/Time start finish
<u>,,, ,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,</u>				
Further Action Necessar	y:			
Comments:				

FIBER RELEASE EPISODE REPORT

	FIBER RELEASE	<u>EPISODE RE</u>	<u>PORT</u>		
Campus:	<u></u>	8uilding:			
Location:				ne:	
Description of Episode	ə:		·		
Type of Episode(Major	r or Minar):	· · · · · · · · · · · · · · · · · · ·		<u> </u>	
Person Identifying Epi	sode:				
	Correc	tive Action			
Method of Repair / Res	sponse Action:	·			· · · · · · · · · · · · · · · · · · ·
ACM Removed: YES	/ NO Quantity:		Removal Met	nod:	
			Site Supvr		
Address			Phone:		· · · · · · · · · · · · · · · · · · ·
_	Equipment/Pre-	ventive Measur	es es		
Area Isolated	Signs Posted	☐ HEPA Vac	ວນແຕ 🗌	isolate Air Handlei	75
Tyvek Suits	Respirators	Goggles		Poly sheeting	
Disposal Bags	Oisposal Orums	Duct Tape	•	Tools(detail below	·)
Encapsulant-Bridging	g 🔲 Encapsulant-penetr	. Miniencio	sure	Change Room	
Enclosure	Giove Bag	Amended	Water	Repair Materials (d	etail below)
Gross Removal(attac	th info on contractor, and a	all activity detail	is)	Notify Asbestos C	ocrdinator
Tools and Repair Materia	ıls-List Ail	<u></u>			
					
					 -
	Staff	Assigned			
Name	Title	1	on(if applic.)	Outies	Date/Tin
		State	Number		start f
			!		
			<u> </u>		
C about Assistant Names				<u> </u>	
Further Action Necess	sary:				
Comments:		,. , , , , , , , , , , , , , , , , , , 			
- · · · · · · · · · · · · · · · · · · ·				6	

MAJOR O & MACTIVITY REPORT

Campus:	· · · · · · · · · · · · · · · · · · ·	Building:_				
Location:		Date: Time:	start	stop		
	. Maintena	nce Activity				
Response Plan Designe	pr:	State of Ac	cred./Accred	i, #:	1	
Description of Activity:						
· · · · · · · · · · · · · · · · · · ·						
ACM Removed: YES /	NO Quantity:		Removal Me	ethod:		
						~
			Phone:			
		<u> </u>				
_	Equipment/Prev	_	· _	_		
Area Isolated	Signs Posted	HEPA Va	cuum [j Isolate Air Handle	rs	
Tyvek Suits	Respirators	Goggles		Poly sheeting		
Disposal Bags	Disposal Drums	Duct Tap	e [Tools(detail below	v)	
Encapsulant-Bridging	Encapsulant-penetr.	. Minienck	osure [Change Room		
Enclosure	Glove Bag	Amende	d Water [Repair Materials (detail belov	v)
Gross Removal(attach	info on contractor, and a	II activity deta	ils)			
— Tools and Repair Matc als	-List All					
					<u> </u>	
						
						
	Staff 2	Assigned		•		
Name	Title	Accre State	ditation Number	Duties	Date: start	Time finish
		State	Number		Start	11111311
			1	<u> </u>		
Further Action Necessa	ry:	· · · · · · · · · · · · · · · · · · ·				
Comments:			············	·		
Sunur Signature:				Date:		

Certificate of Completion

This is to certify that

Darren Lee
has satisfactorily completed

4 hours of refresher training as a Management Planner

in compliance with TSCA Title II

AHERA Accredited

Sep 23, 1999

Training Coordinator

Exp. Date: Sep 22, 2000





Cert. #99-1933 Conducted at: PacPro - Gresham, OR

Certificate of Completion

This is to certify that

Jeffrey Smith

has satisfactorily completed One half-day refresher training as a

Building Inspector

in compliance with TSCA Title II
AHERA Accredited

Sep 15, 1997

Training Administrator

Exp. Date: Sep 15, 1998

Weller

্র্টে Prezant



Cert. # 97-3959
Conducted at:
Pac Pro Safety
Holiday Inn / Portand, OR



This is to certify that

Jeff Smith

section of the complete

has satisfactorily completed

4 hours of refresher training as a Management Planner

in compliance with TSCA Title II

AHERA Accredited

Sep 23, 1999

Training Coordinator

Exp. Date: Sep 22, 2000





Cert. #99-1934 Conducted at: PacPro - Gresham, OR

Certificate of Completion

This is to certify that

Jeffrey Smith
has satisfactorily completed

One day of refresher training as a Project Designer

in compliance with TSCA Title II

AHERA Accredited

Aug 28, 1999

Training Coordinator

Exp. Date: Aug 27, 2000





Cert. #991785
Conducted at:
Three Rivers Environmental, Inc.
Gladstone, OR

Certificate of Completion

This is to certify that

Glenn R. Bryant

has satisfactorily completed 4 hours of refresher training as a

Building Inspector

in compliance with TSCA Title II

AHERA Accredited

Oct 21, 1999

Training Coordinator

Exp. Date: Oct 20, 2000





Cert. #99-2209 Conducted at: Pac Pro Portland, OR



Glenn Bryant

has successfully completed 32 hours of


Sampling and Evaluating Airborne Asbestos Dust

NIOSH 582 Equivalent on this 22nd day of March 1996

Carof Evane

Ken Knigmann Training Director

Certificate No. 960339N

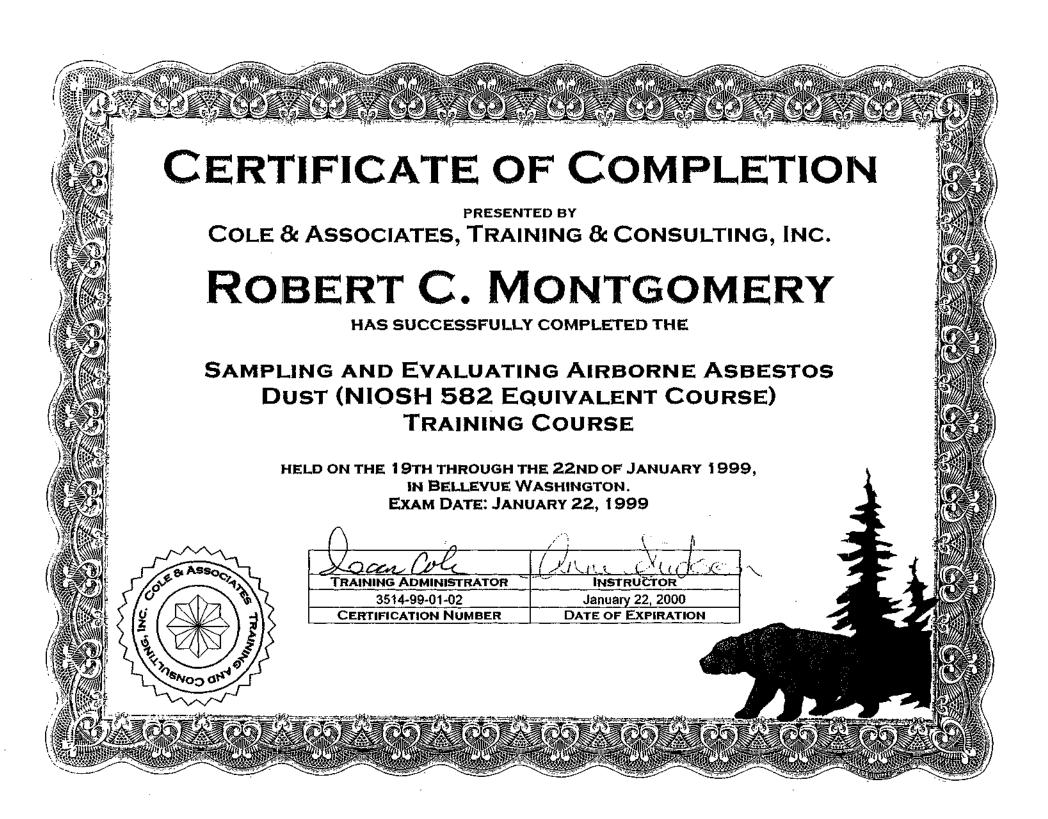



This is to certify that

Robert C. Montgomery

has satisfactorily completed 24 hours training as a

Building Inspector

in compliance with TSCA Title II/AHERA Accredited


Dec 16 - 18, 1998

Conducted at: PacPro - Portland, OR

Training Administrator

Exp. Date: Dec 18, 1999


Prezant



Cert. # 98-09212

Exam Date: Dec 18, 1998



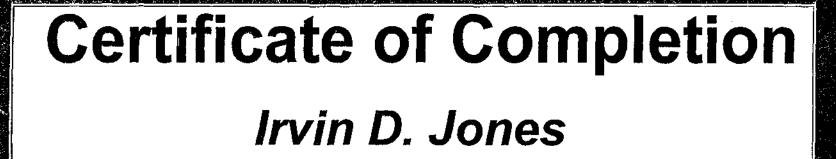

has successfully completed the requisite training and examination for accreditation under TSCA Title II

EPA AHERA (Asbestos Hazard Emergency Response Act), and ASHARA Model Accreditation Program requirements

as presented by Clayton Environmental Consultants

Garry Rossing INSTRUCTOR

Course Date: 09/21/99 through 09/23/99

Certification # 244-83-8571 Examination Date: 09/23/99

BEMLE

Certificate Expiration Date: 09/22/00

Clayton ENVIRONMENTAL CONSULTANTS

Clayton Environmental Consultants is a Division of Clayton Group Services, Inc. 11675 SW 66th Ave. Portland, Oregon 97223 •(503) 968-2112 •fax (503) 968-2213

United States Department of Commerce National Institute of Standards and Technology



ENVIRONMENTAL HAZARDS SERVICES, L.L.C. RICHMOND, VA

is recognized under the National Voluntary Laboratory Accreditation Program for satisfactory compliance with criteria established in Title 15, Part 285 Code of Federal Regulations. These criteria encompass the requirements of ISO/IEC Guide 25 and the relevant requirements of ISO 9002 (ANSI/ASQC Q92-1987) as suppliers of calibration or test results. Accreditation is awarded for specific services, listed on the Scope of Accreditation for:

BULK ASBESTOS FIBER ANALYSIS

December 31, 1999

Effective through

For the Plational Institute of Standards and Technology

NYLAP Lab Code: 101882-0

150 9002:1987



American Association for Laboratory Accreditation

SCOPE OF ACCREDITATION TO ISO/IEC GUIDE 25-1990

ENVIRONMENTAL HAZARDS SERVICES, L.L.C.

7469 White Pine Road Richmond, VA 23237 Irma Faszewski Phone: 804 275 4788

ENVIRONMENTAL

Valid To: August 31, 2000

Certificate Number: 0716-01

In recognition of the successful completion of the A2LA evaluation process, accreditation is granted to this laboratory to perform recognized EPA methods using the following testing technologies and in the analyte categories identified below:

<u>Testing Technologies</u>: Atomic Absorption/ICP-AES Spectrometry, Atomic Absorption-Flame, Hazardous Waste Characteristics Tests

Nonpotable Water

Metals: Al, Sb, As, Ba, Be, Cd, Ca, Cr, Co, Cu, Fe, Pb, Mg, Mn, Hg, Mo, Ni, K, Se, Ag, Na, Tl, Sn, Ti, V, Zr-

per EPA test methods SW 6010, 7420, 7470

Solid/Hazardous Waste

Metais: Al, Sb, As, Ba, Be, Cd, Ca, Cr, Co, Cu, Fe, Pb, Mg, Mn, Hg, Mo, Ni, K, Se, Ag, Na, Tl, Sn, Ti, V, Zn

per EPA test methods SW 6010, 7420, 7470

Hazardous Waste Characteristics Test: TCLP

per EPA test method SW 1311

Environmental Lead: soil, paint chips (residue), dust, air, building debris

sample preparation

per EPA test methods SW3050A (soils, building debris); 3050A modified (paints, wipes) per NIOSH test method 7082 (air) per EPA test method 600/R-93/200 (sonification – air, paint, soil)

sample analysis per EPA test methods SW 6010A, 7420 per NIOSH methods 7082, 7300

Peter Mayer





Office 503-650-8370 - Fax 503-650-837

O. Box 519 - Gladstone, OR 9702

Environmental Safety & Health Services

CLIENT: WEST LINN WILSONVILLE SCHOOL DISTRICT

FACILITY: WEST LINN HIGH SCHOOL

INSPECTION DATES: 12/03/01

ASBESTOS SURVEY REPORT DATE: Dec., 2001 INSPECTOR: Darren Lee CERT. NUMBER: OR-00-6082 NVLLAP CERT: 101882-0

ASBESTOS INVESTIGATIVE REPORT

Sample #:	Material Description:	Sample Location:	HSA#	Total Asbestos:
WLH-01	Ceiling Tile (1x1) Spline	Dance Studio	01	0%
WLH-01	Ceiling Tile (1x1) Spline	Dance Studio	01	0%
WLH-01	Ceiling Tile (1x1) Spline	Dance Studio	01	0%

GLAGIER ENVIR NMENTAL

CHAIN OF CUSTODY

	1		- 1
Page	(of	

Attention: CARREN D. CEE Company Name: CACIER ENU: TNC. Liailing Address: P.O. BOX S19 CHADSTENE OR 970Z-7 PH.(SO3) 6SO-8370 FAX:(SO3) 6SO-8371			UU. INC. 19 OR 97027	SAMPLE TYPE ASUESTOS DEPLM (Bulk) DEPLM MERA Sample Group TEM (Air) Positive map LEAD AA Flattic (Psint, Wipe) TCLP LEPA 200/500 Settes (Duinting Water)	SAMPLE TURNAL [] Standard (5 day [] Priority (2 day [] Rush (2-1 bo) [] Other (specify)	P.O. Number: Project Number: LL Date Sampled: 12/6 Date Submitted: 10/1		ST LINN H.S.	
Sample (1)	Date	Pudite Step	Sample f	Description	Sample Lo	cation	Quantity (SF/LF)	Volume	ltesult
WLHS-001	12-6-01	*	CEILING TILE		DANCE STUT	>10			
" - 007	il	11	p B		tt le				

panifac ire	tyate	зіор	annipe rescription	Sample Eocurion	Quantity (3(7)21)	TORRITE	Kesim
WLH5-001	12-6-01	*	CEILING TILE	DANCE STUDIO			
" - 007	il	11	b R	tt II			
11-003) (11	1. 15	li li			
	··					·	
	······································						
							ļ
							-
	·—						
					.		····
				<u></u>			·
				·			·
			·				
							
							·
		[<u> </u>		

Sampled By: (Sign)	Relinquished By: (Sign)	Date	Time	Recieved By; (Sign)	Date	Time
	1.6	12-6-01	11:05	. Some Stalland	19/19/11	(3 isoph
	1	·		LAB:		



This is to certify that

Darren D. Lee

has satisfactorily completed 4 hours of refresher training as a

Building Inspector


in compliance with TSCA Title II AHERA Accredited

October 25, 2000

Training Coordinator

Date Expires Oct 25, 2001





Cert. # 00-6082 Conducted at: Pac Pro Safety & Health Services

Prezant Associates, Inc. • 330 Sixth Avenue North, Suite 200 • Seattle, Washington 98109 • (206) 281-8858



12750 SW Pacific Highway, Ste 210, Tigard, OR 97223

(503) 968-2533 FAX: (503) 968-0523

200509-0

Bulk Sample Analysis for Asbestos

WEC Project #: P01-398 Client Project#: 01624

Report #: 7000 Report Date: 12/11/01

Client: Glacier Environmental Inc.

P.O. Box 519

Gladstone, Oregon 97027

Samples: 3

Layers: 3

Collected Date: 12/6/01

Collected By: CLIENT

TAT: 24 Hour

Analysis By: T.Hubbard Analysis Date: 12/11/01

Received By: Hubbard Received Date: 12/10/01

Project Name/Location: West Linn H.S.

Client ID# WLHS-001

WEC ID# PB01-2074 Location Dance Studio

Layer 1 of 1

Asbestos

None Detected

Material

Color Off-White

Other Fibrous Materials

Type

% Cettulose 3%

Mineral Wool

Friable/Non Fiberous? genous Friable Yes

HOTTO-

Ceiling Tile

% Asbestos: 0%

% Other Fibrous Materials:

73%

% Non Fibrous Materials: 27%

Sample Comments:

Client ID# WLHS-002

WEC ID# P801-2075

Location

Layer 1 of 1

Asbestos

None Detected

Dance Studio

Friable

Homo-Friable/Non Fiberous? genous

Yes

Material Ceiling Tile

Color Off-White

Other Fibrous Materials

Type Cellulose

73%

Mineral Wool

2%

70%

% Other Fibrous Materials:

% Asbestos:

% Non Fibrous Materials: 25%

Sample Comments:



12750 SW Pacific Highway, Ste 210, Tigard, OR 97223


(503) 968-2533 FAX: (503) 968-0523

200509-0

Bulk Sample Analysis for Asbestos

WEC Project#: 901- Client Project#: 0162		Report #: 7000 Report Date: 12/11/01			
Client ID# WLHS-003	WEC ID# PB01-2076	Location Layer Dance Studio 1 of 1			
Asbestos None Detected		Homo- Friable/Non Fiberous? genous Material Color Friable Yes No Ceiling Tile Off-White			
Other Fibrous Mater	ials	% Asbestos: 0%			
Туре	%	% Other Fibrous Materials: 73%			
Cellulose Mineral Wool	3% 70%	% Non Fibrous Materials: 27% Sample Comments:			
Comments:	an la 1				
Analyst	Fame Hall	Date 12/11/01 Date 12/11/01			
counting method is reque claim product endorseme	sted and noted for the s nt by NVLAP or any age	5. All quantities reported are based on visual estimation by PLM, unless point- ample. Test report relates only to items tested and must not be used by client to ancy of the U.S. Government. Test reports must not be reproduced without the c. General Terms and Conditions (see reverse).			

United States Department of Commerce National Institute of Standards and Technology

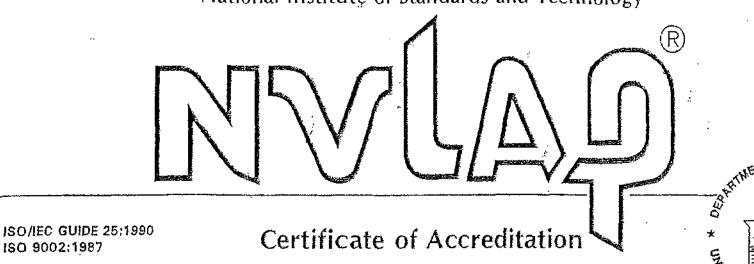

WHITE ENVIRONMENTAL CONSULTANTS, INC.

TIGARD, OR

is recognized under the National Voluntary Laboratory Accreditation Program for satisfactory compliance with criteria established in Title 15, Part 285 Code of Federal Regulations. These criteria encompass the requirements of ISO/IEC Guide 25 and the relevant requirements of ISO 9002 (ANSI/ASQC Q92-1987) as suppliers of calibration or test results. Accreditation is awarded for specific services, listed on the Scope of Accreditation for:

BULK ASBESTOS FIBER ANALYSIS

March 31, 2002

Effective through

For the National Institute of Standards and Technology

NVLAP Lab Code: 200509-0

ISO 9002:1987

Asbestos Investigative Report

WEST LINN HIGH SCHOOL (TRIP HOUSE) 5290 WEST "A" ST. WEST LINN, OR.

TRE Project No. 1020-88

January 2000

Conducted By:

Three Rivers Environmental, Inc.

Prepared for
WEST LINN-WILSONVILLE
SCHOOL DISTRICT 3JT

Attention: Tim Woodley

Prepared by

THREE RIVERS ENVIRONMENTAL, Inc.

Table of Contents

- 1. Introduction
- 2. Investigative Methods
 - Summary of Investigation
- 3. Asbestos Material Summary (Identified Homogeneous Areas)
- 4. Bulk Sample & Positive Material Location Diagrams
- 5. Photographs of Sampled Materials
- 6. Bulk Sample Inventory
 - Chain of Custody
- 7. Laboratory Analysis Results
- 8. Accreditations / Certifications
- 9. Record Keeping

THREE RIVERS
ENVIRONMENTAL, Inc.

W.L.W.S.D. WEST LINN HIGH-TRIP HOUSE ASBESTOS SURVEY TRE# 1020-88 5290 WEST "A" St. WEST LINN, OR... INTRODUCTION JANUARY 12 2000 PAGE 1 OF 1

Introduction

January,2000

Three Rivers Environmental, Inc., under the direction of Tim Woodley performed an asbestos survey to identify specific asbestos containing materials (ACMs) that may be present at 5290 West "A" St. West-Linn, Or.

Field investigation was conducted by EPA accredited asbestos inspector Irvin Jones and Robert Montgomery of this office on January 12 2000.

The purpose of this survey was to provide information in order to meet the AHERA asbestos sampling protocol as stated in 40 CFR 763.86. This sampling protocol is required for all asbestos surveys under Oregon Department of Environmental Quality, prior to performing any renovation or demolition activities.

In addition, this survey meets the "Good Faith" inspection requirements as stated in Oregon Occupational Safety and Health Code, General Industry Standard OAR 437-02-1910.100, Identification. Under the regulation, the Owner of a building to be renovated or demolished is require to provide a written statement as to whether the materials to be disturbed contain asbestos.

The inspection consisted of visual and tactile examination of all accessible portions of the surveyed area. All observed suspect asbestos containing materials were sampled in accordance with the Asbestos Hazard Emergency Response Act (AHERA) protocol, and submitted for laboratory analysis. All asbestos sample analysis was performed by American Industrial Hygiene Association (AIHA) and National Volunteer Laboratory Accreditation Program (NVLAP) Accredited Laboratories.

The results of our asbestos survey indicate that the structure located at the above mentioned address does contain asbestos building materials.

Please contact us with any questions or comments regarding the contents of this report.

Darren D. Lee

Sincerely:

Vice President

Three Rivers Environmental, Inc.

INVESTIGATIVE METHODS

A walk through inspection of all accessible areas of the facilities are performed to identify suspect asbestos-containing-building-materials (ACBM) and presumed-asbestos-containing-materials (PACM). A thorough investigation of suspect ACBM in hidden spaces are also conducted. Materials which may be buried on the property were not investigated.

During any scheduled demolition activities, given that materials different from those identified, may be uncovered during the demolition process. If such suspect materials are discovered, samples of these materials should be collected and analyzed for asbestos content before these materials are disturbed.

Upon identifying a suspect material, its location and type are noted. Samples are obtained, placed in plastic bags, and labeled with a number. Samples are collected to achieve a representative characterization of the visible suspect asbestos-containing materials found.

All samples are taken within EPA guidelines to minimize potential contamination to the surrounding area. Bulk samples location, notes, photographs, and observations are made on-site at the time of sampling. All applicable sample collection data are transferred to a corresponding Chain-of-Custody sample data sheet. Chain-of-Custody sheets are located behind the Bulk Asbestos Sample Analysis Sheet within our survey.

For all asbestos samples, the bulk sample identification number indicates the building from which the sample was taken, the numerical sequence in which the samples are taken, the layer of the material (if applicable), and the homogeneous sampling (HSA).

For Example: IPB-008a-25

IPB Inpatient Building

008 Homogeneous Sampling Area (HSA)

a/b/c layer designation 25 25th sample taken

The amount of asbestos in the sample is shown along with an observation of the condition of the material. Approximately <1% in the bulk materials is the limit of Polarized Light Microscopy (PLM) detection for most laboratories. If the microscopist can see no fibers in the sample, the result is reported as "No Asbestos Detected (NAD)."

The bulk suspect ACM samples are analyzed by Environmental Hazards Services, Inc., a National Voluntary Laboratory Accreditation Program (NVLAP) accredited laboratory. The analytical technique is polarized light microscopy (PLM) with dispersion staining. All analyses are performed by trained optical mineralogy technicians competent in bulk asbestos identification. Environmental Hazards Services, Inc. also participates in interlaboratory and intralaboratory quality control programs as recommended by the National Institute of Standards and Technology (NIST) and the EPA.

ASBESTOS BULK SAMPLING PROTOCOL

40 CFR 763.86 Sampling (AHERA Asbestos Sampling Protocol)

- (a) **Surfacing material.** An accredited inspector shall collect, in a statistically random manner that is representative of the homogeneous area, bulk samples from each homogeneous area of friable surfacing material that is assumed to be ACM, and shall collect the samples as follows:
 - (1) At least three bulk samples shall be collected from each homogeneous area that is 1,000 square feet or less, except as provided in 763.87 (c) (2).
 - (2) At least five bulk samples shall be collected from each homogeneous area that is greater than 1,000 square feet but less than or equal to 5,000 square feet, except as provided in 763.87 (c) (2).
 - (3) At least seven bulk samples shall be collected from each homogeneous area that is greater than 5,000 square feet, except as provided in 763.87 (c) (2).

(b) Thermal system insulation

- (1) Except as provided in paragraphs (b) (2) through (4) of this section and 763.87 (c), an accredited inspector shall collect, in a randomly distributed manner, at least three bulk samples from each homogeneous area of thermal system insulation that is not assumed to be ACM.
- (2) Collect at least one bulk sample from each homogeneous area of patched thermal system insulation hat is not assumed to be ACM if the patched section is less then six linear or six square feet.
- (3) In a manner sufficient to determine whether the material is ACM or not ACM, collect bulk samples from each insulated mechanical system that is not assumed to be ACM where cement or plaster is used on fittings such as tees, elbows, or valves, except as provided under 763.87 (c) (2).
- (4) Bulk samples are not required to be collected from any homogeneous area where the accredited inspector has determined that the thermal system insulation is fiberglass, foam glass, rubber, or other non-ACM.
- (c) **Miscellaneous material.** In a manner sufficient to determine whether material is ACM or not ACM, an accredited inspector shall collect bulk samples from each homogeneous area of friable miscellaneous material that is not assumed to be ACM.
- (d) Nonfriable suspected ACBM. If any homogeneous area of nonfriable suspected ACM, has been or will be rendered friable, then an accredited inspector shall collect, in a manner sufficient to determine whether the material is ACM or not ACM, bulk samples from the homogeneous area of nonfriable suspected ACBM that is not assumed to be ACM.

LABORATORY ANALYTICAL METHODS

- (1) Stereoscopic Examination and Description:
 - (a) The sample is examined with a stereomicroscope in a HEPA-filtered hood to determine color, general morphology, and the presence of distinct layers.
 - (b) The sample is compared with the client description and discrepancies noted.
 - (c) The sample is teased apart with forceps and tweezers. A description of the sample is entered into the laboratory notebook or directly into the computer.
 - (d) The presence of fibers is noted, and their general physical characteristics such as morphology, color, elasticity, etc., are described.
 - (e) Estimates of the percent by volume of each type of fiber in each individual layer is entered into the computer.
 - (f) Mounts of the different fibers and matrix material are prepared for examination under the polarized light microscope.
 - (g) If no fibers are observed during this examination, mounts of the matrix materials are made to search for very fine asbestos fibers.
 - (h) Samples which are hard, or in which the asbestos is tightly bound, may be handled in various ways so that asbestos can be made available for analysis.
- (2) Sample Preparation for viewing by PLM:
 - (a) Two mounts of the sample, including fibers and matrix material, are usually made, one in 1.550 refractive index oil and the other in 1.680 refractive index oil. These oils are used for the two most common types of asbestos; Chrysotile and amosite. Two preparations should provide adequate material to characterize the material under the microscope.
 - (b) If no fibers are noted, this step is repeated at least once.
 - (c) Mechanical grinding of the mount using the eraser end of a pencil, or gentle heating of the sample may be required to free the fibers from the binder.
- (3) Sample Examination by PLM:
 - (a) Fibers in the sample are examined to determine if their morphological and crystallographic properties are consistent with those common to asbestos minerals. Optical properties examined include sign of elongation, extinction angles, and determination of the refractive index of the fibers using the Becke Line Method or dispersion staining color techniques.
 - (b) Additional mounts are made as necessary in order to optically match the refractive index of the fiber to that of the oil. Dispersion staining colors are considered the definitive property on which the identification is based.
- (4) Other Characteristics of Asbestos Minerals:
 - -Fibers will not burn.
 - -Fibers are resistant to acid.
 - -Fibers may change their sign of elongation after being subjected to intense heat.
 - -Fibers may exhibit higher refractive indices after being subjected to intense heat.

(5) Special treatment for samples in which the asbestos is tightly bound may be required for plasters, cements, floor tiles, roofing, and other nonfriable materials. In some cases, the fibers of interest may be found by simply breaking the sample to view a freshly broken surface. Visible fibers may be pulled out and mounted for further examination. If this is not possible, the sample may be broken into smaller pieces, and ground up using a mortar and pestle or dissolved using solvents and gravimetric techniques as recommended by the Research Triangle Institute Draft Test Method for the Determination of Asbestos in Bulk Building Material, July, 1991.

(6) Quantification of Materials Present:

- (a) For the most part, if asbestos is present in amounts greater than 3%, quantification is fairly reliable. In the samples where the asbestos levels are closer to 1%, quantification is more difficult and often due to some subjectivity on part of the analyst.
- (b) Quantification by weight or volume of asbestos in a sample is based on the relative volumes of asbestos compared to other material present. The quantification is subjective and makes the assumptions that the densities of materials present are approximately the same and that the volumes can be reasonable estimated from a two-dimensional view.
- (c) Analysts are "calibrated" by analyzing known-weight samples and by reference samples provided by NIST.

(7) Final Evaluation and Recording:

- (a) A description of the sample and all properties of asbestos fibers and their final percentages found during the analysis are recorded in the laboratory notebook or the computer.
- (b) A final percentage by volume is reported for the non-asbestos fibers identified and reported in the same manner.
- (c) Nonfibrous accessory phases, fillers, and binders are noted where identifiable.

(8) Completion of Sample Report:

- (a) When the sample analysis and data recording is complete, the Chain-of-Custody form is signed by the analyst.
- (b) The bulk data is stored in the computer of Lab Notebook includes the optical data justifying the analysis. Hard copies of the analytical data and computer backups are generated on a weekly basis.
- (c) The final Bulk Sample Report is printed and reviewed by the analyst and/or Laboratory Manager who signs the computerized copy. The original signed copy is sent to the client along with a copy of the Chain-of-Custody, the original of which is maintained on file with the lab.

(9) Quality Control Issues:

(a) Contamination: All manipulation of the samples outside of the sample container is performed inside the HEPA-filtered hood. All laboratory work surfaces in and out of the hoods are kept clean before, during and after sample analysis using wet wipes to clean any debris which may result from sample manipulation. Tools used for analysis are cleaned before, during and after each sample analysis using wet wipes and chem wipes. Care is used to assure tools remain clean to avoid cross contamination between samples. Spray bottles of amended water are kept at each station preparation. Only clean microscope slides and coverslips are used. Each sample is completed and the sample container is closed before the next sample is begun.

Monthly air sampling is performed in the laboratory to ascertain the level of fibrous material in the air. If results of the PCM analysis show fiber levels greater than 0.01 fibers per cc of air, the sample will be sent for analysis by TEM.

(b) Intralaboratory and Interlaboratory Quality Control: In cases of a questionable analysis, such as when the asbestos is detected at or around 1%, when the asbestos has been altered, or when an uncommon type of asbestos is found, a split of the sample will be analyzed by a second analyst or will be sent to a NVLAP accredited laboratory for confirmation. Approximately 10% of all samples are submitted for blind reanalysis either as duplicate or replicate samples. These samples are chosen at random and include samples which contain asbestos, and those which do not. The samples may be analyzed by a different analyst by the original analyst. These results are recorded in the Laboratory QC Notebook, and compared with the original result.

The bulk laboratory participates in a Interlaboratory Quality Assurance Program (IQAP) round robin asbestos sample exchange program. Results from at least three other participating laboratories are returned to the laboratory for comparison. Any discrepancies are noted and the sample re-submitted to the analyst whose analysis resulted in a discrepancy. This analyst repeats the sample and records the repeat analysis. It is the Laboratory Manager's responsibility to notify the client of any change in analytical result from that which was originally reported, this notification is also kept on file by the laboratory.

WEST LINN-WILSONVILLE SCHOOL DISTRICT 3JT WEST LINN HIGH SCHOOL-TRIP HOUSE 5290 WEST "A" SL WEST LINN, OR. ASBESTOS SURVEY TRE# 1020-88 BULK ASBESTOS SAMPLE ANALYSIS SUMMARY JANUARY 12 / 2000 PAGE 1 of 1

Asbestos Material Summary

SAMPLE#	HSA#	MATERIAL DESCRIPTION	LOCATIONS	QUANTITY	<u>CONDITION</u>	<u>РНОТО#</u>	% ASBESTOS
T-01	01	Floor tile, 9x9, mustard/gold green	Lower bedroom, under carpet	150 sq. ft.	good	2	8% chrysotile
T-07	07	Floor tile, 9x9, beige with green spots	Furnace room, lower level	60 sq. ft.	good	3	10% chrysotile
T-13	13	Floor tile 9x9, tan with light brown spots	Utility room, lower level	170 sq. ft.	good	4	3% chrysotile
T-22	22	Gasket of furnace, brown	Furnace room, blower/furnace	: 1 sq. ft,	good	6	80% chrysotile
T-40	40	Cove base mastic, yellow	N. Upper Bathroom	30 In ft.	good	11	2% chrysotile 5% Tremolite
T-43	43	Floor tile 9x9, brown with multi colors	Main floor laundry room	150 sq. ft.	Good	12	10% chrysotile
T-49	49	floor tile 9x9, tan with brown spots	Main floor, N. bedroom	120 sq. ft.	Good	13	10% chrysotile

COMMENTS: (HSA#) Represents homogeneous sampling areas of identical materials.

(Quantities) All quantities listed are approximate values.

(Condition) Condition of materials were assessed at date and time of inspection.

(Photo#) Photographs may not show specific sample location.


NOTE: All samples were collected by AHERA accredited inspectors and analyzed by NVLAP and AHIA laboratories.


CONDITIONS: Good / Fair / Poor

P.O. BOX 216 GLADSTONE, OR 97027

PHONE: (503) 557-2396 FAX: (503) 557-3025



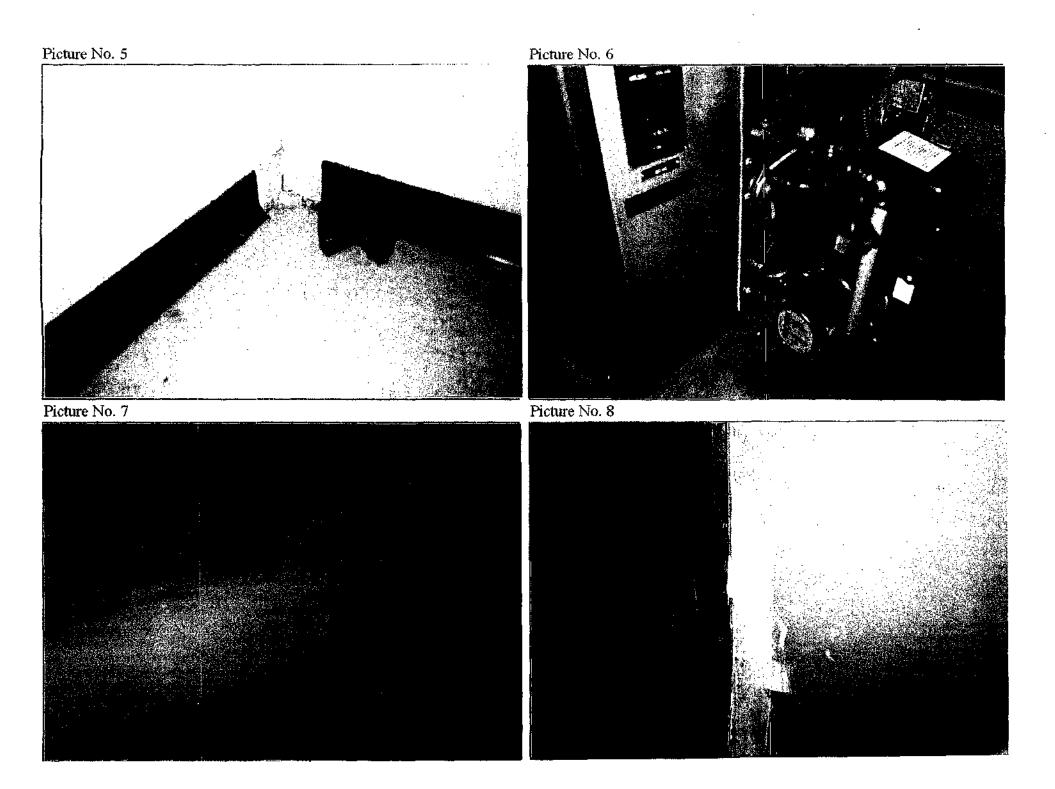

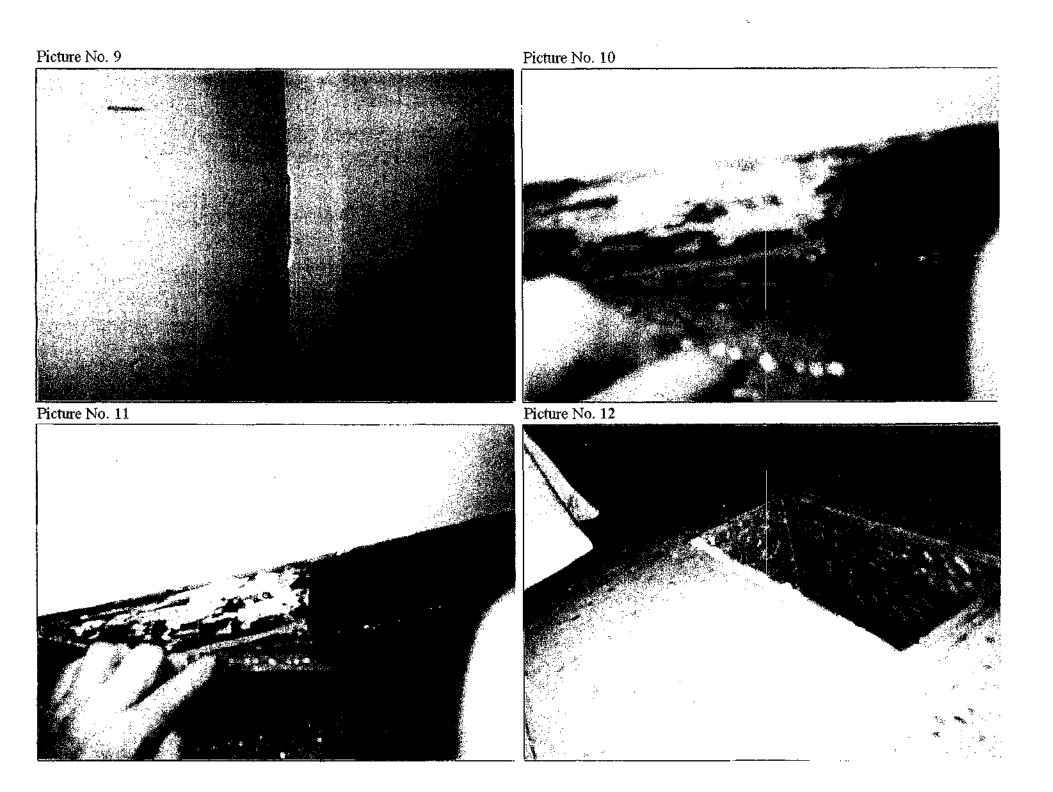

Picture No. 14

Picture No. 14



BULK ASBESTOS SAMPLE ANALYSIS SUMMARY JANUARY 12, 2000 PAGE 1 OF 3

Bulk Asbestos Sample Analysis Summary

Sample#	HSA#	Material Description	Sample Location Photo:	% Asbestos
T- 01	001	Floor tile, 9x9 mustard color	Lower bedroom,under carpet 2	8% chrysotile
T- 02	001	Floor tile, 9x9 mustard color	Lower bedroom,under carpet 2	Did not analyze
T- 03	001	Floor tile, 9x9 mustard color	Lower bedroom,under carpet 2	Did not analyze
T- 04	002	Mastic of floor tile 9x9, black	Lower bedroom, under carpet 2	0%
T- 05	002	Mastic of floor tile 9x9, black	Lower bedroom, under carpet 2	0%
T- 06	002	Mastic of floor tile 9x9, black	Lower bedroom,under carpet 2	. 0%
T- 07	003	Floor tile, 9x9, beige, brown spots	Furnace room, lower level 3	10% chrysotile
T- 08	003	Floor tile, 9x9, beige, brown spots	Furnace room, lower level 3	Did not analyze
T- 09	003	Floor tile, 9x9, beige, brown spots	Furnace room, lower level 3	Did not analyze
T- 10	004	Mastic of floor tile 9x9, black	Furnace room, lower level 3	0%
T- 11	004	Mastic of floor tile 9x9, black	Furnace room, lower level 3	0%
T- 12	004	Mastic of floor tile 9x9, black	Furnace room, lower level 3	0%
T-13	005	Floor tile, 9x9, tan w/light brown	Utility room, lower level 4	3% chrysotile
T-14	005	Floor tile, 9x9, tan w/light brown	Utility room, lower level 4	Did not analyze
T-15	005	Floor tile, 9x9, tan w/light brown	Utility room, lower level 4	Did not analyze
T-16	006	Mastic of floor tile 9x9, brown	Utility room, lower level 4	0%
T-17	006	Mastic of floor tile 9x9, brown	Utility room, lower level 4	0%
T-18	006	Mastic of floor tile 9x9, brown	Utility room, lower level 4	0%
T-19	007	Cove base mastic, yellow	Utility room, lower level 5	0%
T-20	007	Cove base mastic, yellow	Utility room, lower level 5	0%
T-21	007	Cove base mastic, yellow	Utility room, lower level 5	0%
T-22	008	Gasket of furnace, brown	Furnace room, lower level 6	80% Chrysotile
T-23	008	Gasket of furnace, brown	Furnace room, lower level 6	Did not analyze
T-24	008	Gasket of furnace, brown	Furnace room, lower level 6	Did not analyze

BULK ASBESTOS SAMPLE ANALYSIS SUMMARY JANUARY 12, 2000 PAGE 2 OF 3

Bulk Asbestos Sample Analysis Summary

Sample#	HSA#	Material Description	Sample Location]	Photo#	% Asbestos
T-25	009	Drywall taping compound	Furnace room, lower level	7	0%
T-26	009	Drywall taping compound	Furnace room, lower level	7	0%
T-27	009	Drywall taping compound	Furnace room, lower level	7	0%
T-28	010	Drywall patching compound	Furnace room, lower level	8	0%
T-29	010	Drywall patching compound	Furnace room, lower level	8	0%
T -30	010	Drywall patching compound	Furnace room, lower level	8	0%
T-31	011	Sheet rock, gray w/tan paper	Furnace room, lower level	9	0%
T-32	011	Sheet rock, gray w/tan paper	Furnace room, lower level	9	0%
T-33	011	Sheet rock, gray w/tan paper	Furnace room, lower level	9	0%
T-34	012	Sheet vinyl, gray&black w/colored specs.	Under carpet, main floor N. bathroom	10	0%
T-35	012	Sheet vinyl, gray&black w/colored specs.	Under carpet, main floor N. bathroom	10	0%
T-36	012	Sheet vinyl, gray&black w/colored specs.	Under carpet, main floor N. bathroom	10	0%
T-37	013	Mastic of sheet vinyl, black	N. bathroom, main floor	10	0%
T-38	013	Mastic of sheet vinyl, black	N. bathroom, main floor	10	0%
T-39	013	Mastic of sheet vinyl, black	N. bathroom, main floor	10	0%
T-40	014	Cove base mastic	N. bathroom, main floor	11	2% chrysotile 5% Tremolite
T-41	014	Cove base mastic	N. bathroom, main floor	11	Did not analyze
T-42	014	Cove base mastic	N. bathroom, main floor	11	Did not analyze
T-43	015	Floor tile 9x9, brown w/multi colors	Laundry room, main floor	12	10% chrysotile
T-44	015	Floor tile 9x9, brown w/multi colors	Laundry room, main floor	12	Did not analyze
T-45	015	Floor tile 9x9, brown w/multi colors	Laundry room, main floor	12	Did not analyze
T-46	016	Mastic of floor tile (9x9), black	Laundry room, main floor	12	0%
T-47	016	Mastic of floor tile (9x9), black	Laundry room, main floor	12	0%

BULK ASBESTOS SAMPLE ANALYSIS SUMMARY JANUARY 12, 2000 PAGE 3 OF 3

Bulk Asbestos Sample Analysis Summary

Sample#	HSA#	Material Description	Sample Location	Photo#	% Asbestos
T-48	016	Mastic of floor tile (9x9), black	Laundry room, main floor	12	0%
T-49	017	Floor tile 9x9, tan w/brown spots	N. bedroom, main floor	13	10% chrysotile
T-50	017	Floor tile 9x9, tan w/brown spots	N. bedroom, main floor	13	Did not analyze
T-51	017	Floor tile 9x9, tan w/brown spots	N. bedroom, main floor	13	Did not analyze
T-52	018	Mastic of floor tile (9x9), black	N. bedroom, main floor	13	0%
T- <i>5</i> 3	018	Mastic of floor tile (9x9), black	N. bedroom, main floor	. 13	0%
T-54	018	Mastic of floor tile (9x9), black	N. bedroom, main floor	13	0%
T-55	019	Skimcoat, rough textured walls	Living room, main floor	14	0%
T-56	019	Skimcoat, rough textured walls	S. bedroom, main floor	14	0%
T-57	019	Skimcoat, rough textured walls	S. bathroom, main floorr	14	0%
T-58	020	Ceiling texture, brocade	Foyer, main level	15	0%
T-59	020	Ceiling texture, brocade	Living room, main floor	15	0%
T-60	020	Ceiling texture, brocade	N.W. bedroom, main floor	15	0%
T-61	021	Roofing, three tab	Roof	N/A	0%
T-62	021	Roofing, three tab	Roof	N/A	0%
T-63	021	Roofing, three tab	Roof	N/A	0%

EITS U1-00-0723	CHAIN OF	CUSTODY	Page 1 of 4
THREE RIVERS ENVIRONMENTAL PO How 216 Gladstone, OR 97027 Plance (Stil) 557-2396 FAX: (503) 557-3025 Attention Company None: Liating Address: FILE FAX:()	SAAPLIST PPE ASBESTOS 50 PLATGORA CLPEAT CLPCM (Ab) Subjet Group CD TENTEAD Notice stop LEAD CL AA Flattic grote, uspet CL TCLP LE 197A 200/200 Sentes (floridity West)	SAMPLE TURNAR (SERVE) The Sundard (5 day) [7] Priority (3 day) [7] Rush (24 bour) [8] Other (grady)	TRE Client Number: 1020 P.O. Number: 1020 88 Project Number: 1020 88 Date Sampled: 01/10/2000 Date Submitted: 01/10/2000 Special Instructions

Sample (f)	Date	Pudiles Stop		Sample	e Description		Sumple Location	Quantity (St41.(*)	PHIEF.	Result
T-01	01-10-2000	X	FLOOR TILE	989	THE IN	WIARD COLOR	LOWER BEDDOOM, UNDER CARACT	ISO SOFT	#/2	
T-02	11		М	d	11		-11	11	ţŧ	
7-03			ı/	- 1	<i>,</i> [Н	1(tl "	
T-041	01-10-2000	_X_	MASTIC OF	FLOOR TH	E (9X9)	BLACK	LOWER BEDFOOM WHER CHANT	ISD SOFT	# / 2	
T-05_	H			11		1	"		el	
T-06	*1	<u> </u>	*			{ 			H	
T-07	01-10-1000	<u>x</u>	FLOOR TILE,	9x9	BELF I	BROWN SPOTS	FURLACE AM LOWER LEVEL	60 30 FT	#≥ 3	
T-08			11		"				11	·
T-09	- 0		£	·	<u> </u>	!			11	
T-10	01-10-2000	Х	MASTIC OF	FLOOR TH	E (9X9)	BIACK	FURLACE RM, LOWER LEVEL	6050FT	*23	
T-11	-1		н	Λ				11	11	
7-12	41		it	į(<i>t</i> 1		11		
T-13	01-12-3000	X_	KLOOR TILE	9X9 7	AN W LIN	HT BROWN SHOTS	UTILITY RM LOWER LEVEL	70 30 FT	#34	
T-14	4)		11	,		11	14	11	μ	
T-15	1.8		H			11	Il	11	11	
T-16	01-18-2000	X	MASTIC OF	FLOOR T	TUE /9xº	BROWN	UTILITY RM LOWER LOUZE	70 sq FT	# 94	
T 17	• • •))	11		И	<i>i</i> l.	/	11	
T.18.	,1		K	ų		7		11	ri .	

Sampled By. (Sign)	Refinguished By: (Sign)	Date	Time	Recogned By: (Sign)	Date	Tunc
almal	alamos	al robas	1400	Thelimber	11-11-12	gan
		77			, ,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,	
	0			LAH:		
				<u></u>		

CHA.	IN	UR	CII	ST	OD	Y
		177	\sim	A. / . A	~~	.48

marle han
THREE RIVERS
ENVIRONMENTAL
1*O Hox 216 Gladstone, Oft 97027
Phone (30) 557-2396 PAX: (303) 557-3035

ENVIRONMENTAL	
4°O Hox 216 Gladstone, OR 97027 ne (30) 557-2396 PAX: (503) 557-3625	

Anephon:	_ _
Company Name:	
i.tailing Addiess:	_
	·
PH()FAX:()

SAMPLE TYPE ASHISTOS PLACEMENT PLACE CTPCALAND SIGNER (BOAR CTTCALAND NUMBER (BOAR NUMBER (BOAR)	SAMPLE THRNA ROUND Standard (5 day) Ll Priority (2 day) Ll Rush (24 hour)
HAD I AA Mario (44) I AA Mario (740, 1874) I TCLP I FPA 100/100 Series (1884) (1884) (1884)	[] Other (quality

	·—	Page .	2 11 1	
TRE Client No.	mber:	1020		
P.O. Number:	.		•	
Project Number	: 1 <u>0</u> ?	0-8	<u>E</u>	.
Date Sampled:		_	_	
Date Submitted	: 01-	10-3	2000	_
Special lastrocións		.	··· ··· ····	
				_

Տեգոլթե ՀՄ	Date	Positive Step	Sumple Description	Sample Location	Quantity (SF(LF)	Volume	Result
T-19	01-10-200	Χ	COVE BASE MASTIC, YELLOW	UTILITY BM. LOWERLEVEL	38 W FT	#4.5	
7-20	4		d ·	<i>N N</i>	н		
T-21	4			r 1(
T-22	01-10-2000	X	GASKET OF FURNACE (BROWN)	FURNACE RM. BLOWER KILL	1 sa FT	#56	
7-23	#			11'	K	1	
T-24	//		1(//		l l	
T-25	01-10-2000	X	DEMUALL TAPENS COMPOUND	FURUACE RM, LOWER LEVE	38 CD FT	₩b7	
T-26	N		// / /	/t ' #	A		
T-27			n n n		1/		
T-28	01-10-100		DEPOSEL PATCHING COMPOUND	FURUACE DIM LOWER LAND	18 B FT	#78	
7-29	Ai -		μ - Η	1 11 11			-
T -30	11		lt if		\mathcal{H}		
T -31	01-10-2000	Х	SHEET ROCK GREY WITHU THISR	FURNACE RM, LOWER LEV.	80 50 FT	#891	
T-32	11	1	11 (1	# //	μ		
7.33	u		11	Tr It	u	7-7-	
7-34	01-10-2000	大	SHEET VINY GREY BLACK IN COLUMN SOUMES	MAIN BOOK N. BATHROOM	40 so FT	#910	
T · 35	11		et 1 11 12	u u	d		
7.36	fi.		1 11	IC R	ft		

Sympled By: (Sign)	Relingsiphel By: (Sign)	Date	Time	Recieved By: (Sign)	Date	Time
Lind .	Sundy	/sofore	1400	MYNUNL	1-11-12	901
	0//		 			
				IAR:		<u> </u>

Page 3 of 4

CHAIN	$\mathcal{O}F$	CUST	ODY
-------	----------------	-------------	-----

ade NR SI	diar
THRE	ERIVERS
ENVIRO	DNMENTAL
	Hadstone, OR 97027

Thone (500) 557-2396 FAX: (503) 557 3035

Attention.
Company Name:
tailing Address:
TILL FAX:()

SAMPLICTURE ASHISTOS APLATINAIS APLAT ABERA SAMPTICTURA APER	SAMPLE THRNA ROUNG (Stimtard (5 day) (El Priority (2 day) [] Rush (24 kor)	Project Number: 1020 Pate Sampled: 0-10-2000 Date Submitted:
III AA Flume (ug	[] Other equity	
🗍 AA (Tame gran wya)		Special Instructions
Eliteur		
El EPA 200700 Smin		
(Onding West)	······································	The second secon

Sample II)	Date	Fusishes Stop	Sumple Description	Pf3	San	ple Location	Quantity (SIVLI)	HUURE Volume	Result
T-37	01-10-2000	X	MASTIC OF SHEET VILLY	r Brock	N. UPACR	BETHEODY MAIL FROM	40 SQ FT	#9/0	
7-38	11		at at	d		11	"		
T-39	ļ(A A	, II		tt g	/(
T-40	01-10-2000	X	OWE BASE MASTIC, YEL	لعاهد	N. UPAKR	BATHROOM II	30 W FT	##011	
T-41	11		/1	//		U U			
T-42	11		ll .	H		d II	"		
T-43	01-10-2000	X	FLOOR TILE 9K9 BROWN !	N/MULTI COLORS	MAIN FLOOR	LAWSET ROOM	150 se	#412	
T-44	14		40 4	11	11	21	11		,
T-45	fl		H G	1c	11	10	"		
T-46	01-10-2000	X	MASTIC OF FLOOR TILE (9X9)	BLACK	MAIN FLOO	A. LAUWDAY BOOM	130 SQ	# #12	. <u>. </u>
T-47	11		10 (0)	10	10	"	μ		
T-48	41		11 ((71	10.	11	it		
T-49	01-10-2000	X	CLOOR TILE, 9×9, TAU W BA	own stors	MAIN FLOOR A	UO BED ROOM	130 se FT	W1813	
T-30	11		4 特		11,	į (14		
7-51	R		11 11		14	11	1{		
T-58_	a-10-1000	X	MASTIC OF FLOOR TILE, B	ACK	MAIN FLOOR	M. REDROM	130 SQ FT	-1823	
T-53	11		IX	h	11	[1			
1-24	N		11	} \	11				}

Sampled ity. (Sign)	Reformished By (Sign)	Dayle	Tunc	10 Recieved Lity: (Sign)	Date	Time
Sill Comments	Land I was a series of the ser	a frotzen	1400	Muchillane.	11-11-10	gan
		/ /				
	0			LAB:		
						<u></u>

SAMPLE TORNAROUND

MERTI Share
THREE RIVERS
ENVIRONMENTAL
PO this 216 Oladstone, OR 97027
Idama (Sintessa ones Estatessa) 560 anos

IENVIRONMENTAL, PO Bus 216 Oladstone, OR 97027 June (S03) 557 2396 FAX: (503) 557-3025	ASHESTOS CHALLING CHALLING CHALLING	M Plat Mena Superflux	্ৰি Simulard (5 day) Cl Privatty (5 day) □ Rush (24 bent)		P.O. Numbe Project Num
	□ TEM 1500	Italdes proji	·	U P	Date Sample

SAMPLE TYPE

,	TIM thing tolder any	4 lunit)
Attention:	HIAD	
Company Naire:	[AA Plante ploy [Other position	
1- Lasting Address:	□ AA Planic pole, weet -	
Transing Addition	Circle	
	[13PA 200480 Suite	
PU()FAX:()	(Ditables Water)	

	TRE Client Number: 1020
ı	P.O. Number:
ı	Project Number: 1020 - 88
H	Date Sampled: 01-10- Zeno
I	Date Submitted: 01:10-2000
	Special Instructions
1	

Page 4 of 4

Sample H	Date	Pastales Sit-p	Sumple Description	Sample Location	Quantity (SF/LE)	Valume	Hearti
-55	01-10-200	X	BRIMCOST, Rough Textured WALLS	Manshevet his ing Room	14005, FT	#13/4	
-66	1#	<u> </u>		Mainhoust, South BEDRO	AT BOD S. FT	<u>, (</u>	
r- <u>5</u> 7			.,	Markeyel S. Bath Roa	2 420 Sy FT	<u> </u>	
-58	01-10-200	<u> </u>	CRILENG TEXTURIZ RROCHOR	Mondered FOYER	605 FT	#7465	<u>-</u>
<u>7-59</u>	**			Main Level Living Room	450 Sp. FT	,	
T-60	<u>'`</u>		<u>, , , , , , , , , , , , , , , , , , , </u>	Mankeret NW. BADRO		<u> </u>	
1-61	01-10-2000	79	ROOFING, THREA TAB.	ROOF	about 2000 12	None)	
-62			19 /				
r-63	••		41	<u> </u>			
							
	<u> </u>	<u> </u>				<u> </u>	
	-					——— <u>—</u>	
	<u> </u>	-			_ 		
							
					J	~ ·-	
	.1					<u></u>	,

Spynpled By: (Sign)	Relinguisted By: (Sign)	Date	Time	Recieved By: (Sign)	Date	Trine
Sindle	Lind	0/0/200	1400	Thurw / YUV (1)	-11-00	gan
		//	[
			<u></u>	IAR:		

7489 WHITE PINE ROAD - RICHMOND, VA 23237 804-275-4788 FAX 804-275-4907

BULK ASBESTOS SAMPLE ANALYSIS SUMMARY

CLIENT:

Three Rivers Environmental

P.O. Box 216

Gladstone, OR 97027

DATE OF RECEIPT: 11 JAN 2000 DATE OF ANALYSIS: 11 JAN 2000

DATE OF REPORT: 11 JAN 2000

CLIENT NUMBER:

EHS PROJECT #:

88-2970 01-00-0723

PROJECT:

1020-88

EHS SAMPLE#	CLIENT SAMPLE #/ LABORATORY GROSS DESCRIPTION	% ASBESTOS	OTHER MATERIALS
01	T-01/ Mustard/Gold Gran.	8% Chrysotile 8% Total Asbestos	92% Non-Fibrous
02	T-02/	DID NOT ANALYZE	
03	T-03/	DID NOT ANALYZE	
04	T-04/ Black Adhes.	NAD	5% Cellulose 1% Hair 94% Non-Fibrous
05	T-05/ Black Adhes.	NAD	5% Cellulose 95% Non-Fibrous
06	T-06/ Black Adhes.	NAD	6% Cellulose 94% Non-Fibrous
07	T-07/ Beige Gran.	10% Chrysotile 10% Total Asbestos	90% Non-Fibrous
. 08	T-08/	DID NOT ANALYZE	
09	T-09/	DID NOT ANALYZE	
10	T-10/ Black Adhes.	NAD	8% Cellulose 92% Non-Fibrous
11	T-11/ Black Adhes.	NAD	5% Cellulose 2% Hair 93% Non-Fibrous
12	T-12/ Black Adhes.	NAD	7% Cellulose 93% Non-Fibrous
13	T-13/ Tan Gran.	3% Chrysotile 3% Total Asbestos	97% Non-Fibroua
14	T-14	DID NOT ANALYZE	

⁻⁻ PAGE 01 of 05 --

CLIENT NUMBER:

\$8-2970 01-00-0723

EHS PROJECT #: PROJECT:

1020-88

EHS SAMPLE#	CLIENT SAMPLE III LABORATORY GROSS DESCRIPTION	% ASBESTOS	OTHER MATERIALS
15	T-15/	DID NOT ANALYZE	
16	T-16/ Gold Adhes.	NAD	15% Cellulose 85% Non-Fibrous
17	T-17/ Gold Adhes.	NAD	12% Cellulose 88% Non-Fibrous
18	T-18/ Gold Adhes.	NAD	15% Cellulose 85% Non-Fibrous
19	T-19/ Yellow Adhes.	NAD	10% Cellulose 90% Non-Fibrous
20	T-20/ Yellow Adhes.	NAD	7% Cellulose 93% Non-Fibrous
21	T-21/ Yellow Adhes.	NAD	4% Cellulose 96% Non-Fibrous
22	T-22/ Brown Fib.	80% Chrysotile 80% Total Asbestos	2% Cellulose 18% Non-Fibrous
23	T-23/	DID NOT ANALYZE	
24	T-24/	DID NOT ANALYZE	
25	T-25/ White Brittle; Beige Fib.	NAD	55% Cellulose 45% Non-Fibrous
26	T-26/ White Brittle; Beige Fib.	NAD	55% Cellulose 45% Non-Fibrous
27	T-27/ White Brittle; Beige Fib.	NAD	55% Cellulose 45% Non-Fibrous
28	T-28/ White Brittle	NAD	5% Cellulose 95% Non-Pibrous
29	T-29/ White Brittle	NAD	5% Cellulose 95% Non-Fibrous
30	T-80/ White Brittle	NAD	10% Cellulose 90% Non-Fibrous
31	T-31/ Pale Gray/Tan Fib.	NAD	30% Cellulose 70% Non-Fibrous

CLIENT NUMBER:

88-2970

EHS PROJECT #: PROJECT:

01-00-0723 1020-88

EHS SAMPLE #	CLIENT SAMPLE #/ LABORATORY GROSS DESCRIPTION	% ASBESTOS	OTHER MATERIALS
32	T-32/ Pale Gray/Tan Fib.	NAD	30% Cellulose 70% Non-Fibrous
33	T-33/ Pale Gray/Tan Fib.	NAD	30% Cellulose 70% Non-Fibrous
34	T-34/ Black/Multi-Colored Vinyl-Like; Black Fib.	NAD	45% Cellulose 15% Hair 40% Non-Fibrous
35	T-35/ Black/Multi-Colored Vinyl-Like; Black Fib.	NAD	45% Cellulose 15% Hair 40% Non-Fibrous
36	T-36/ Black/Multi-Colored Vinyl-Like; Black Fib.	NAD	45% Cellulose 15% Hair 40% Non-Fibrous
37	T-97/ Black Adhes.	NAD	7% Cellulose 3% Hair 90% Non-Fibrous
38	T-38/ Black Adhes.	NAD	8% Cellulose 2% Hair 90% Non-Fibrous
39	T-39/ Black Adhes.	NAD	7% Cellulose 2% Hair 91% Non-Fibrous
40	T-40/ Brown Adhes.	2% Chrysotile 5% Tremolite 7% Total Asbestos	2% Cellulose 4% Fibrous Glass 87% Non-Fibrous
41	T-41/	DID NOT ANALYZE	
42	T-42/	DID NOT ANALYZE	
43	T-49/ Brown Gran.	10% Chrysotile 10% Total Asbestos	90% Non-Fibrous
44	T-44/	DID NOT ANALYZE	
45	T-45/	DID NOT ANALYZE	
46	T-46/ Black Adhes.	NAD .	20% Collulose 80% Non-Fibrous

CLIENT NUMBER:

38-2970

EHS PROJECT #: PROJECT:

01-00-0723 1020-88

ehs Sample#	CLIENT SAMPLE #/ LABORATORY GROSS DESCRIPTION	% ASBESTOS	OTHER MATERIALS
47	T-47/ Black Adhes.	NAD	15% Cellulose 85% Non-Fibrous
48	T-48/ Black Adhes.	NAD	15% Cellulose 85% Non-Fibrous
49	T-49/ Tan Gran.	10% Chrysotile 10% Total Asbestos	90% Non-Fibrous
50	T-50/	DID NOT ANALYZE	
51	T-51/	DID NOT ANALYZE	
52	T-52/ Black Adhes.	NAD	5% Cellulose 95% Non-Fibrous
53	T-53/ Black Adhes.	NAD	7% Cellulose 93% Non-Fibrous
54	T-54/ Black Adhes.	NAD	5% Cellulose 95% Non-Fibrous
55	T-55/ White/Pink Brittle	NAD	1% Cellulose 99% Non-Fibrous
56	T-56/ White/Off-White Brittle	NAD	1% Cellulose 99% Non-Fibrous
57	T-57/ White/Pink Brittle	NAD	2% Cellulose 98% Non-Fibrous
58	T-58/ White/Pink Brittle	NAD	1% Cellulose 99% Non-Fibrous
59	T-59/ White/Green Brittle	NAD	2% Cellulose 98% Non-Fibrous
60	T-60/ White/Pink Brittle	NAD	2% Cellulose 98% Non-Fibrous
61	T-61/ Black Fib.; Gray/Brown Aggregate	NAD	35% Cellulose 65% Non-Fibrous
62	T-62/ Black Fib.; Gray/Brown Aggregate	NAD	35% Cellulose 65% Non-Fibrous
63	T-63/ Black Fib.; Groy/Brown Aggregato	NAD	35% Cellulose 65% Non-Fibrous

⁻ PAGE 04 of 05 --

CLIENT NUMBER:

38-2970

EHS PROJECT #:

PROJECT:

01-00-0723 1020-88

QC SAMPLE:

MI-1993-1

REPORTING LIMIT:

1% Asbestos

METHOD:

Polarized Light Microscopy, EPA Method 600/R-93/116

ANALYST:

Mark Case

Reviewed By Authorized Signatory:

Howard Varner, Laboratory Director

Irma Faszewski, Quality Assurance Coordinator

David Xu, MS, Senior Chemist Feng Jiang, MS, Senior Geologist

Results represent the analysis of samples submitted by the client. Sample location, description, area, volume, etc., was provided by the client. This report cannot be used by the client to claim product endorsement by NVLAP or any agency of the U.S. Government. This report shall not be reproduced except in full, without the written consent of Environmental Hazards Services, L.L.C. California Certification #2319

Environmental Hazarda Services, L.L.C. recommends reanalysis by point count (for more accurate quantification) or Transmission Electron Microscopy ((TEM), for enhanced detection capabilities) for materials regulated by the EPA NESHAP (National Emission Standards for Hazardous Air Pollutants) and found to contain less than ten percent (<10%) asbestos by polarized light microscopy (PLM). Both services are available for an additional fee.

LEGENO

NAD = no asbestos detected

SCF = suspected caramic fibers

pim1.dot/01 APR 1999/ mec

-- PAGE 05 of 05 -- END OF REPORT --

Certificate of Completion

This is to certify that

Robert C. Montgomery

has satisfactorily completed

4 hours of refresher training as a

Building Inspector

in compliance with TSCA Title II

AHERA Accredited

Sep 23, 1999

Training Coordinator

Exp. Date: Sep 22, 2000





Cert. #99-1931 Conducted at: PacPro - Gresham, OR

Prezant Associates, Inc. • 330 Sixth Avenue North, Suite 200 • Seattle, Washington 98109 • (206) 281-8858





THE AMERICAN
ASSOCIATION
FOR LABORATORY
ACCREDITATION

ACCREDITED LABORATORY

A2LA has accredited

ENVIRONMENTAL HAZARDS SERVICES, L.L.C. Richmond, VA

for technical competence in the field of

Environmental Testing

The accreditation covers the specific tests and types of tests listed on the agreed scope of accreditation. This laboratory meets the requirements of ISO/IEC Guide 25-1990 "General Requirements for the Competence of Calibration and Testing Laboratories" (equivalent to relevant requirements of the ISO 9000 series of standards) and any additional program requirements in the identified field of testing.

Presented this 12th day of January, 1999.

SEAL SEAL

President

For the Accreditation Council Certificate Number 716.01

Valid to 08/31/2000

For tests or types of tests to which this accreditation applies, please refer to the laboratory's Environmental Scope of Accreditation.



THE AMERICAN ASSOCIATION FOR LABORATORY ACCREDITATION

A2LA has accredited

Environmental Hazards Services, L.L.C. Richmond, VA

under the

ENVIRONMENTAL LEAD (Pb) TESTING LABORATORY ACCREDITATION PROGRAM

By virtue of the on-site assessment of this laboratory's environmental lead (Pb) testing capabilities and successful participation in the Environmental Lead Proficiency Analytical Testing Program (ELPAT), this laboratory has been found to meet the AZLA Environmental Lead (Pb) Program Requirements. As such, this laboratory is recognized under the EPA Office of Pollution Prevention and Toxics' (OPPT) National Lead Laboratory Accreditation Program (NLLAP) for the matrices of dust, soil and paint chips (residue). The aboratory's AZLA accreditation covers the following matrices: dust, soil, paint chips (residue), air and boilding debris.

THE STATE OF THE S

Presented this 12th day of January, 1999.

President

For the Accreditation Council Certificate Number 716.01

Valid to 08/31/2000

United States Department of Commerce National Institute of Standards and Technology



ISO/IEC GUIDE 25:1990

ISO 9002:1907

Certificate of Accreditation



ENVIRONMENTAL HAZARDS SERVICES, L.L.C. RICHMOND, VA

is recognized under the National Voluntary Laboratory Accreditation Program for satisfactory compliance with criteria established in Fitle 15, Part 285 Code of Federal Regulations. These criteria encompass the requirements of ISO/IEC Cuide 25 and the relevant requirements of ISO/9002 (ANSI/ASQC Q92-1987) as suppliers of calibration or test results. Accreditation is awarded for specific services, listed on the Scope of Accreditation for:

BULK ASBESTOS FIBER ANALYSIS

December 31, 1999

- Ofertice through

for the Mational Institute of Standards and Technology

NVLAP Lab Code: 101882-0



American Association for Laboratory Accreditation

SCOPE OF ACCREDITATION TO ISO/IEC GUIDE 25-1990

ENVIRONMENTAL HAZARDS SERVICES, L.L.C.

7469 White Pine Road Richmond, VA 23237 Irma Faszewski Phone: 804 275 4788

ENVIRONMENTAL

Valid To: August 31, 2000

Certificate Number: 0716-01

In recognition of the successful completion of the A2LA evaluation process, accreditation is granted to this laboratory to perform recognized EPA methods using the following testing technologies and in the analyte categories identified below:

<u>Testing Technologies</u>: Atomic Absorption/ICP-AES Spectrometry, Atomic Absorption-Flame, Hazardous Waste Characteristics Tests

Nonpotable Water

Metals: Al, Sb, As, Ba, Be, Cd, Ca, Cr, Co, Cu, Fe, Pb, Mg, Mn, Hg, Mo, Ni, K, Se, Ag, Na, Ti, Sn, Ti, V, Zn-

per EPA test methods SW 6010, 7420, 7470

Solid/Hazardous Waste

Metais: Al, Sb, As, Ba, Be, Cd, Ca, Cr, Co, Cu, Fe, Pb, Mg, Mn, Hg, Mo, Ni, K, Se, Ag, Na, Ti, Sn, Ti, V. Zn

per EPA test methods SW 6010, 7420, 7470

Hazardous Waste Characteristics Test: TCLP

per EPA test method SW 1311

Environmental Lead: soil, paint chips (residue), dust, air, building debris

sample preparation

per EPA test methods SW3050A (soils, building debris); 3050A modified (paints, wipes)

per NIOSH test method 7082 (air)

per EPA test method 600/R-95/200 (sonification - air, paint, soil)

sample analysis

per EPA test methods SW 6010A, 7420

per NIOSH methods 7082, 7300

Leta Mayer



REINSPECTIONS

This section reflects requirements outlined in 40 CFR 763.85 (b) (l) through (c)

ACTION: Reinspection is recommended every 3 years.

TRAINING: Accredited Inspector/Management Planner.

Decide if you will train in-house people or not.

FORM: Update management plan using Inspector's report format.

At least once every three years, after the Management Plan is in effect, all buildings should be reinspected by an accredited Inspector. This differs from the periodic surveillance and is more comprehensive because the material is actually touched to determine friability or change in friability, along with noting assessment criteria such as condition. The reinspection may also include additional samples of suspect material, accessing previously inaccessible areas, and other activities. The person performing these tasks should, at least, be an accredited Inspector. An accredited Management Planner may be necessary to recommend additional response actions.

The decisions an LEA must make prior to this reinspection is to either train their in-house staff to perform the reinspection or utilize an outside consultant.

The AHERA-accredited Inspector training course is three days long, with a 50-question exam that must be passed. An AHERA Management Planner training course is an additional two days with another 50-question exam. If a person is presently an accredited Inspector or Management Planner, they must have an annual refresher course to keep their accreditation current.

RECORDKEEPING:

Keep the reinspection records in this TAB section, along with any new data. New sample locations should be noted on copies of the drawings in TAB 7, and then filed in this section.

AHERA

Three Year Asbestos Reinspection

WEST LINN SCHOOL DISTRICT #3Jt

OF

West Linn High School 5464 West "A" Street West Linn, OR 97068

Project No. 1020-68

Prepared by:

THREE RIVERS
ENVIRONMENTAL, Inc.

P.O. Box 216 Gladstone, OR 97027 Phone (503) 557-2396 Fax (503) 557-3025

Material: Boiler/tank insulation/mechanical insulation, USA 01

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: N. boiler, S. boiler, DHW tank

Quantity: Approximately 600 sq. ft.

600 sq. ft. 300 sq. ft.

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Material: Gasket, USA 01

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Boiler, gasket on B1 E. side

Quantity: Approximately 4 sq. ft.

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes
Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: I

Low pressure steam/MJP on pipe covering, USA 01

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Joints; between boiler #1 & #2 E. side

Quantity: Approximately 25 ln. ft.-10 in. O.D. low pressure steam

30 ln. ft.-12 in. O.D. low pressure steam 25 ln. ft.-14 in. O.D. low pressure steam 39 ln. ft.-6 in. O.D. low pressure steam

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Domestic hot water/MJP on corrugated pipe cover, USA 01

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Joints; between boiler #1 & #2 E. side

Quantity: Approximately 35 ln. ft.-4 in. O.D. domestic hot water

22 ln. ft.-6 in. O.D. domestic hot water

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Domestic hot water/corrugated pipe cover, USA 01

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Piping; between boiler #1 & #2 E. side

Quantity: Approximately 110 ln. ft.-4 in. O.D. domestic hot water

75 ln, ft.-6 in. O.D. domestic hot water

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Domestic cold water/corrugated pipe cover, USA 01

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Piping; between boiler #1 & #2 E. side

Quantity: Approximately 110 ln. ft.-4 in. O.D. domestic cold water

75 ln. ft.-6 in. O.D. domestic cold water

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Low pressure steam/pipe covering, USA 01

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Piping, between boiler #1 & #2 E. side

Quantity: Approximately 100 ln. ft.-10 in. O.D. low pressure steam

130 ln. ft.-12 in. O.D. low pressure steam 50 ln. ft.-14 in. O.D. low pressure steam

15 in. O.D. low pressure steam

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material:

Boiler/tank insulation, USA 02

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Boiler, DHW exchange tanks

Quantity: Approximately

60 sq. ft.

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Domestic hot water/MJP on corrugated pipe cover, USA 02

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Joints, S.W. corner

Quantity: Approximately 30 ln. ft.-4 in, O.D. domestic hot water

25 ln. ft.-6 in. O.D. domestic hot water 19 ln. ft.-8 in. O.D. domestic hot water

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Domestic hot water/corrugated pipe cover, USA 02

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Piping; S.W. corner

Quantity: Approximately 175 ln. ft.-4 in. O.D. domestic hot water

65 In. ft.-6 in. O.D. domestic hot water 65 in. ft.-8 in. O.D. domestic hot water

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Low pressure steam/pipe covering, USA 03

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: All floors in building

Quantity: Approximately 150 ln. ft.-4 in. O.D.

850 ln. ft.-6 in. O.D. 980 ln. ft.-8 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Reassess quantity and location, maintain in an intact

Material: Low pressure team/MJP on pipe covering, USA 04

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: All floors in building

Quantity: Approximately 200 ln. ft.-4 in. O.D.

165 ln. ft.-6 in. O.D. 150 ln. ft.-8 in. O.D. 20 ln. ft.-12 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Reassess quantity and location, maintain in an intact

Material: Domestic hot water/pipe covering, USA 05

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: All floors in building

Quantity: Approximately 1,500 ln. ft.-4 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Reassess quantity and location, maintain in an intact

Material: Domestic hot water/MJP on pipe covering, USA 06

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: All floors in building

Quantity: Approximately 330 ln. ft.-4 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Reassess quantity and location, maintain in an intact

Material: Domestic cold water/corrugated pipe covering, USA 07

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: All floors in building

Quantity: Approximately 925 ln. ft.-4 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Reassess quantity and location, maintain in an intact

Material: Domestic cold water/MJP on corrugated pipe cover, USA 08

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: All floors in building

Quantity: Approximately 145 ln. ft.-4 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Reassess quantity and location, maintain in an intact

Material: Acoustical/thermal plaster, USA 11

Description: Surfacing

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: First floor

Quantity: Approximately 21,531 sq. ft.

Potential for disturbance:

Potential for contact: Effect of vibration: Potential for air erosion:

Overall condition:

Change in condition from last inspection: yes
Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Low pressure steam/pipe covering, USA 50

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Gym

Quantity: Approximately 5 ln. ft.-8 in. O.D.

5 ln. ft.-6 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Reassess quantity and location, maintain in an intact

Material: Low pressure steam/MJP on pipe covering, USA 50

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Gym

Quantity: Approximately 2 ln. ft.-8 in. O.D.

3 ln. ft.-6 in. O.d.

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Reassess quantity and location, maintain in an intact

Material: Low pressure steam/pipe covering, USA 52

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Swimming pool, front room

Quantity: Approximately 20 ln. ft.-8 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes
Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Low pressure steam/pipe covering, USA 53

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Tunnel access S. rm. 554

Quantity: Approximately 40 ln. ft.-4 in. O.D.

10 ln. ft.-8 in. O.D. 8 ln. ft.-6 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Low pressure steam/MJP on pipe covering, USA 54

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Tunnel access S. rm. 554

Quantity: Approximately 4 ln. ft.-14 in. O.D.

2 ln. ft.-8 in. O.D. 12 ln. ft.-6 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Low pressure steam/pipe covering, USA 55

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Main building A., custodial office

Quantity: Approximately 12 ln. ft.-8 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Low pressure steam/pipe covering, USA 56

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Tunnels

Quantity: Approximately 460 in. ft.-12 in. O.D.

60 ln. ft.-8 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Low pressure steam/MJP on pipe covering, USA 57

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Tunnels

Quantity: Approximately 15 ln. ft.-12 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes
Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Domestic cold water/corrugated pipe covering, USA 58

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Tunnels

Quantity: Approximately 60 ln. ft.-6 in. O.D.

200 ln. ft.-4 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Domestic cold water/MJP on corrugated pipe cover, USA 59

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Tunnels

Quantity: Approximately 40 ln. ft.-4 in. O.D.

38 ln. ft.-6 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Domestic hot water/pipe covering, USA 60

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Tunnels

Quantity: Approximately 200 ln. ft.-4 in. O.D.

50 ln. ft.-6 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes
Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Domestic hot water/MJP on pipe covering, USA 61

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Tunnels

Quantity: Approximately 45 ln. ft.-4 in. O.D.

28 ln, ft.-6 in. O.D.

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category: Unchanged

Material:

Vinyl floor tile, USA 97

Description: Miscellaneous

Sampled or Assumed: Surfacing

Friable or Non-Friable: Non-friable

Locations: All floors in building

Quantity: Approximately 50,000 sq. ft.

Potential for disturbance:

Potential for contact: low

Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes

Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Transite siding, USA 98

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: All floors in building

Quantity: Approximately 400 sq. ft.

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: yes
Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Recommended response action: Reassess quantity and location

Material: Vinyl floor tile, USA 99

Description: Miscellaneous

Sampled or Assumed: Sampled

Friable or Non-Friable: Non-friable

Locations: All floors in building

Quantity: Approximately 86,055 sq. ft.

Potential for disturbance:

Potential for contact: high Effect of vibration: low

Potential for air erosion: low

Overall condition: fair

Change in condition from last inspection: yes

Assessment noted: 8 locations W. end of Cafeteria and library, material torn

loose from floor (20 sq. ft.)

Previous AHERA category: ACBM with potential for damage

New AHERA category: Damaged miscellaneous material

Recommended response action: Repair damaged area and maintain in an intact and

undamaged condition.

Material: Mag Lines

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Under old building (E & W)

Quantity: Approximately 600 ln. ft. of piping with approx. 50 hard fittings

Potential for disturbance:

Potential for contact: low-piping running under building and over ceiling

Effect of vibration: low Potential for air erosion: low

Overall condition: poor

Change in condition from last inspection: yes

Assessment noted: Exposed mag with debris, 40 ln. ft. of damage at hangers and floor extrusion, 30-40 sq. ft. debris in crawl space (access closet W. end hallway)

Previous AHERA category: ACBM with potential for damage

New AHERA category: Damaged or significantly damaged TSI

Recommended response action: Repair damaged area and maintain in an intact and

undamaged condition.

Material: Sheet Vinyl

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Library

Quantity: Approximately 300 sq. ft.

Potential for disturbance:

Potential for contact: high-vinyl flooring

Effect of vibration: moderate-heavy to moderate traffic

Potential for air erosion: low

Overall condition: fair

Change in condition from last inspection: yes
Assessment noted: Abated Summer 1999

Previous AHERA category: ACBM with potential for damage

New AHERA category:

Material: Corrugated Pipe Cover

Description: TSI

Sampled or Assumed: Sampled

Friable or Non-Friable: Friable

Locations: Rm. E. side of weight room

Quantity: Approximately 40 ln. ft.

Potential for disturbance:

Potential for contact: high-in storage room

Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition

Material: Hard Fittings

Description: TSI

Sampled or Assumed: Assumed

Friable or Non-Friable: Friable

Locations: Wood shop entrance

Quantity: Approximately 16 hard fittings

Potential for disturbance:

Potential for contact: moderate-above drop ceiling by heating duct

Effect of vibration: low

Potential for air erosion: low

Overall condition: fair

Change in condition from last inspection: yes

Assessment noted: Patch & repair, 4 hard fittings damaged, w/debris 6 sq. ft. on

drop ceiling (foyer of entrance to wood shop)

Previous AHERA category: ACBM with potential for damage

New AHERA category: Damaged or significantly damaged TSI

Recommended response action: Clean-up debris and repair damaged area and

maintain in an intact and undamaged condition

Material: Drywa

Drywall taping compound

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Friable

Locations: Throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Sheet vinyl mastic

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Under sheet vinyl, various locations throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Sheet vinyl

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Various locations throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material:

Window putty

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Throughout school (on exterior windows)

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Fire doors

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Cove base mastic

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Chalkboards

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: In classrooms throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Paint, interior

Description: Surfacing

Sampled or Assumed: Assumed

Friable or Non-Friable: Friable

Locations: Various locations throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: high Effect of vibration: low

Potential for air erosion: moderate

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: Any remaining friable ACBM or friable suspect ACBM

New AHERA category: Any remaining friable ACBM or friable suspect ACBM

Recommended response action: Maintain in an intact and undamaged condition,

Material: Electrical wire casing

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Friable

Locations: Stage lights

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: Any remaining friable ACBM or friable suspect ACBM

New AHERA category: Any remaining friable ACBM or friable suspect ACBM

Recommended response action: Maintain in an intact and undamaged condition,

Material: Drop-in ceiling tile

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Friable

Locations: Various locations throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: moderate

Effect of vibration: low

Potential for air erosion: moderate

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: Any remaining friable ACBM or friable suspect ACBM

New AHERA category: Any remaining friable ACBM or friable suspect ACBM

Recommended response action: Maintain in an intact and undamaged condition, conduct six-month inspection cycle

Material:

Transite siding, USA 98

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: All floors in building

Quantity: Approximately 10 sq. ft.

Potential for disturbance:

Potential for contact: low

Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: Unchanged

Recommended response action: Reassess quantity and location

Material:

Vinyl floor tile, USA 99

Description: Miscellaneous

Sampled or Assumed: Sampled

Friable or Non-Friable: Non-friable

Locations: All floors in building

Quantity: Approximately 11,000 sq. ft.

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: Unchanged

Recommended response action: Reassess quantity and locations

Material: Drywall taping compound

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Friable

Locations: Throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material:

Sheet vinyl mastic

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Under sheet vinyl, various locations throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Sheet vinyl

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Various locations throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Window putty

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Throughout school (on exterior windows)

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Fire doors

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Cove base mastic

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Chalkboards

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: In classrooms throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Paint, interior

Description: Surfacing

Sampled or Assumed: Assumed

Friable or Non-Friable: Friable

Locations: Various locations throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: high Effect of vibration: low

Potential for air erosion: moderate

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: Any remaining friable ACBM or friable suspect ACBM

New AHERA category: Any remaining friable ACBM or friable suspect ACBM

Recommended response action: Maintain in an intact and undamaged condition,

Material: Electrical wire casing

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Friable

Locations: Stage lights

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: Any remaining friable ACBM or friable suspect ACBM

New AHERA category: Any remaining friable ACBM or friable suspect ACBM

Recommended response action: Maintain in an intact and undamaged condition, conduct six-month inspection cycle

Material: Drop-in ceiling tile

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Friable

Locations: Various locations throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: moderate

Effect of vibration: low

Potential for air erosion: moderate

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: Any remaining friable ACBM or friable suspect ACBM

New AHERA category: Any remaining friable ACBM or friable suspect ACBM

Recommended response action: Maintain in an intact and undamaged condition,

Material:

Vinyl floor tile, USA 99

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: All floors in building

Quantity: Approximately 10,000 sq. ft.

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: Unchanged

Recommended response action: Reassess quantity and locations

Material: Drywall taping compound

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Friable

Locations: Throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material:

Sheet vinyl mastic

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Under sheet vinyl, various locations throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Sheet vinyl

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Various locations throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Window putty

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Throughout school (on exterior windows)

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Fire doors

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Cove base mastic

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: Throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Chalkboards

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Non-friable

Locations: In classrooms throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: ACBM with potential for damage

New AHERA category: ACBM with potential for damage

Recommended response action: Maintain in an intact and undamaged condition,

Material: Paint, interior

Description: Surfacing

Sampled or Assumed: Assumed

Friable or Non-Friable: Friable

Locations: Various locations throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: high Effect of vibration: low

Potential for air erosion: moderate

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: Any remaining friable ACBM or friable suspect ACBM

New AHERA category: Any remaining friable ACBM or friable suspect ACBM

Recommended response action: Maintain in an intact and undamaged condition, conduct six-month inspection cycle

Material:

Electrical wire casing

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Friable

Locations: Stage lights

Quantity: Not quantified

Potential for disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: Any remaining friable ACBM or friable suspect ACBM

New AHERA category: Any remaining friable ACBM or friable suspect ACBM

Recommended response action: Maintain in an intact and undamaged condition,

Material: Drop-in ceiling tile

Description: Miscellaneous

Sampled or Assumed: Assumed

Friable or Non-Friable: Friable

Locations: Various locations throughout school

Quantity: Not quantified

Potential for disturbance:

Potential for contact: moderate

Effect of vibration: low

Potential for air erosion: moderate

Overall condition: good

Change in condition from last inspection: no

Assessment noted:

Previous AHERA category: Any remaining friable ACBM or friable suspect ACBM

New AHERA category: Any remaining friable ACBM or friable suspect ACBM

Recommended response action: Maintain in an intact and undamaged condition,

AHERA

Three Year Asbestos Reinspection

for

WEST LINN-WILSONVILLE SCHOOL DISTRICT 3JT

West Linn High School 5464 West "A" St. West Linn, OR

Project No. 1020-15

September 1998

Prepared by

THREE RIVERS ENVIRONMENTAL

P.O. Box 216, Gladstone, Oregon 97207 (503) 557-2396 Fax (503) 557-3025

Material: Boiler/Tank Insulation/Mechanical Insulation USA 01

Description: TSI, Sampled, Friable

Locations: North Boiler, South Boiler, DHW Tank

Quantity: Approximately: 600 sq. ft.

600 sq. ft.

300 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Recommendations: 6 Month Periodic Surveillance

Material: Gasket, USA 01

Description: Miscellaneous, Non Friable

Locations: Boiler; Gasket on B1 E. Side

Quantity: Approximately 4 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Recommendations: 6 Month Periodic Surveillance

Material: Low Pressure Steam/MJP on Pipe Covering, USA 01

Description: TSI, Sampled, Friable

Locations: Joints, Between Boiler 1 & 2 E. Side

Quantity: Approximately: 25-10 in. O.D. Low Pressure Steam

30-ft. 12 in. O.D. Low Pressure Steam 25-ft. 14 in. O.D. Low Pressure Steam 39-ft. 6 in. O.D. Low Pressure Steam

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/MJP on Corrugated Pipe Cover USA 01

Description: TSI, Sampled, Friable

Locations: Joints; Between Boiler 1 & 2 E. Side

Quantity: Approximately: 35-4 in. O.D. Domestic Hot Water

22-6 in. O.D. Domestic Hot Water

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/Corrugated Pipe Covering USA 01

Description: TSI, Sampled, Friable

Locations: Piping; Between Boiler 1 & 2 E. Side

Quantity: Approximately: 110-4 in. O.D. Domestic Hot Water

75-6 in. O.D. Domestic Hot Water

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Cold Water/Corrugated Pipe Covering, USA 01

Description: TSI, Sampled, Friable

Locations: Piping; Between Boiler 1 & 2 E. Side

Quantity: Approximately: 110-4 in. O.D. Domestic Cold Water

75-6 in. O.D. Domestic Cold Water

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/Pipe Covering, USA 01

Description: TSI, Sampled, Friable

Locations: Piping; Between Boiler 1 & 2 E. Side

Quantity: Approximately: 100-10 in. O.D. Low Pressure Steam

130-12 in. O.D. Low Pressure Steam 50-14 in. O.D. Low Pressure Steam 15 in. O.D. Low Pressure Steam

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Boiler/Tank Insulation, USA 02

Description: TSI, Sampled, Friable

Locations: Boiler; DHW Exchange Tanks

Quantity: Approximately 60 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/MJP on Corrugated Pipe Covering, USA 02

Description: TSI, Sampled, Friable

Locations: Joints; SW Corner

Quantity: Approximately: 30-4 in. O.D. Domestic Hot Water

25-6 in. O.D. Domestic Hot Water 19-8 in. O.D. Domestic Hot Water

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/Corrugated Pipe Covering, USA 02

Description: TSI, Sampled, Friable

Locations: Piping, SW Corner

Quantity: Approximately: 175-4 in. O.D. Domestic Hot Water

65-6 in. O.D. Domestic Hot Water 65-8 in. O.D. Domestic Hot Water

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/Pipe Covering, USA 03

Description: TSI, Sampled, Friable

Locations: All Floors in Building

Quantity: Approximately: 150-4 in. O.D.

850-6 in. O.D. 980-8 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/MJP on Pipe Covering, USA 04

Description: TSI, Sampled, Friable

Locations: All Floors in Building

Quantity: Approximately: 200-4 in. O.D.

165-6 in. 0.D. 150-8 in. 0.D. 20-12 in. 0.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/Pipe Covering, USA 05

Description: TSI, Sampled, Friable

Locations: All Floors in Building

Quantity: Approximately 1500-4 in. 0.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/MJP on Pipe Covering, USA 06

Description: TSI, Sampled, Friable

Locations: All Floors in Building

Quantity: Approximately 330-4 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Cold Water/Corrugated Pipe Covering, USA 07

Description: TSI, Sampled, Friable

Locations: All Floors in Building

Quantity: Approximately 925-4 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Cold Water/MJP on Corrugated Pipe Covering, USA 08

Description: TSI, Sampled, Friable

Locations: All Floors in Building

Quantity: Approximately 145-4 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Acoustical/Thermal Plaster, USA 11

Description: Surfacing, Sampled, Friable

Locations: First Floor

Quantity: Approximately 21,531 sq. ft.-Removed

Potential For Disturbance:

Potential for contact:
Effect of vibration:
Potential for air erosion:

Overall Condition:

Previous AHERA Category: Removed

New AHERA Category:

Recommendations:

Material: Low Pressure Steam/Pipe Covering, USA 50

Description: TSI, Sampled, Friable

Locations: Gym

Quantity: Approximately: 5-8 in. O.D.

5-6 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/MJP on Pipe Covering, USA 50

Description: TSI, Sampled, Friable

Locations: Gym

Quantity: Approximately: 2-8 in. O.D.

3-6 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/Pipe Covering, USA 52

Description: TSI, Sampled, Friable

Locations: Swimming Pool, Front Room

Quantity: Approximately 20-8 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/Pipe Covering, USA 53

Description: TSI, Sampled, Friable

Locations: Tunnel Access South, Rm. 554

Quantity: Approximately: 40-14 in. O.D.

10-8 in. O.D.

8-6 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/MJP on Pipe Covering, USA 54

Description: TSI, Sampled, Friable

Locations: Tunnel Access South, Rm. 554

Quantity: Approximately: 4-14 in. O.D.

2-8 in. O.D. 12-6 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/Pipe Covering, USA 55

Description: TSI, Sampled, Friable

Locations: Main Building A, Custodial Office

Quantity: Approximately 12-8 in.O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/Pipe Covering, USA 56

Description: TSI, Sampled, Friable

Locations: Tunnels

Quantity: Approximately: 460-12 in. O.D.

60-8 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/MJP on Pipe Covering, USA 57

Description: TSI, Sampled, Friable

Locations: Tunnels

Quantity: Approximately 15-12 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Cold Water/Corrugated Pipe Covering, USA 58

Description: TSI, Sampled, Friable

Locations: Tunnels

Quantity: Approximately: 60-6 in. O.D.

200-4 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Cold Water/MJP on Corrugated Pipe Cover, USA 59

Description: TSI, Sampled, Friable

Locations: Tunnels

Quantity: Approximately: 40-4 in. O.D.

38-6 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/Pipe Covering, USA 60

Description: TSI, Sampled, Friable

Locations: Tunnels

Quantity: Approximately: 200-4 in. O.D.

50-6 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/MJP on Pipe Covering, USA 61

Description: TSI, Sampled, Friable

Locations: Tunnels

Quantity: Approximately: 45-4 in. O.D.

28-6 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Vinyl Floor Tile, USA 97

Description: Miscellaneous, Sampled, Non Friable

Locations: All Floors in Building

Quantity: Approximately 50,000 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Transite Siding, USA 98

Description: Miscellaneous, Assumed, Non Friable

Locations: All Floors in Building

Quantity: Approximately 400 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Vinyl Floor Tile, USA 99

Description: Miscellaneous, Sampled, Non Friable

Locations: All Floors in Building

Quantity: Approximately 86,055 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Transite Siding, USA 98

Description: Miscellaneous, Non Friable

Locations: All Floors in Building.

Quantity: Approximately 10 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Vinyl Floor Tile, USA 99

Description: Miscellaneous, Sampled, Non Friable

Locations: All Floors in Building.

Quantity: Approximately 11,000 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Vinyl Floor Tile, USA 99

Description: Miscellaneous, Sampled, Non Friable

Locations: All Floors in Building.

Quantity: Approximately 10,000 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

AHERA Reinspection THREE RIVERS ENVIRONMENTAL, Inc. Signature Page

Three Rivers Environmental, Inc. utilized only inspectors accredited as per the EPA Model Accreditation Plan, 40 CFR 763, Subpart E, Appendix C at a minimum. In addition, all inspectors utilized on projects in states which require additional training qualifications and licensing met these

qualifications	and were so licensed i	n that state. In addition to the E	EPA required training, Three Rivers further examination prior to project
The inspection	was conducted by the	e fallowing Three Rivers Enviro	onmental, Inc. personnel:
\			100
VEFF	DMHH.	<u> </u>	
	Name	Accreditation	Signature
M	1	00.40	m+++ 1.1
MATT	<u> 104N2011</u>	98-08182	- Marin Gomon
	Name	Accreditation	Signature
SHAWN	() SIN	90_181ali	
	Name	Accreditation	Signature
	•		
The Managem Inc. personnel		ation was developed by the fallo	owing Three Rivers Environmental
DEFF	Smoth_	98-08179	AMON
	Name	Accreditation	Signature
	Name	Accreditation .	Signature
	Name	Accreditation	Signature

AHERA

Three Year Asbestos Reinspection

for

WEST LINN-WILSONVILLE SCHOOL DISTRICT 3JT

West Linn High School 5464 West "A" St. West Linn, OR

Project No. 1020-07

May/June 1995

Prepared by

170 E Arlington Gladstone, Oregon 97027 (503) 656-4601



AHERA Re-inspection Signature page

Three Rivers Environmental utilized only inspectors accredited as per the EPA Model Accreditation Plan, 40 CFR 763, Subpart E, Appendix C at a minimum. In addition, all inspectors utilized on projects in states which require additional training, qualifications and licensing, met these qualifications and were so licensed in that state. In addition to the EPA required training, Three Rivers Environmental inspectors receive extensive field training and further examination prior to project assignment.

Material: Transite Siding, USA 98

Description: Miscellaneous, Non Friable

Locations: All Floors in Building.

Quantity: Approximately 10 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Vinyl Floor Tile, USA 99

Description: Miscellaneous, Sampled, Non Friable

Locations: All Floors in Building.

Quantity: Approximately 11,000 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Boiler/Tank Insulation/Mechanical Insulation USA 01

Description: TSI, Sampled, Friable

Locations: North Boiler, South Boiler, DHW Tank

Quantity: Approximately: 600 sq. ft.

600 sq. ft. 300 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Gasket, USA 01

Description: Miscellaneous, Non Friable

Locations: Boiler; Gasket on B1 E. Side

Quantity: Approximately 4 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/MJP on Pipe Covering, USA 01

Description: TSI, Sampled, Friable

Locations: Joints, Between Boiler 1 & 2 E. Side

Quantity: Approximately: 25-10 in. O.D. Low Pressure Steam

30-ft. 12 in. O.D. Low Pressure Steam 25-ft. 14 in. O.D. Low Pressure Steam 39-ft. 6 in. O.D. Low Pressure Steam

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/MJP on Corrugated Pipe Cover USA 01

Description: TSI, Sampled, Friable

Locations: Joints; Between Boiler 1 & 2 E. Side

Quantity: Approximately: 35-4 in. O.D. Domestic Hot Water

22-6 in. O.D. Domestic Hot Water

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/Corrugated Pipe Covering USA 01

Description: TSI, Sampled, Friable

Locations: Piping; Between Boiler 1 & 2 E. Side

Quantity: Approximately: 110-4 in. O.D. Domestic Hot Water

75-6 in. O.D. Domestic Hot Water

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Cold Water/Corrugated Pipe Covering, USA 01

Description: TSI, Sampled, Friable

Locations: Piping; Between Boiler 1 & 2 E. Side

Quantity: Approximately: 110-4 in. O.D. Domestic Cold Water

75-6 in. O.D. Domestic Cold Water

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/Pipe Covering, USA 01

Description: TSI, Sampled, Friable

Locations: Piping; Between Boiler 1 & 2 E. Side

Quantity: Approximately: 100 10 in. O.D. Low Pressure Steam

130-12 in. O.D. Low Pressure Steam 50-14 in. O.D. Low Pressure Steam 15 in. O.D. Low Pressure Steam

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Boiler/Tank Insulation, USA 02

Description: TSI, Sampled, Friable

Locations: Boiler; DHW Exchange Tanks

Quantity: Approximately 60 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/MJP on Corrugated Pipe Covering, USA 02

Description: TSI, Sampled, Friable

Locations: Joints; SW Corner

Quantity: Approximately: 30-4 in. O.D. Domestic Hot Water

25-6 in. O.D. Domestic Hot Water 19-8 in. O.D. Domestic Hot Water

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/Corrugated Pipe Covering, USA 02

Description: TSI, Sampled, Friable

Locations: Piping, SW Corner

Quantity: Approximately: 175-4 in. O.D. Domestic Hot Water

65-6 in. O.D. Domestic Hot Water 65-8 in. O.D. Domestic Hot Water

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/Pipe Covering, USA 03

Description: TSI, Sampled, Friable

Locations: All Floors in Building

Quantity: Approximately: 150-4 in. O.D.

850-6 in. O.D.

980-8 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/MJP on Pipe Covering, USA 04

Description: TSI, Sampled, Friable

Locations: All Floors in Building

Quantity: Approximately: 200-4 in. O.D.

165-6 in. O.D. 150-8 in. O.D. 20-12 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/Pipe Covering, USA 05

Description: TSI, Sampled, Friable

Locations: All Floors in Building

Quantity: Approximately 1500-4 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/MJP on Pipe Covering, USA 06

Description: TSI, Sampled, Friable

Locations: All Floors in Building

Quantity: Approximately 330-4 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Cold Water/Corrugated Pipe Covering, USA 07

Description: TSI, Sampled, Friable

Locations: All Floors in Building

Quantity: Approximately 925-4 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Cold Water/MJP on Corrugated Pipe Covering, USA 08

Description: TSI, Sampled, Friable

Locations: All Floors in Building

Quantity: Approximately 145-4 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Acoustical/Thermal Plaster, USA 11

Description: Surfacing, Sampled, Friable

Locations: First Floor

Quantity: Approximately 21,531 sq. ft.-Removed

Potential For Disturbance:

Potential for contact: Effect of vibration: Potential for air erosion:

Previous AHERA Category:

Removed

New AHERA Category:

Recommendations:

Overall Condition:

Material: Low Pressure Steam/Pipe Covering, USA 50

Description: TSI, Sampled, Friable

Locations: Gym

Quantity: Approximately: 5-8 in. O.D.

5-6 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/MJP on Pipe Covering, USA 50

Description: TSI, Sampled, Friable

Locations: Gym

Quantity: Approximately: 2-8 in. O.D.

3-6 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/Pipe Covering, USA 52

Description: TSI, Sampled, Friable

Locations: Swimming Pool, Front Room

Quantity: Approximately 20-8 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/Pipe Covering, USA 53

Description: TSI, Sampled, Friable

Locations: Tunnel Access South, Rm. 554

Quantity: Approximately: 40-14 in. O.D.

10-8 in. O.D.

8-6 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/MJP on Pipe Covering, USA 54

Description: TSI, Sampled, Friable

Locations: Tunnel Access South, Rm. 554

Quantity: Approximately: 4-14 in. O.D.

2-8 in. O.D. 12-6 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/Pipe Covering, USA 55

Description: TSI, Sampled, Friable

Locations: Main Building A, Custodial Office

Quantity: Approximately 12-8 in.O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/Pipe Covering, USA 56

Description: TSI, Sampled, Friable

Locations: Tunnels

Quantity: Approximately: 460-12 in. O.D.

60-8 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Low Pressure Steam/MJP on Pipe Covering, USA 57

Description: TSI, Sampled, Friable

Locations: Tunnels

Quantity: Approximately 15-12 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

AHERARE-INSPECTION MAY/JUNE. 1995 PAGE 26 OF 32

AHERA Re-inspection

Material: Domestic Cold Water/Corrugated Pipe Covering, USA 58

Description: TSI, Sampled, Friable

Locations: Tunnels

Quantity: Approximately: 60-6 in. O.D.

200-4 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Cold Water/MJP on Corrugated Pipe Cover, USA 59

Description: TSI, Sampled, Friable

Locations: Tunnels

Quantity: Approximately: 40-4 in. O.D.

38-6 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/Pipe Covering, USA 60

Description: TSI, Sampled, Friable

Locations: Tunnels

Quantity: Approximately: 200-4 in. O.D.

50-6 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Domestic Hot Water/MJP on Pipe Covering, USA 61

Description: TSI, Sampled, Friable

Locations: Tunnels

Quantity: Approximately: 45-4 in. O.D.

28-6 in. O.D.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Vinyl Floor Tile, USA 97

Description: Miscellaneous, Sampled, Non Friable

Locations: All Floors in Building

Quantity: Approximately 50,000 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Transite Siding, USA 98

Description: Miscellaneous, Assumed, Non Friable

Locations: All Floors in Building

Quantity: Approximately 400 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Vinyl Floor Tile, USA 99

Description: Miscellaneous, Sampled, Non Friable

Locations: All Floors in Building

Quantity: Approximately 86,055 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged

Material: Vinyl Floor Tile, USA 99

Description: Miscellaneous, Sampled, Non Friable

Locations: All Floors in Building.

Quantity: Approximately 10,000 sq. ft.

Potential For Disturbance:

Potential for contact: low Effect of vibration: low

Potential for air erosion: low

Overall Condition: good

Previous AHERA Category: ACBM With Potential for Damage

New AHERA Category: Unchanged